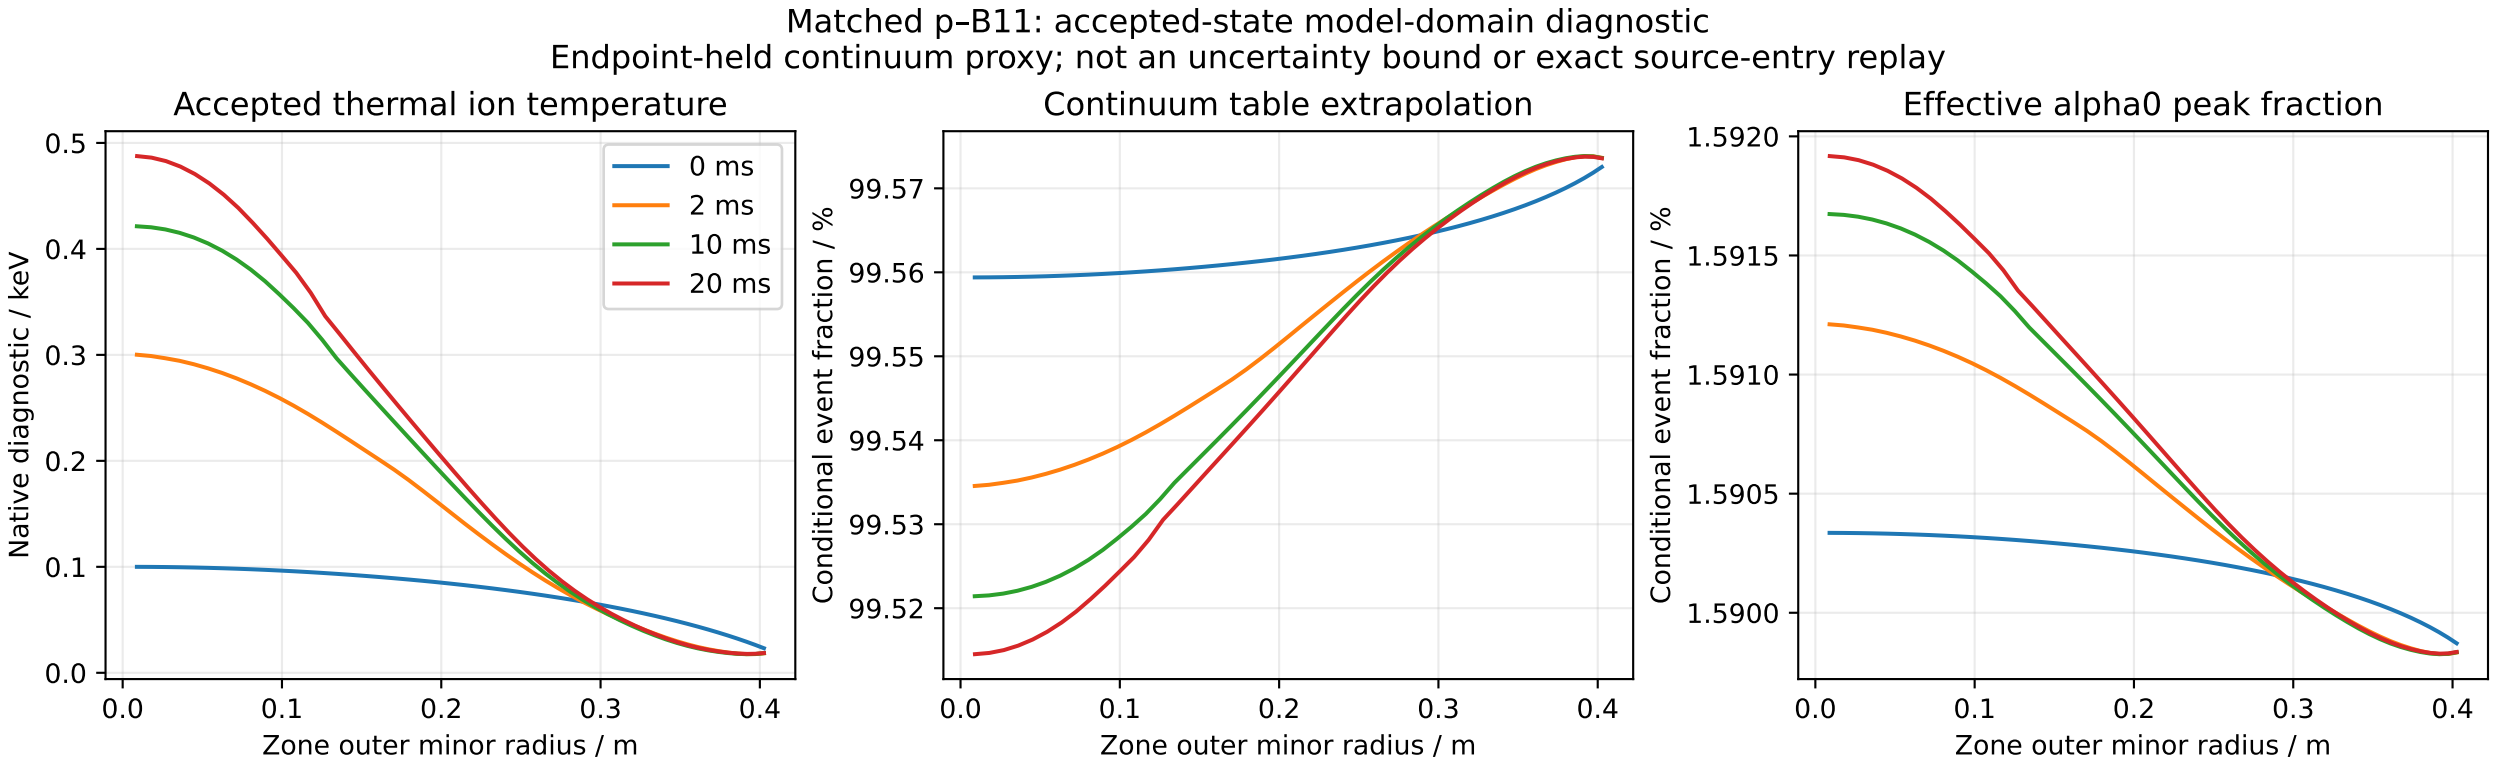
Matched p–B11: accepted-state model-domain diagnostic
Endpoint-held continuum proxy; not an uncertainty bound or exact source-entry replay
Accepted thermal ion temperature
Native diagnostic / keV
0 ms
2 ms
10 ms
20 ms
Zone outer minor radius / m
Continuum table extrapolation
Conditional event fraction / %
Zone outer minor radius / m
Effective alpha0 peak fraction
Conditional event fraction / %
Zone outer minor radius / m