
Device Variability Report


Date Range	10/11/2010 - 1/11/2011		
Device 1	Epson Stylus Pro 4900	Device 2	Epson Stylus Pro 4900
Dongle Number	U10554 - Demo	Dongle Number	U10554 - Demo
Location Name	Demo Branch	Location Name	Demo Branch
Company	CGS	Company	CGS
Measurement ID	1 - 18	Measurement ID	1 - 18


Search Field	Operator	Criteria
---	---	
---	---	
---	---	


© CGS 2020

Device 1 : Epson Stylus Pro 4900		
Error Rate : 50.00%	Number Of Reads : 18	Total Errors : 9

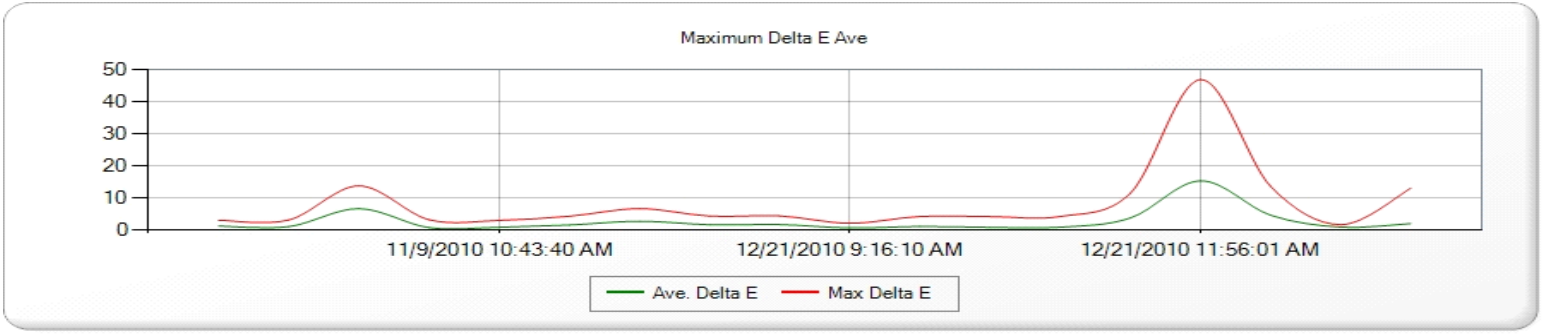

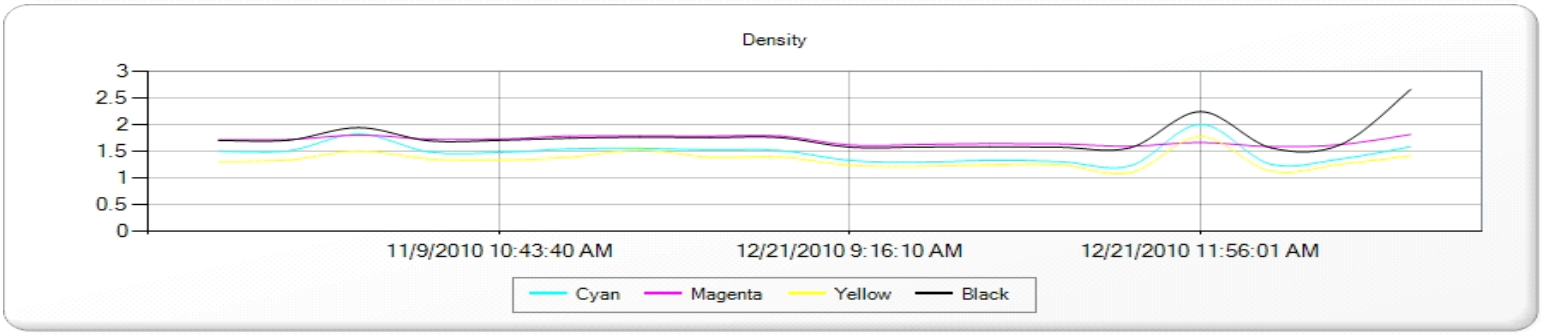

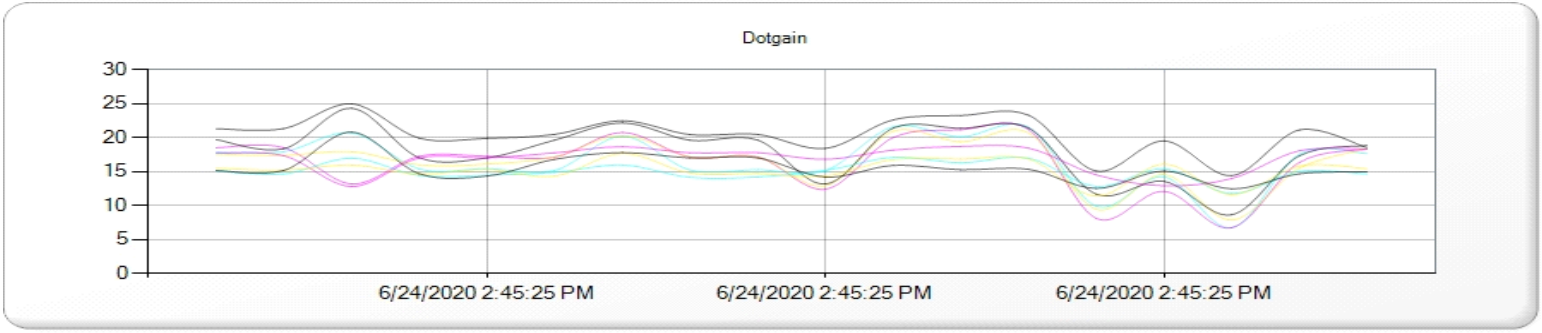


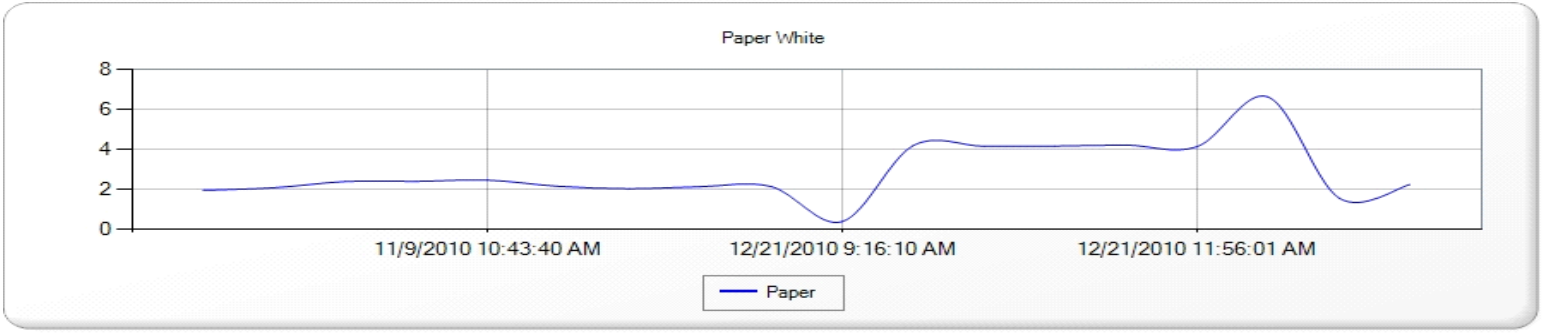



© CGS 2020


Device 2 : Epson Stylus Pro 4900

Error Rate : 50.00% | Number Of Reads : 18 | Total Errors : 9

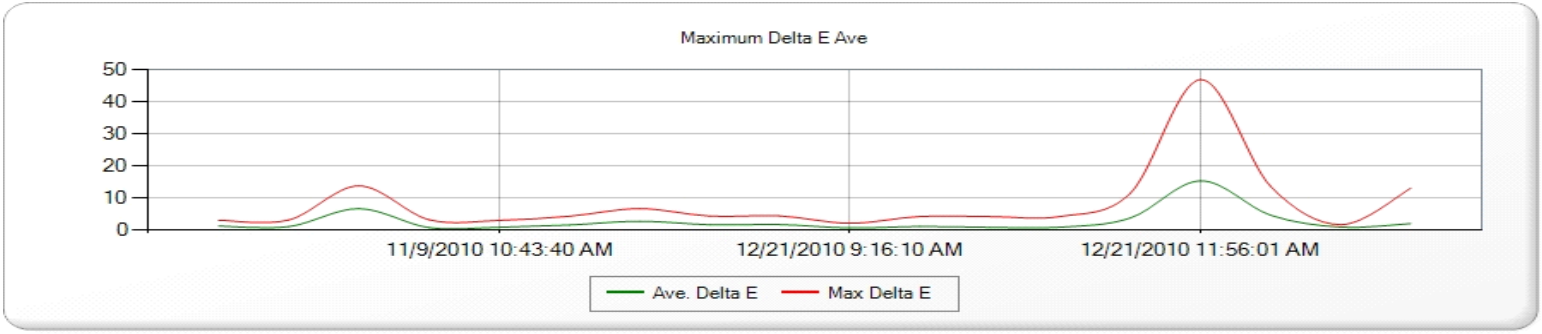

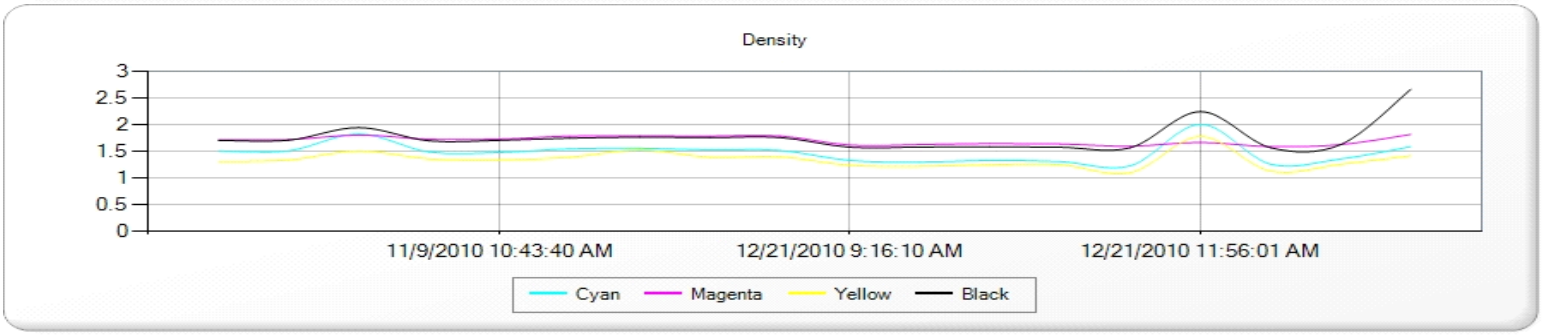

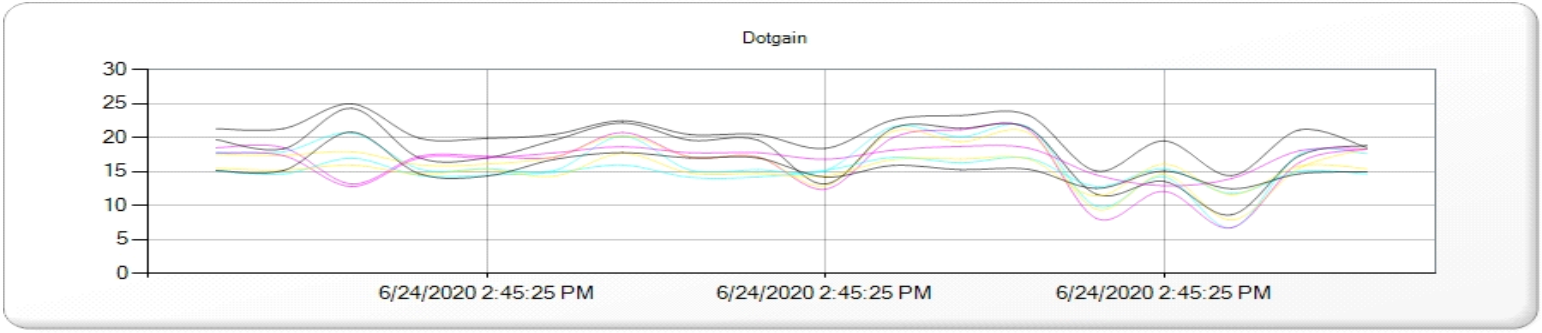

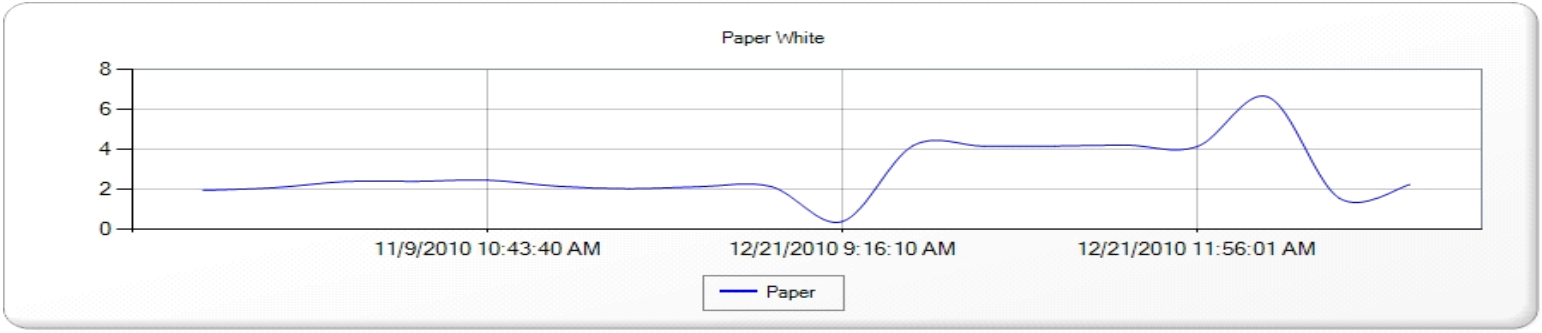

© CGS 2020