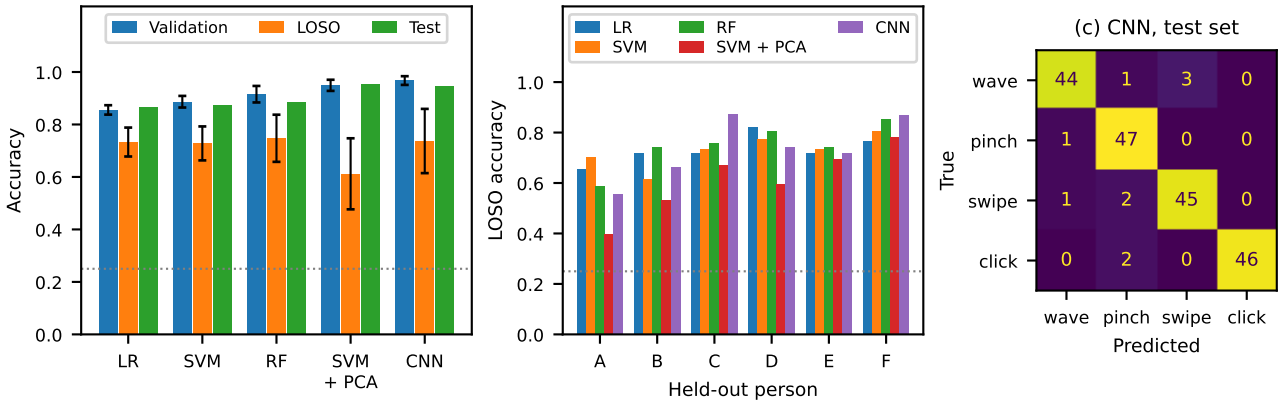
(a) Accuracy per model
Validation
LOSO
Test
Accuracy
0.0
0.2
0.4
0.6
0.8
1.0
LR
SVM
RF
SVM + PCA
CNN
(b) Accuracy per held-out person
LR
SVM
RF
SVM + PCA
CNN
LOSO accuracy
0.0
0.2
0.4
0.6
0.8
1.0
A
B
C
D
E
F
Held-out person
(c) CNN, test set
True
wave
pinch
swipe
click
44
1
3
0
1
47
0
0
1
2
45
0
0
2
0
46
wave
pinch
swipe
click
Predicted