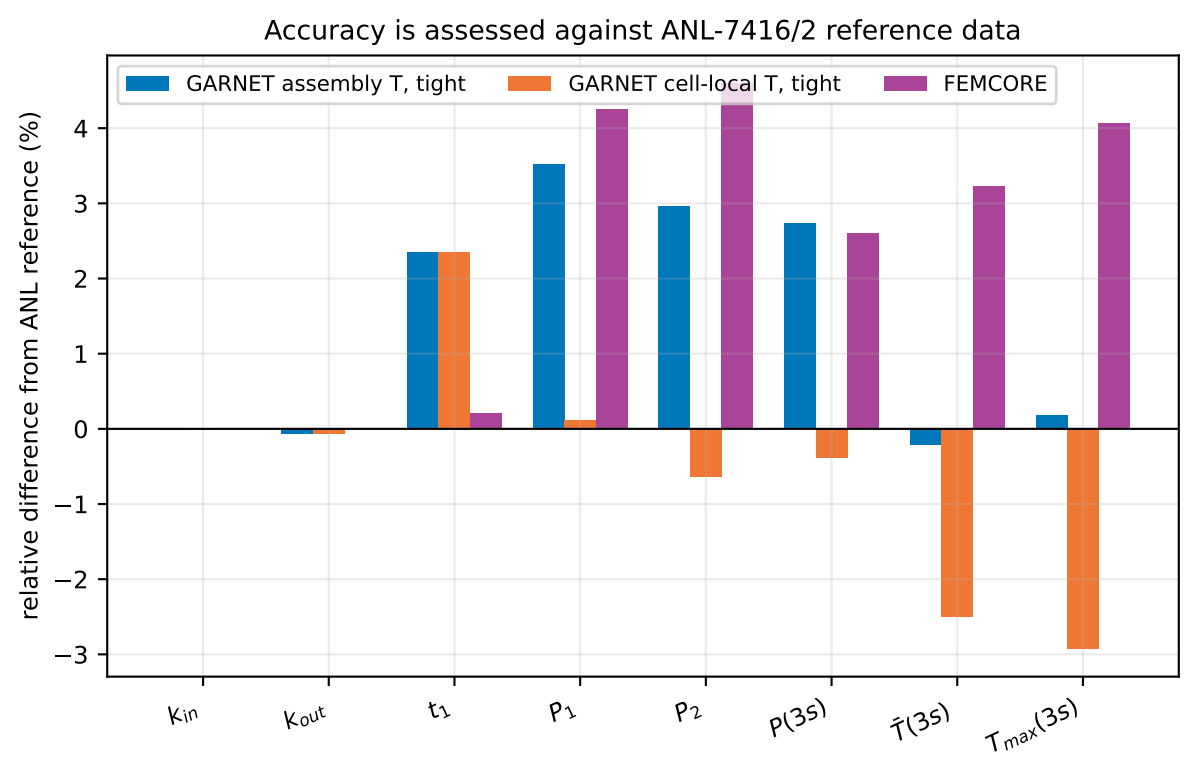
Accuracy is assessed against ANL-7416/2 reference data
GARNET assembly T, tight
GARNET cell-local T, tight
FEMCORE
relative difference from ANL reference (%)
4
3
2
1
0
−1
−2
−3
k_{in}
k_{out}
t_1
P_1
P_2
$P(3S)$
$\bar{T}(3S)$
$T_{max}(3S)$