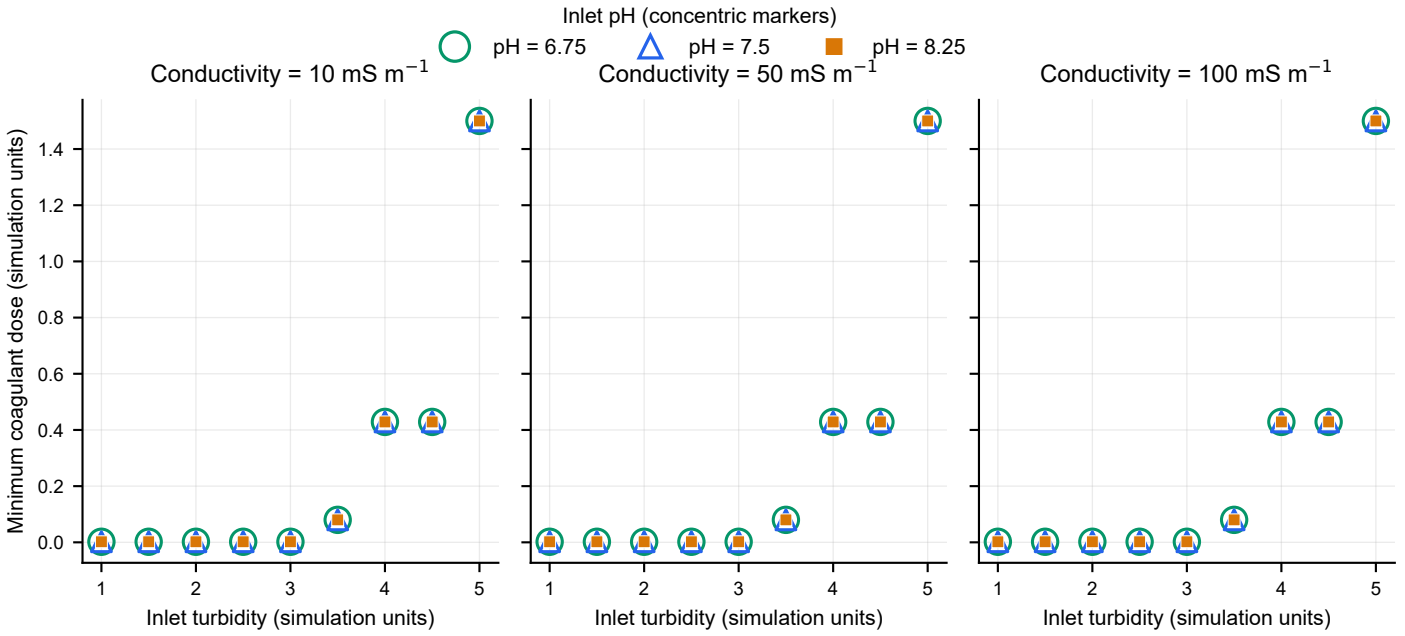

Inlet pH (concentric markers)
pH = 6.75
pH = 7.5
pH = 8.25
Conductivity = 10 mS m^{-1}
Conductivity = 50 mS m^{-1}
Conductivity = 100 mS m^{-1}
Minimum coagulant dose (simulation units)
0.0
0.2
0.4
0.6
0.8
1.0
1.2
1.4
1
2
3
4
5
Inlet turbidity (simulation units)