
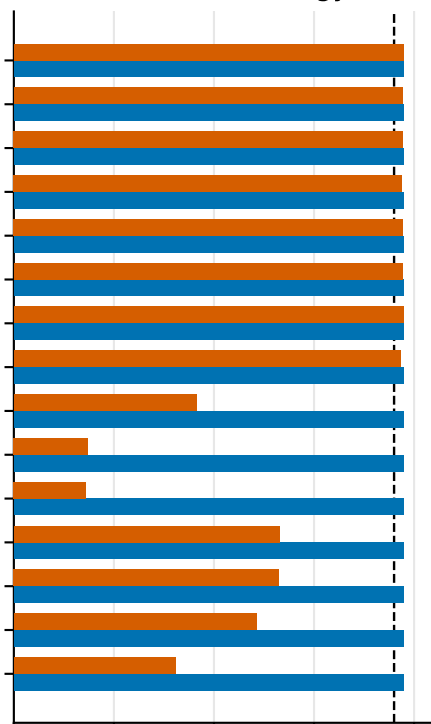


Fixed interval

Closed loop



PLEIAData temperature

PLEIAData energy

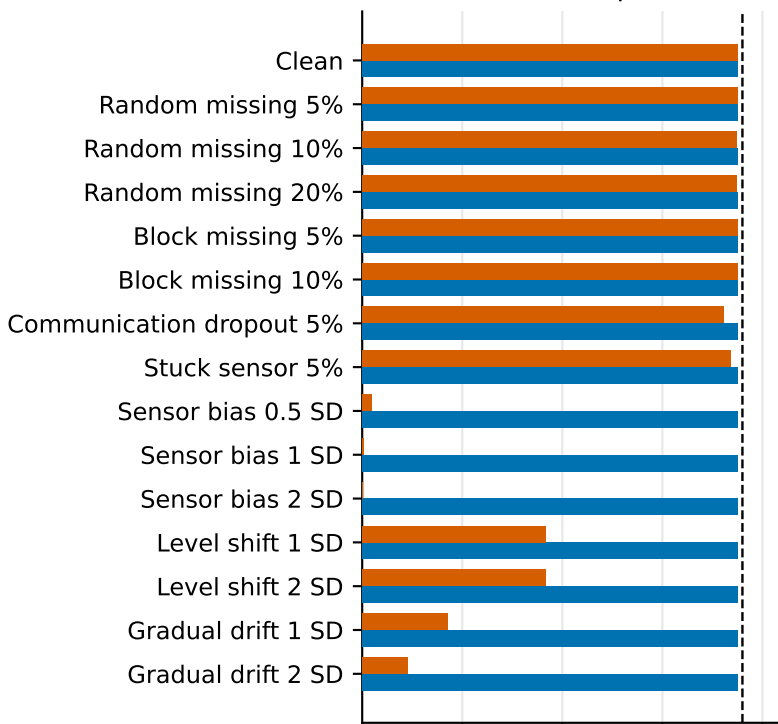

RICO HVAC

BDG2 electricity

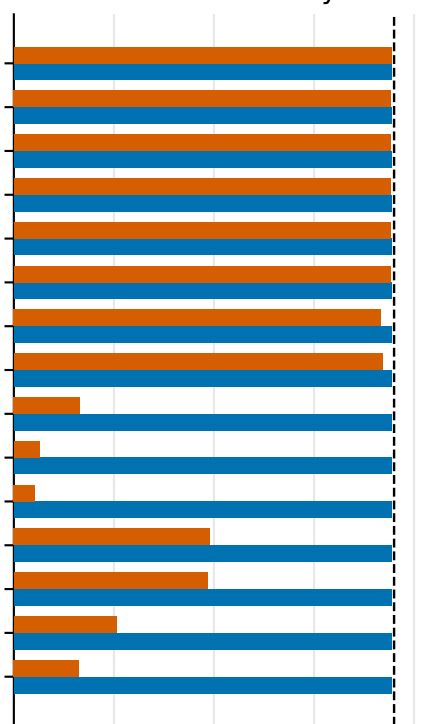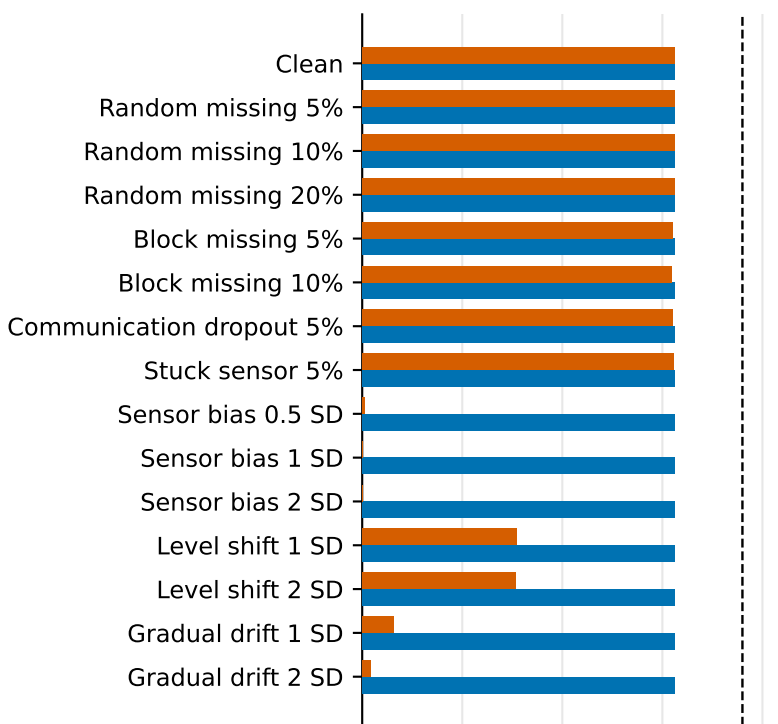

0.00 0.25 0.50 0.75 1.00 0.00 0.25 0.50 0.75 1.00

Clean-reference coverage