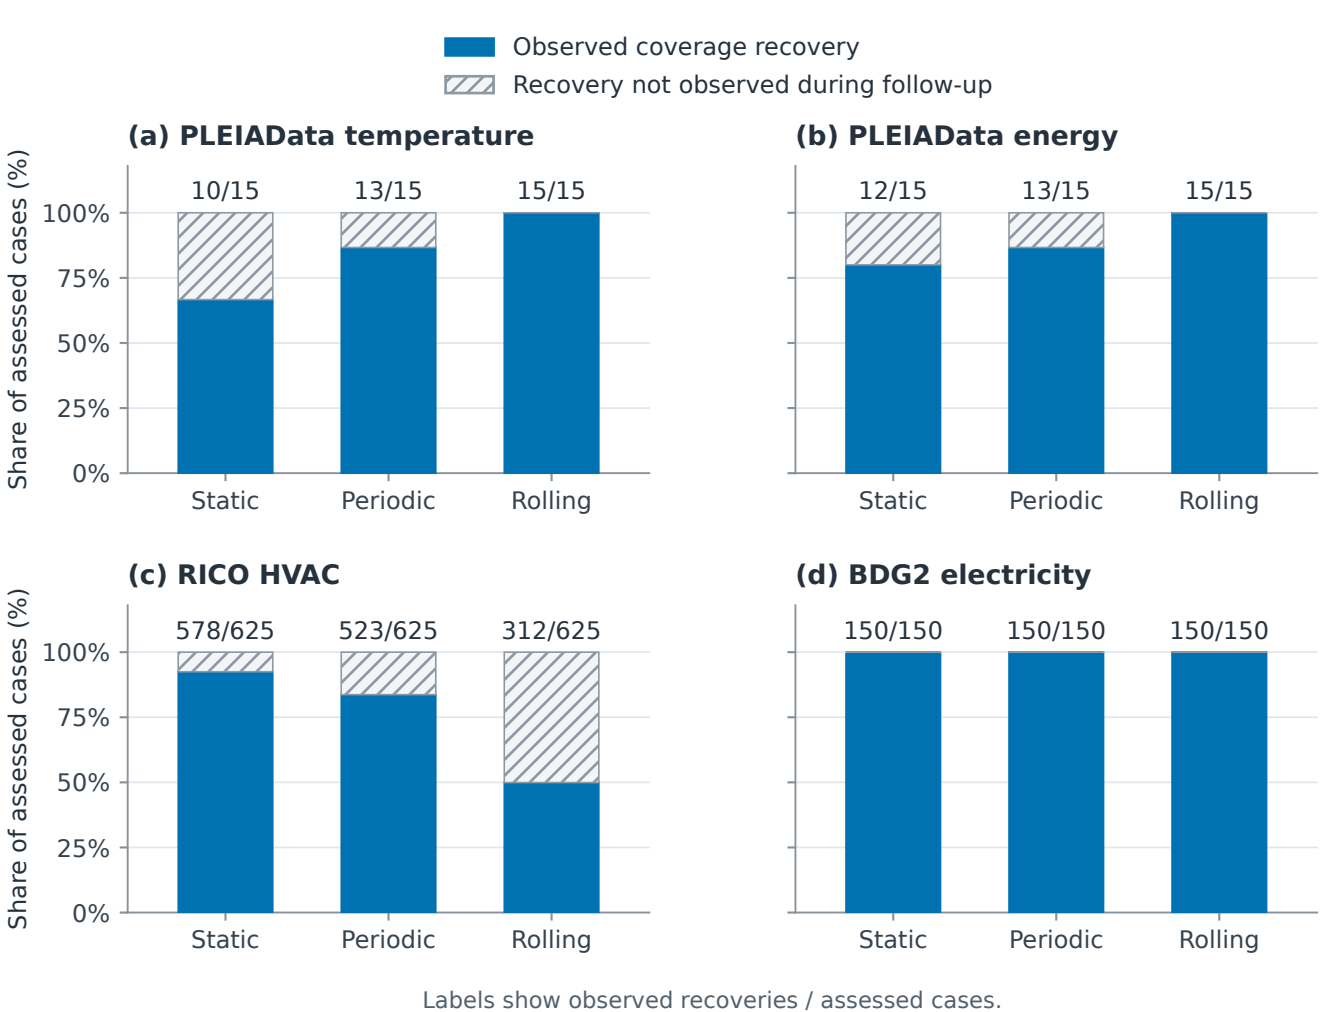
Observed coverage recovery
Recovery not observed during follow-up
(a) PLEIAData temperature
(b) PLEIAData energy
(c) RICO HVAC
(d) BDG2 electricity
Share of assessed cases (%)
100%
75%
50%
25%
0%
10/15
13/15
15/15
12/15
13/15
15/15
578/625
523/625
312/625
150/150
150/150
150/150
Static
Periodic
Rolling
Labels show observed recoveries / assessed cases.