


Contracted real-data validation metrics

Seed 42 · identical chronological split and training budget · test set not used


Validation macro NSE

Higher is better

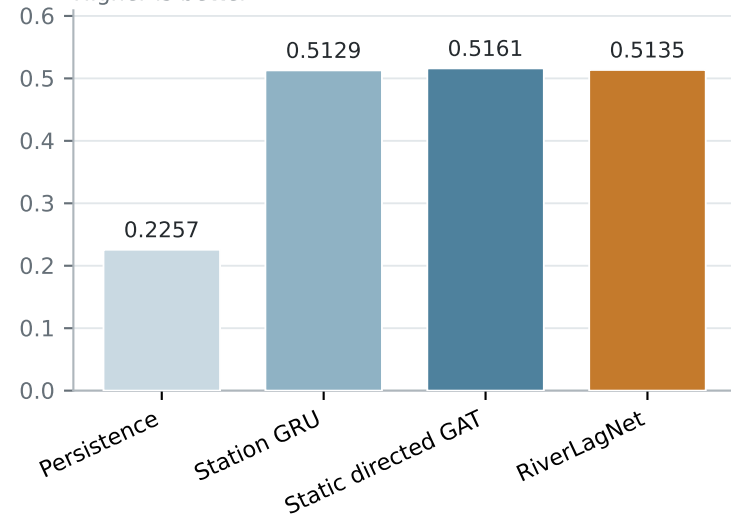


Validation macro MAE

Lower is better · physical units

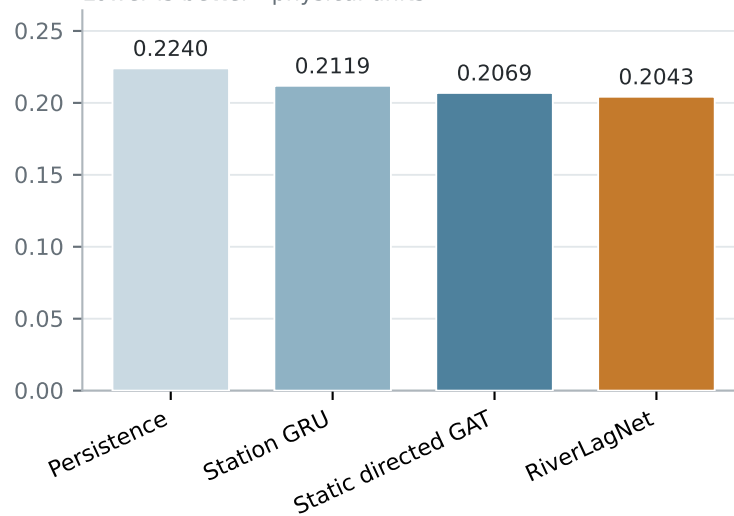

Validation macro RMSE

Lower is better · physical units

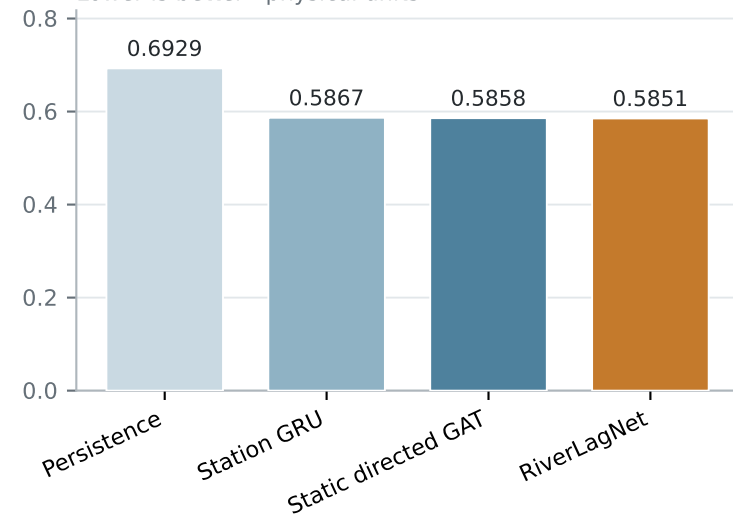

RiverLagNet NSE delta: +0.0007 vs Station GRU; -0.0025 vs Static directed GAT. Single-seed evidence only.