

FIGURE - 1

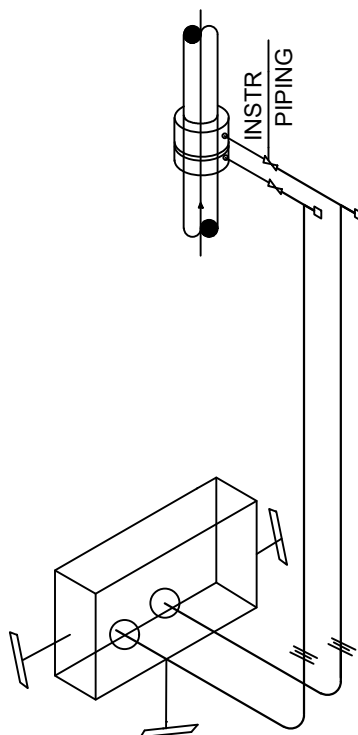


FIGURE - 2  
ALTERNATIVE INSTALLATION  
WITH MANIFOLD

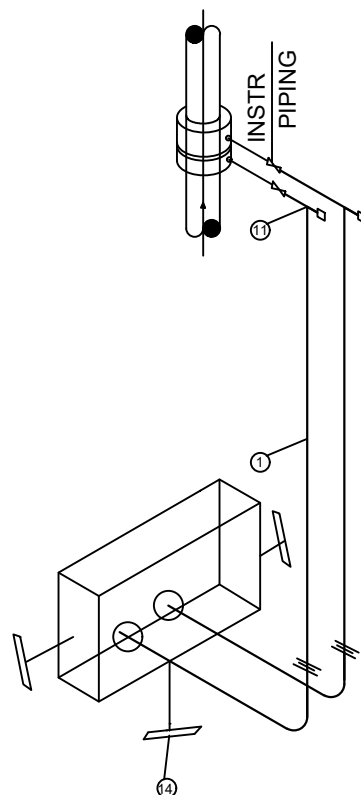


FIGURE - 3  
ALTERNATIVE INSTALLATION  
WITH TUBING

ITEM	QTY	SIZE	ITEM	MATERIAL
1		1/2"	TUBE	
2		1/2"	LINE PIPE MIN, SCHEDULE 40	
3		1/2"	ELBOW	
4		1/2"	TEE EQUAL	
7		1/2"	NIPPLE	
8		1/2"	UNION	
9		1/2"	GLOBE VALVE	
10		1/2"	GATE VALVE	
11		1/2"	CONNECTOR,MALE,COMPR,TYPE	
14		1/2"	MANIFOLD	
18		1/2"	PLUGE	

**NOTES:-**

- 1- FOR MINIMUM LENGHT OF STRAIGHT RUN OF PIPE REQUIRED O EACH SIDE OF ORIFICE P LATE SEE STANDARD DROWING NUMBER IPS-D-102
- 2 - FOR IMPLUSE PIPING 1/2" PIPE SHOULD BE USED TUBING MAY ONLY BE USED WHEN SPECIFIED.
- 3 - METER LEADS SHOULD BE AS SHORT AS POSSIBLE PREFERBLY NOT EXCEEDING THAN 6 METER

C			*****			
B			LIQUID STEAM OR			
A			CONDENSATE VAPOR			
REV	DESCRIPTION	DATE	SERVICE			
			DATE	DROWING NO.	SHE	REV