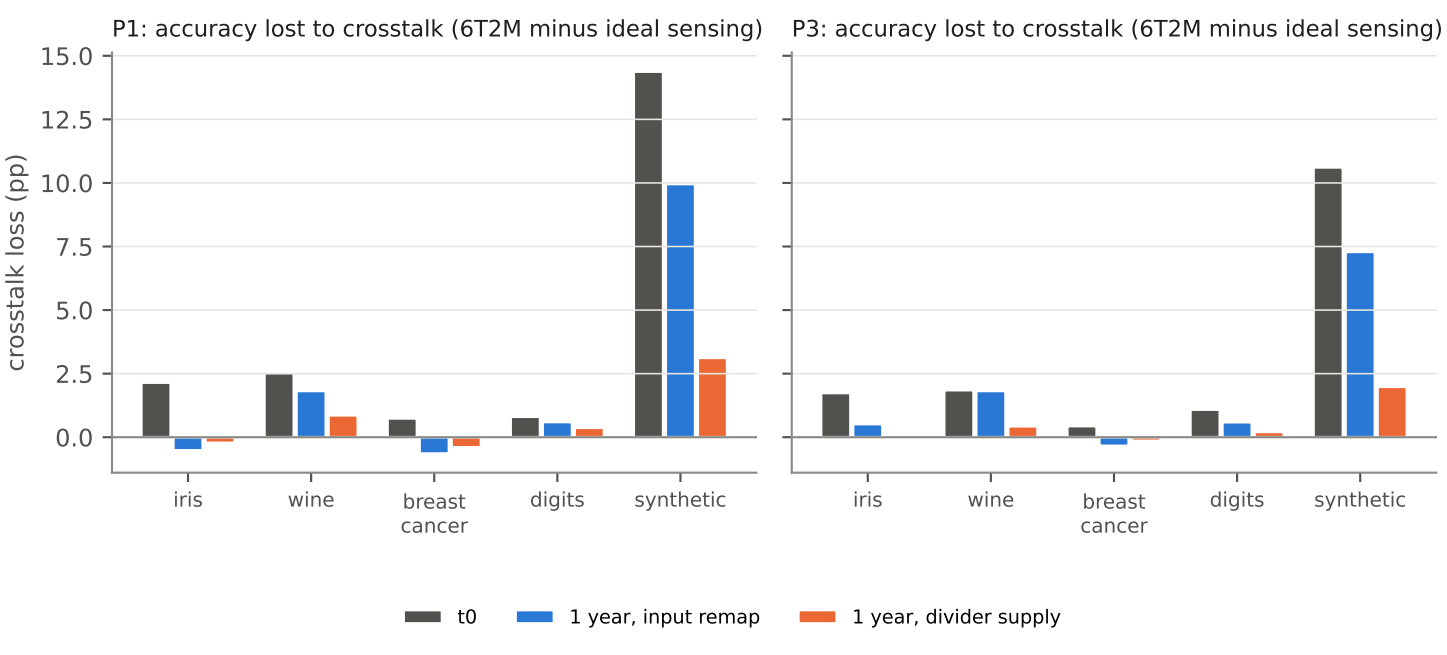
P1: accuracy lost to crosstalk (6T2M minus ideal sensing)
P3: accuracy lost to crosstalk (6T2M minus ideal sensing)
crosstalk loss (pp)
15.0
12.5
10.0
7.5
5.0
2.5
0.0
iris
wine
breast cancer
digits
synthetic
t0
1 year, input remap
1 year, divider supply