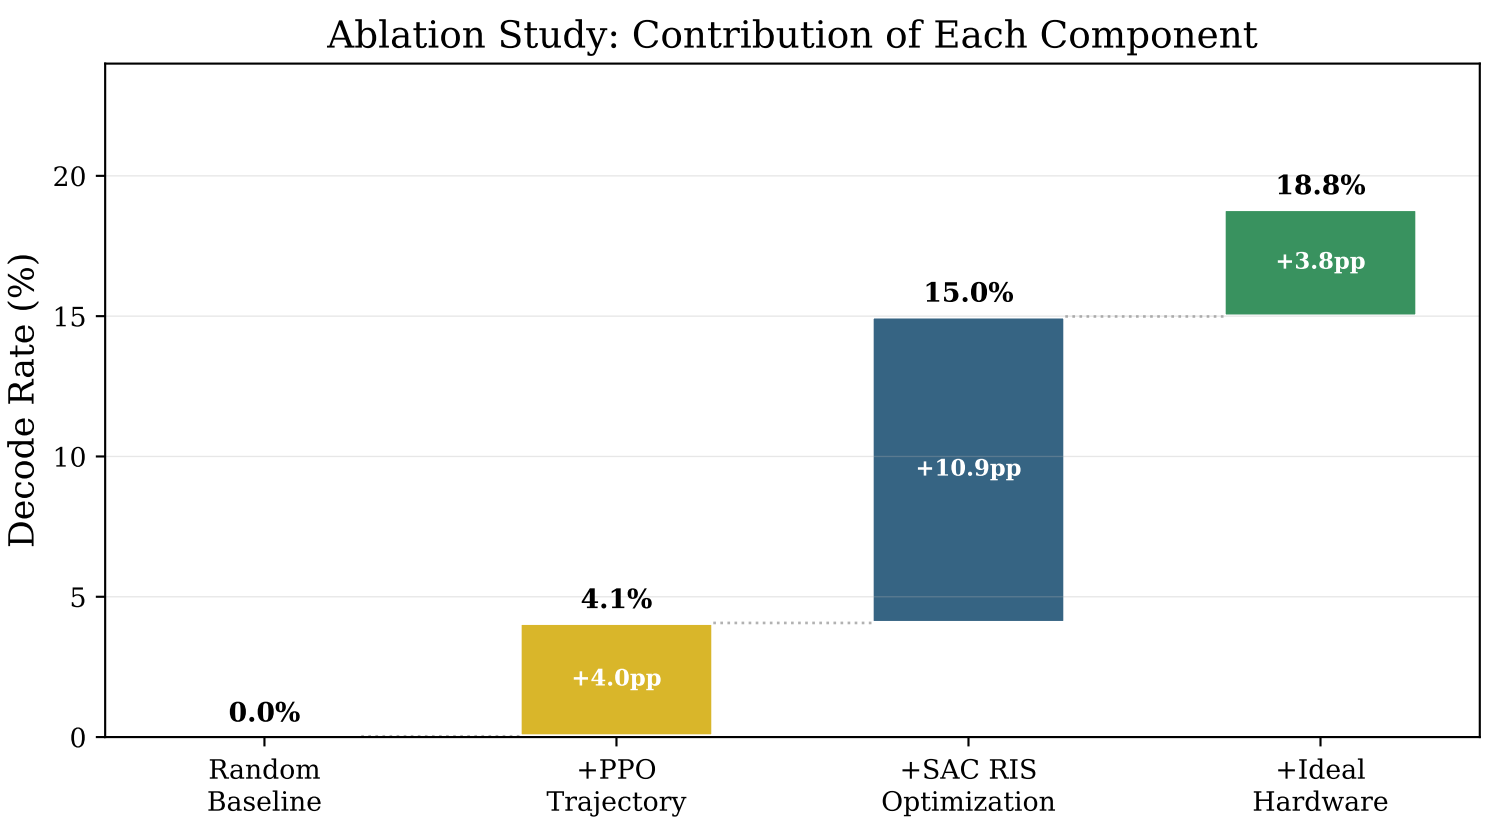
Ablation Study: Contribution of Each Component
Decode Rate (%)
0
5
10
15
20
0.0%
4.1%
+4.0pp
15.0%
+10.9pp
18.8%
+3.8pp
Random Baseline
+PPO Trajectory
+SAC RIS Optimization
+Ideal Hardware