

Flowshua Field Knowledge Playbook

Purpose

An illustrative portfolio prototype for trade-service companies to capture recurring field discrepancies, preserve senior technician knowledge, and turn completed service calls into structured learning material for newer employees.

How to use this workbook

1	Log completed or recurring service issues in the Discrepancy Log.
2	Use the Playbook to organize likely causes, verification checkpoints, escalation points, and coaching focus.
3	Review the Dashboard monthly to identify repeat issues, common categories, and training priorities.
4	Replace the illustrative examples with the company's real work-order history and senior technician input.

Important boundaries

This workbook supports operational learning and knowledge capture. It uses illustrative examples and does not replace manufacturer guidance, applicable codes, licensing requirements, safety procedures, or qualified technical judgment. Use company-approved technical references and escalation paths.

Workbook map


Sheet	Use it for
Start Here	Purpose, workflow, and safe-use boundaries.
Discrepancy Log	Capturing service outcomes, recurring issues, review status, and lessons learned.
Playbook	Turning common complaints into structured, company-specific troubleshooting and coaching pathways.
Dashboard	Monitoring training priorities, recurring issue categories, escalation volume, and review readiness.
Lists	Dropdown values and editable category lists used throughout the workbook.

Flowshua Field Knowledge Playbook | Dashboard


Illustrative dashboard using the sample Discrepancy Log. Replace the examples with real company data to identify training priorities.

Cases Logged	High Repeat-Call Cases	Escalations Needed	Training Ready Cases
30	12	13	17

Recurring issue categories		Knowledge readiness	
Service Category	Cases Logged	Knowledge Status	Cases
Cooling	6	Draft	6
Heating	4	Needs Review	7
Airflow	4	Training Ready	17
Controls	4	Archived	0
Electrical	3		
Condensate	3		
Noise / Vibration	3		
Maintenance	3		

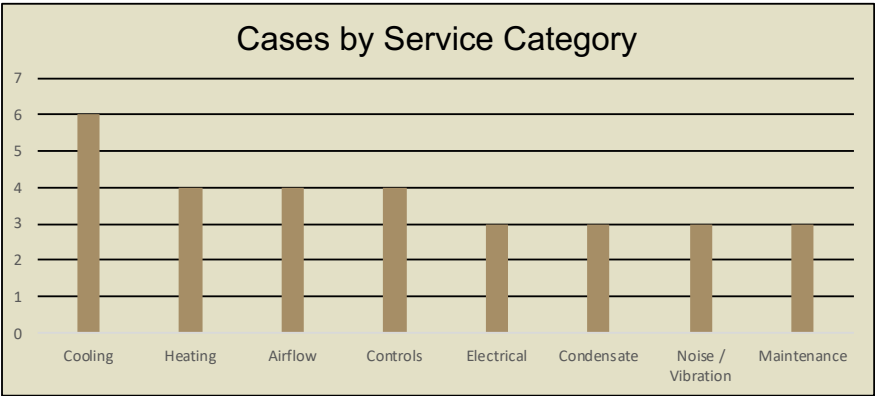

High-risk calls by category		What to review next
Service Category	High-Risk Cases	
Cooling	4	1. Review high-risk cases still marked Draft or Needs Review.
Heating	3	2. Ask senior technicians which complaints create the most repeat calls.
		3. Turn approved cases into new or improved Playbook entries.

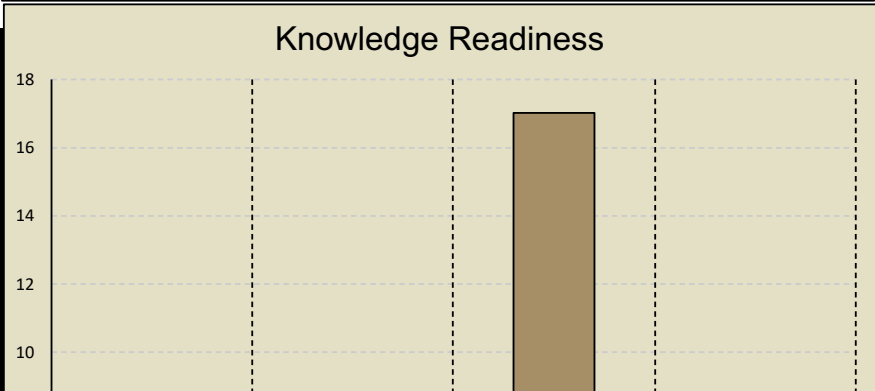

Flowshua Field Knowledge Playbook | Common Discrepancy Pathways

Use this sheet to capture company-approved experience. Cause rank should reflect local history and be reviewed as new work orders are added.

Scenario ID	Customer-Reported Issue	Service Category	Cause Rank	Potential Cause / Pattern	First Verification Checkpoint	Escalate When	Evidence to Capture	Coaching Focus
PB-01	System runs but home is not cooling	Cooling	1	Power or basic availability issue	Confirm the complaint, equipment status, and approved power / control availability checks.	Required safety check fails or the issue is beyond the technician's authorization.	Customer report, equipment type, visible status, approved test results.	Start with the simplest confirmed facts before assuming a major failure.
PB-01	System runs but home is not cooling	Cooling	2	Control or communication interruption	Confirm the call for cooling and note whether indoor and outdoor equipment respond as expected.	Observed behavior is inconsistent or requires deeper electrical / controls evaluation.	Sequence of operation, timing, thermostat setting, fault messages.	Teach technicians to describe what happened in order.
PB-01	System runs but home is not cooling	Cooling	3	Performance issue needing senior review	Capture company-approved observations and compare to the expected operating condition.	Measurements or conditions indicate qualified review is needed.	Approved readings, ambient conditions, photos, prior repair history.	Documentation quality makes escalation faster and cleaner.
PB-02	System is blowing cool air in heat mode	Heating	1	Thermostat mode or scheduling issue	Confirm mode, setpoint, schedule, and customer expectation.	Settings are correct but operation remains abnormal.	Thermostat view, setpoint, schedule, time of complaint.	Rule out user-setting issues without dismissing the customer.
PB-02	System is blowing cool air in heat mode	Heating	2	Control sequence issue	Record which components respond and in what order.	Sequence does not match approved operation or safety concern exists.	Observed sequence, equipment type, fault display if present.	Use exact, objective wording.
PB-03	Some rooms have weak airflow	Airflow	1	Filter or accessible airflow restriction	Check company-approved accessible airflow points and maintenance history.	Airflow concern remains after common restrictions are ruled out.	Filter condition, room locations, vent observations.	Compare room-specific and whole-home symptoms.
PB-03	Some rooms have weak airflow	Airflow	2	Distribution or balance issue	Identify whether the concern is isolated to one space or repeated across the home.	Configuration or concealed system work may be involved.	Room map, affected vents, customer timeline.	Train technicians to localize the problem.
PB-04	Water near indoor equipment	Condensate	1	Drain management condition	Confirm visible water path and safe condition; follow approved company procedure.	Water source is unclear, damage is extensive, or electrical / safety issue is present.	Photos, location, active drip status, prior notes.	Never close a water-related call without documenting the observed condition.
PB-04	Water near indoor equipment	Condensate	2	Intermittent or historic condition	Determine whether water is active now or only evidence remains.	Root cause cannot be verified with available observations.	Stain history, customer timing, weather / run-time context.	Good notes preserve the handoff when the condition is not active.
PB-05	Thermostat is blank or unresponsive	Controls	1	Power or user-interface availability issue	Document the display condition and approved basic checks.	Control or low-voltage evaluation is needed beyond technician authorization.	Display condition, equipment response, recent outage information.	Capture the condition before resetting anything.
PB-05	Thermostat is blank or unresponsive	Controls	2	Communication / control issue	Record what is connected, what responds, and any intermittent behavior.	Issue is intermittent, code-specific, or requires qualified control work.	Timing, error messages, wiring / equipment context per policy.	Intermittent complaints need time stamps and repeatable facts.
PB-06	Breaker trips or system will not power on	Electrical	1	Electrical condition requiring qualified evaluation	Follow company safety and escalation policy immediately.	Any safety concern, recurring trip, or unclear power condition exists.	Customer report, timing, equipment state; do not bypass safety procedures.	Safety and clean escalation come before speed.
PB-07	Loud or unusual noise	Noise / Vibration	1	External vibration or access-panel condition	Identify timing, location, and whether sound is continuous or intermittent.	Noise suggests internal equipment concern or cannot be safely identified.	Audio / video if approved, location, operating sequence.	A precise sound description is more useful than "it sounds bad."
PB-07	Loud or unusual noise	Noise / Vibration	2	Operational sequence or equipment concern	Compare the noise to the timing of normal operation without making unsupported assumptions.	Qualified review is needed to determine source.	When it happens, duration, what starts / stops with it.	Teach the difference between observation and diagnosis.
PB-08	System runs for a long time without comfort	Cooling	1	Load or performance concern	Document comfort impact, weather context, duration, and customer setpoint.	Company-approved observations point to a deeper performance review.	Outdoor conditions, run time, indoor comfort report, prior service history.	Turn a broad complaint into measurable, repeatable facts.
PB-09	Customer asks for seasonal maintenance	Maintenance	1	Routine inspection and customer education	Use the company-approved maintenance checklist and record observations.	A condition falls outside routine maintenance scope.	Checklist result, filter condition, recommendations made.	Routine work builds documentation habits and customer trust.
PB-10	One bedroom is much warmer or cooler	Airflow	1	Room-specific distribution or usage condition	Map the affected room, time of day, occupancy, and nearby vents / returns.	The concern may involve concealed work or a wider system issue.	Affected room, adjacent rooms, window exposure, observed airflow.	Teach technicians to separate one-room and system-wide patterns.