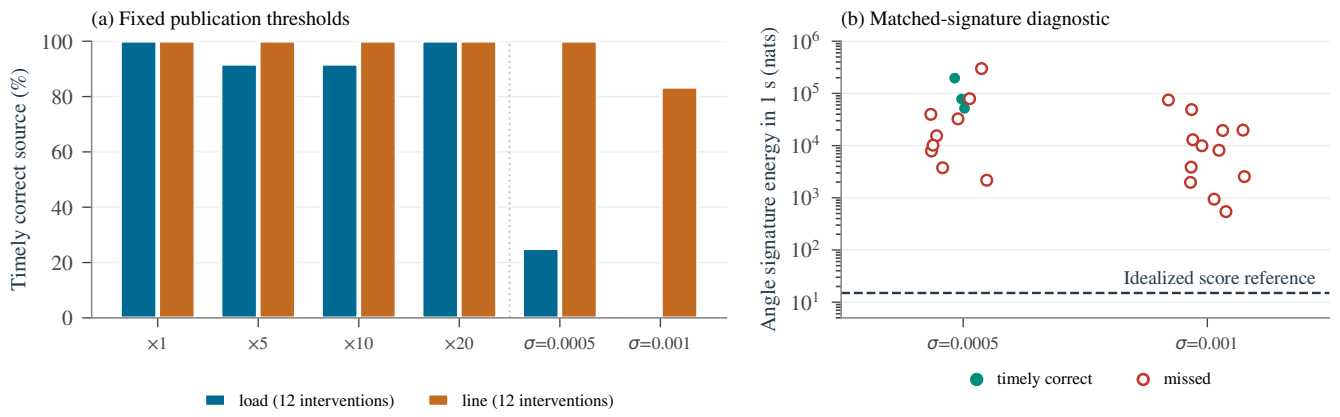
(a) Fixed publication thresholds
Timely correct source (%)
100
80
60
40
20
0
×1
×5
×10
×20
σ=0.0005
σ=0.001
load (12 interventions)
line (12 interventions)
(b) Matched-signature diagnostic
Angle signature energy in 1 s (nats)
10^6
10^5
10^4
10^3
10^2
10^1
Idealized score reference
σ=0.0005
σ=0.001
timely correct
missed