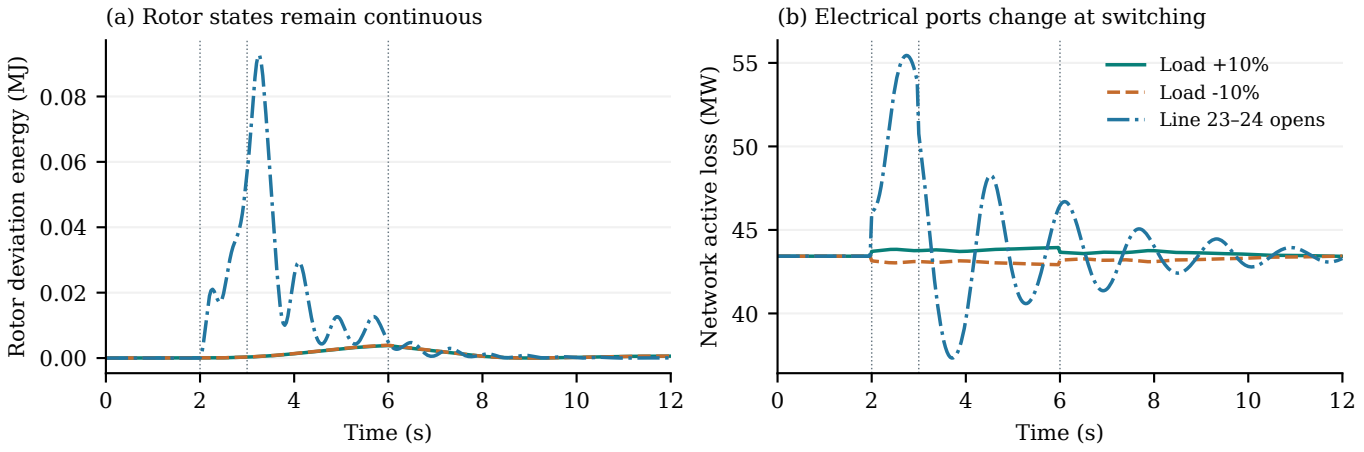
(a) Rotor states remain continuous
Rotor deviation energy (MJ)
0.00
0.02
0.04
0.06
0.08
0
2
4
6
8
10
12
Time (s)
(b) Electrical ports change at switching
Network active loss (MW)
40
45
50
55
Load +10%
Load -10%
Line 23–24 opens
0
2
4
6
8
10
12
Time (s)