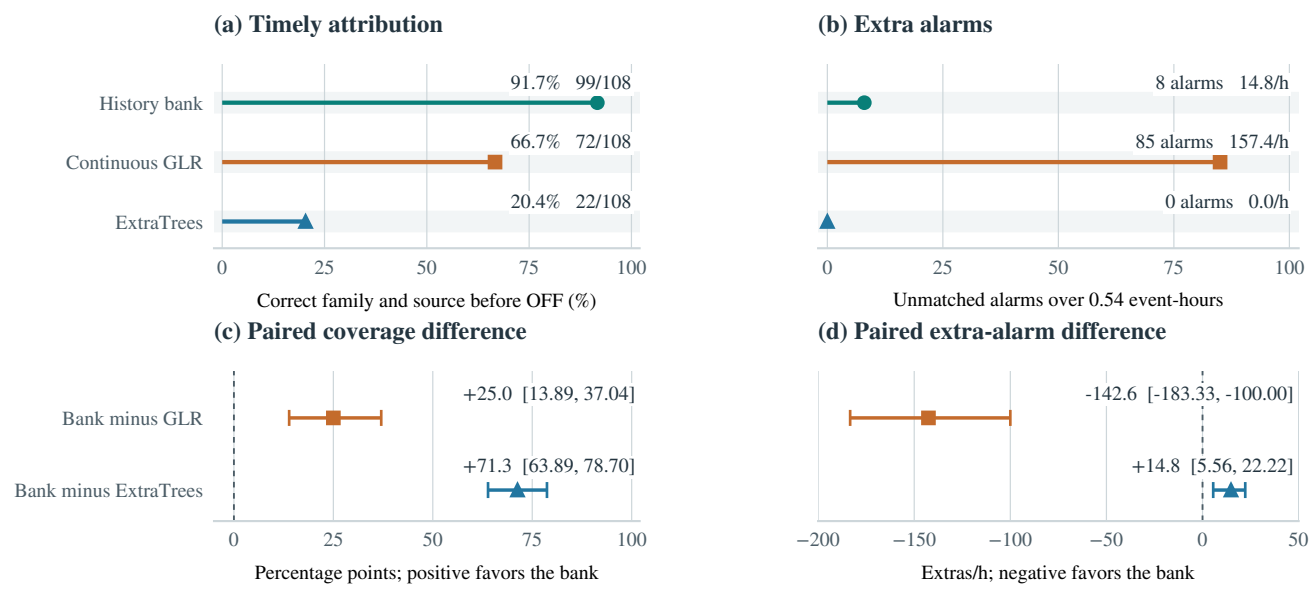

Normal records: 0 alarms in 3.92 h per method; one-sided 95% Poisson upper bound 0.76/h.

Paired 95% intervals: 10,000 resamples of 18 event parents. Each method meets the calibration alarm budget.