


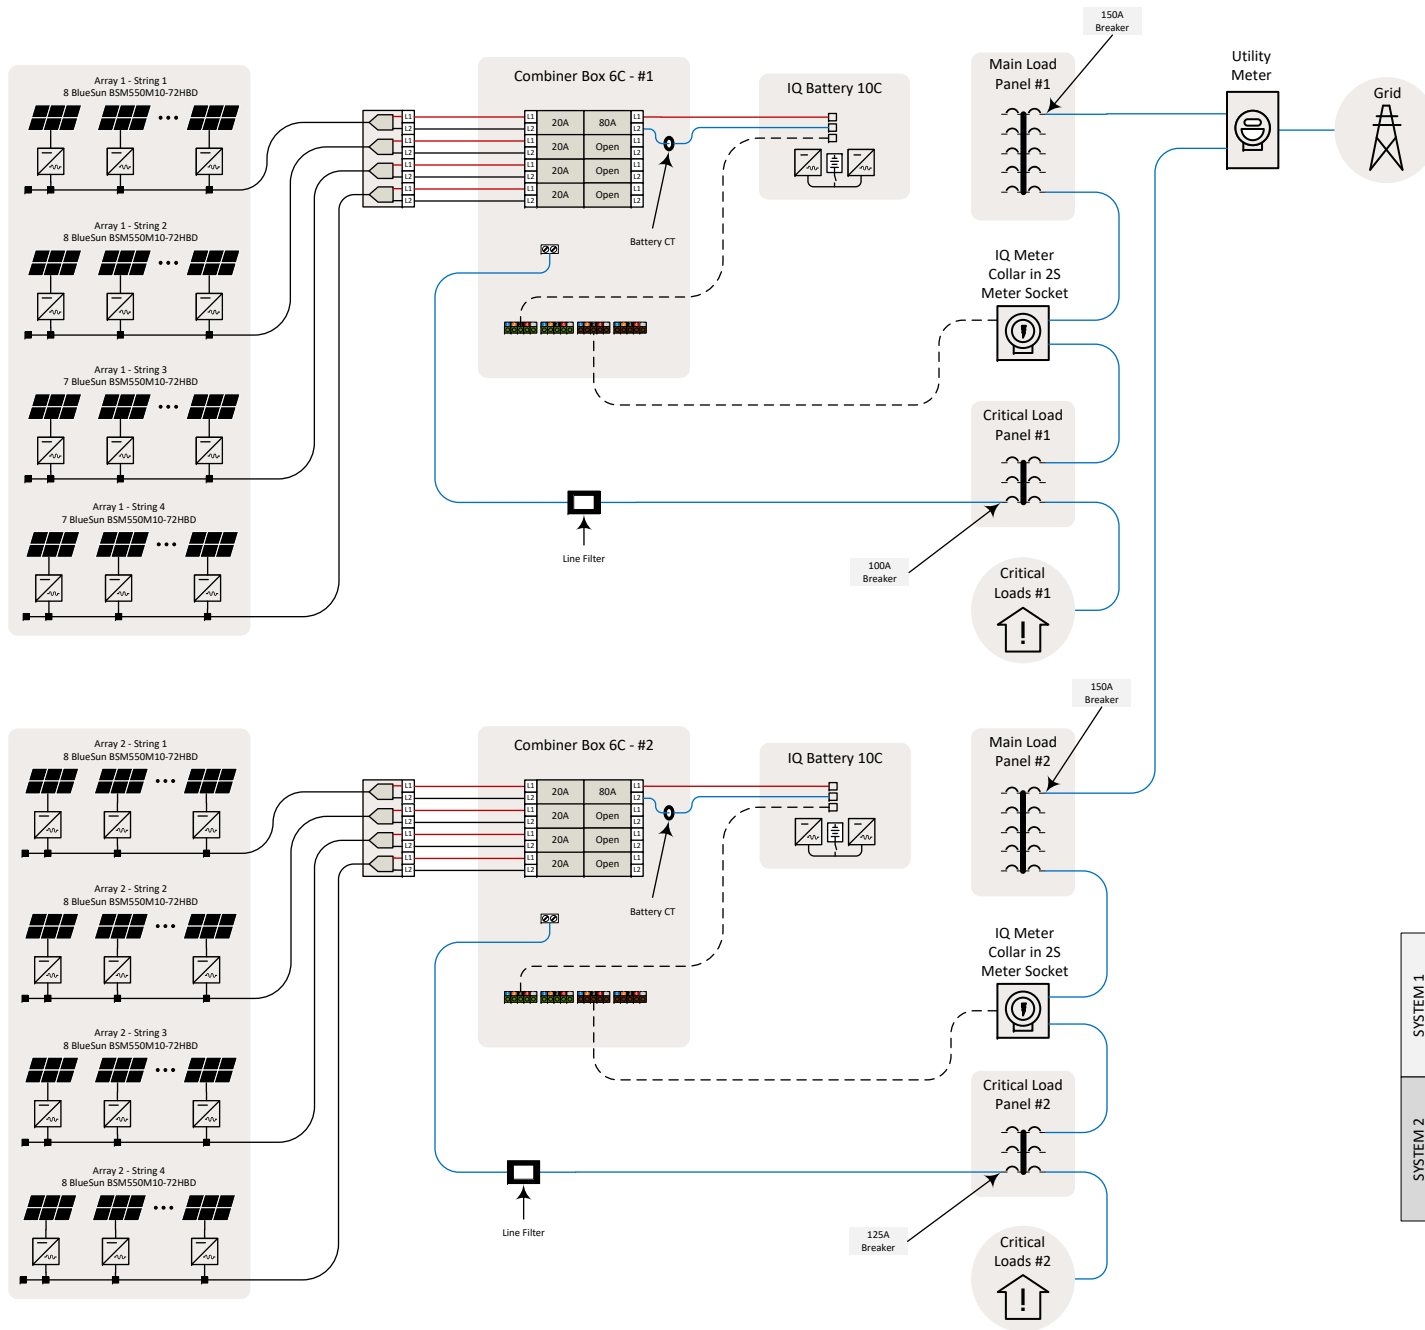

LRA OF LARGEST LOAD IN BACKED UP LOAD
PANEL CANNOT EXCEED THE (BATTERY) STORAGE
OUTPUT CAPACITY (64A) FOR 3 SECONDS AND
(51.2A) FOR 10 SECONDS PER NEC 710.15

SINGLE LARGEST BREAKER IN BACKED UP LOAD
PANEL CANNOT EXCEED THE (BATTERY) STORAGE
OUTPUT CAPACITY (40A) PER NEC 710.15

JEFFREY LOTTERER
62 MONSON RD
WILBRAHAM, MA 01095

DATE: 08/11/2025

Signature with Seal

REVISIONS

Initial draft	08/10/25	v1
Realigned objects	08/11/25	v2

PROJECT NAME & ADDRESS

JEFFREY LOTTERER
RESIDENCE
26 MONSON RD
WILBRAHAM, MA 01095
Email: jlotterer@hotmail.com

SYSTEM INFORMATION

SYSTEM 1	PANELS:	30 – BlueSun Solar BSM550M10-72HBD (550W)
	INVERTERS:	30 – Enphase IQ8HC (240V / 1.6A ea)
	DC SYSTEM SIZE:	16.50 KWDC
	AC SYSTEM SIZE:	9.0 KWAC
SYSTEM 2	PANELS:	32 – BlueSun Solar BSM550M10-72HBD (550W)
	INVERTERS:	32 – Enphase IQ8HC (240V / 1.6A ea)
	DC SYSTEM SIZE:	17.60 KWDC
	AC SYSTEM SIZE:	9.60 KWAC

SERVICE INFORMATION

AHJ NAME:	HAMPDEN COUNTY
UTILITY PROVIDER:	NATIONAL GRID
MAIN SERVICE VOLTAGE	240V (400A)
MAIN SERVICE PANEL #1 RATING:	225A
MAIN BREAKER #1 RATING:	150A
MAIN SERVICE PANEL #2 RATING:	225A
MAIN BREAKER #2 RATING:	150A
MAIN SERVICE LOCATION:	NORTH-EAST
SERVICE FEED SOURCE:	UNDERGROUND