

JEFFREY LOTTERER
62 MONSON RD
WILBRAHAM, MA 01095


DATE: 08/10/2025

Signature with Seal

REVISIONS		
Initial draft	08/10/25	v1

PROJECT NAME & ADDRESS

JEFFREY LOTTERER
RESIDENCE
26 MONSON RD
WILBRAHAM, MA 01095
Email: jlotterer@hotmail.com

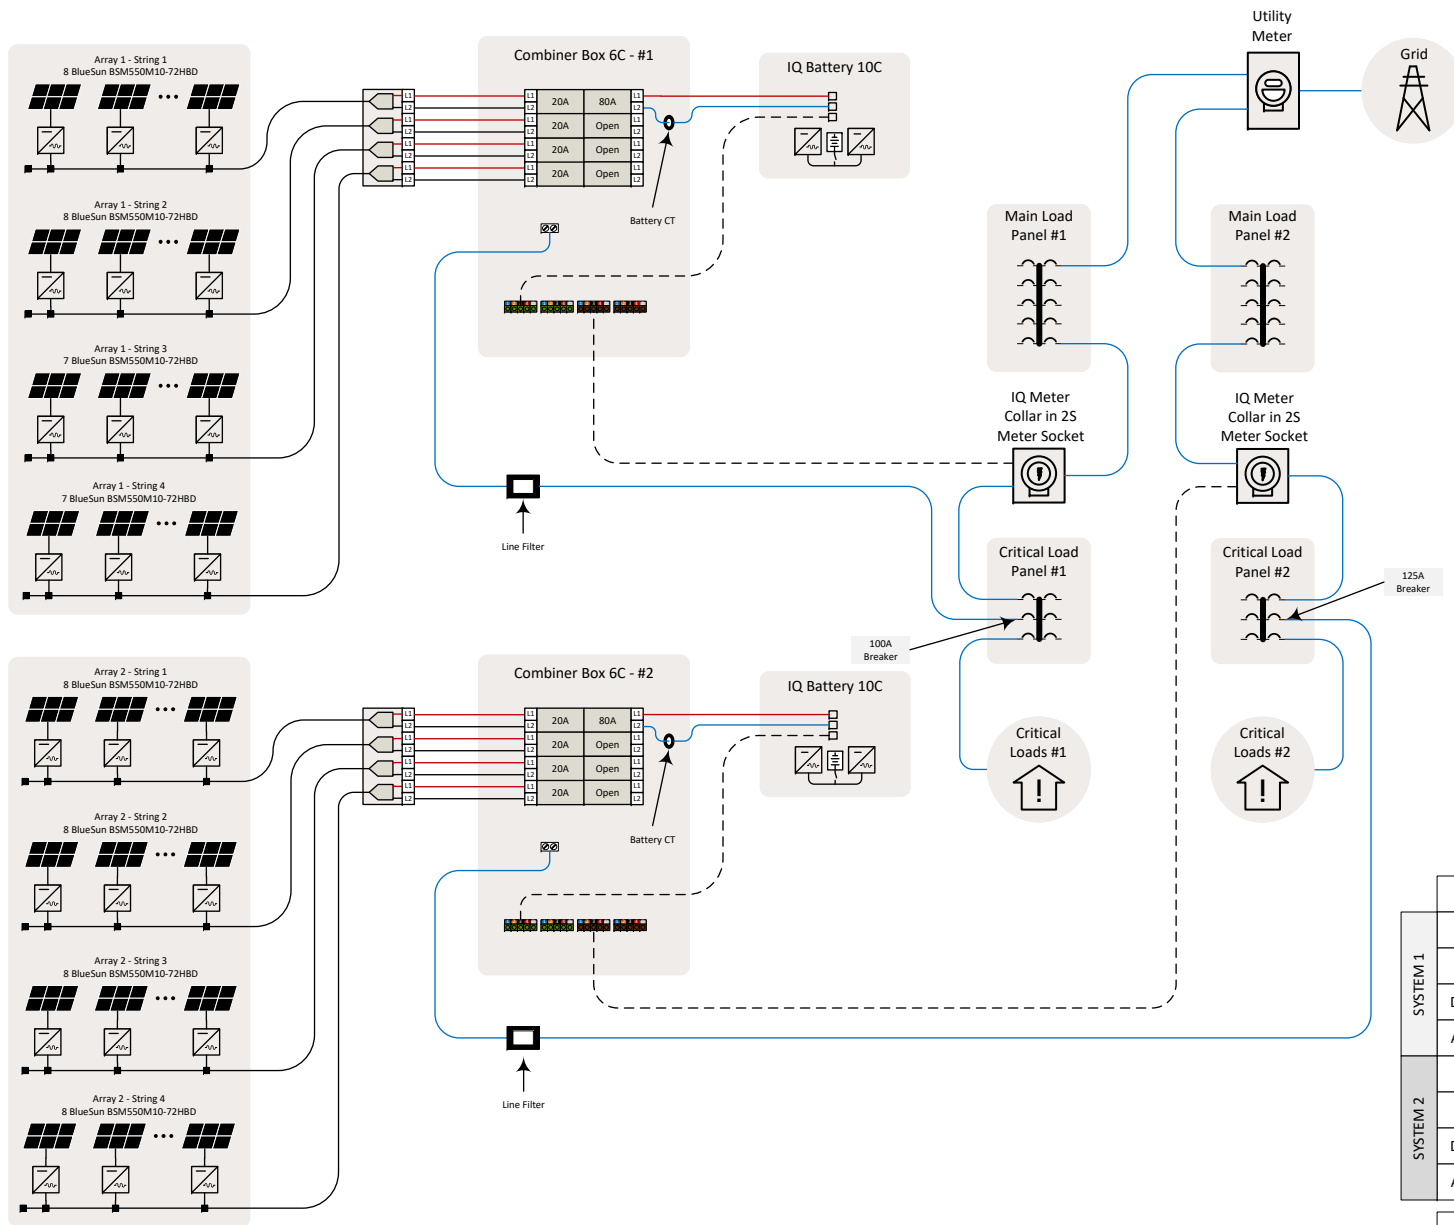

LRA OF LARGEST LOAD IN BACKED UP LOAD
PANEL CANNOT EXCEED THE (BATTERY) STORAGE
OUTPUT CAPACITY (64A) FOR 3 SECONDS AND
(51.2A) FOR 10 SECONDS PER NEC 710.15

SINGLE LARGEST BREAKER IN BACKED UP LOAD
PANEL CANNOT EXCEED THE (BATTERY) STORAGE
OUTPUT CAPACITY (40A) PER NEC 710.15

SYSTEM INFORMATION	
SYSTEM 1	PANELS: 30 – BlueSun Solar BSM550M10-72HBD (550W)
	INVERTERS: 30 – Enphase IQ8HC (240V / 1.6A ea)
	DC SYSTEM SIZE: 16.50 KWDC
SYSTEM 2	AC SYSTEM SIZE: 9.0 KWAC
	PANELS: 32 – BlueSun Solar BSM550M10-72HBD (550W)
	INVERTERS: 32 – Enphase IQ8HC (240V / 1.6A ea)
	DC SYSTEM SIZE: 17.60 KWDC
	AC SYSTEM SIZE: 9.60 KWAC

SERVICE INFORMATION	
AHJ NAME:	HAMPDEN COUNTY
UTILITY PROVIDER:	NATIONAL GRID
MAIN SERVICE VOLTAGE	240V (400A)
MAIN SERVICE PANEL #1 RATING:	225A
MAIN BREAKER #1 RATING:	150A
MAIN SERVICE PANEL #2 RATING:	225A
MAIN BREAKER #2 RATING:	150A
MAIN SERVICE LOCATION:	NORTH-EAST
SERVICE FEED SOURCE:	UNDERGROUND