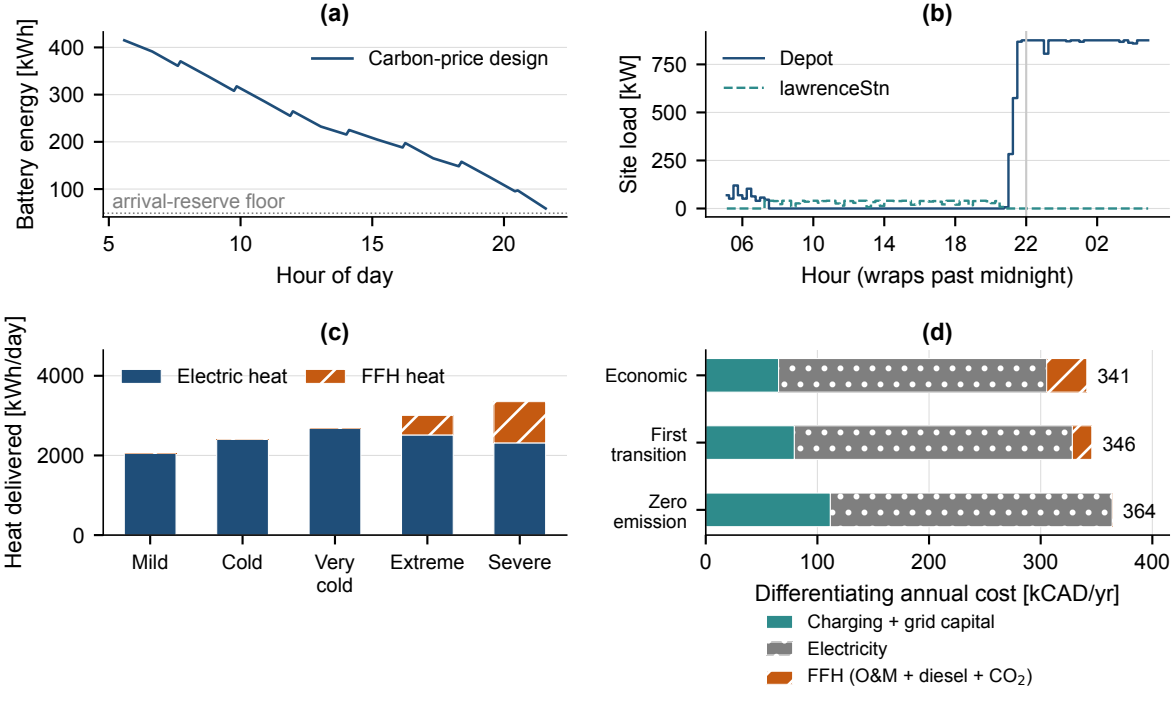
(a)
Battery energy [kWh]
400
300
200
100
Carbon-price design
arrival-reserve floor
5
10
15
20
Hour of day
(b)
Site load [kW]
750
500
250
0
Depot
lawrenceStn
06
10
14
18
22
02
Hour (wraps past midnight)
(c)
Heat delivered [kWh/day]
4000
2000
0
Electric heat
FFH heat
Mild
Cold
Very cold
Extreme
Severe
(d)
Economic
First transition
Zero emission
341
346
364
0
100
200
300
400
Differentiating annual cost [kCAD/yr]
Charging + grid capital
Electricity
FFH (O&M + diesel + CO_2)