

C&I Rate-Fit One-Pager: GS / GSD / GSLD / HLFT / SDTR (Synthetic FL Utility)


1.0M commercial & industrial accounts (20K-account oversampled sample, weighted) | FPL 2026 tariff | projected next 12 months

202KC&I on the wrong rate
20.2% of 1.0M**798K**

C&I on the right rate

41Kon TOU but shouldn't be
\$16.9M/yr**39K**should be on TOU
\$48.0M/yr**97K**should add SDTR
\$209.8M/yr**\$333.5M**C&I annual savings
2.7% of \$12.25B

C&I savings opportunity by segment

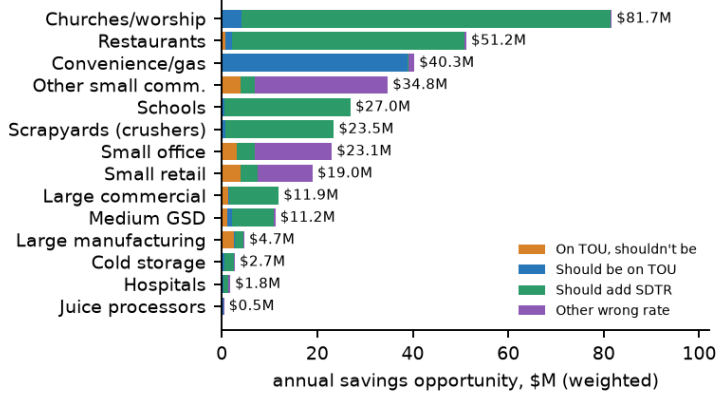


Top rate migrations (weighted)

Current → optimal	Cust.	\$/yr	\$/cust
GSD-1 → GSD-1 + SDTR-1 Opt B	63K	\$130.1M	\$2,071
GSD-1 → GS-1	18K	\$53.3M	\$2,957
GS-1 → GSDT-1	11K	\$31.1M	\$2,791
GSLD-1 → GSLD-1 + SDTR-2 Opt B	1,023	\$18.7M	\$18,291
GSLD-2 → GSLD-2 + SDTR-3 Opt B	124	\$11.3M	\$91,230
GSD-1 → GSD-1 + SDTR-1 Opt A	17K	\$10.0M	\$578
GST-1 → GS-1	34K	\$8.8M	\$259
GSDT-1 → GSD-1 + SDTR-1 Opt B	7,709	\$8.6M	\$1,111
GSD-1 → GSDT-1	8,885	\$6.8M	\$770
GSLD-1 → GSLD-1 + SDTR-2 Opt B	366	\$6.8M	\$18,696


July hourly shape (normalised)

tan = TOU on-peak 12-9 PM, green = SDTR 3-6 PM

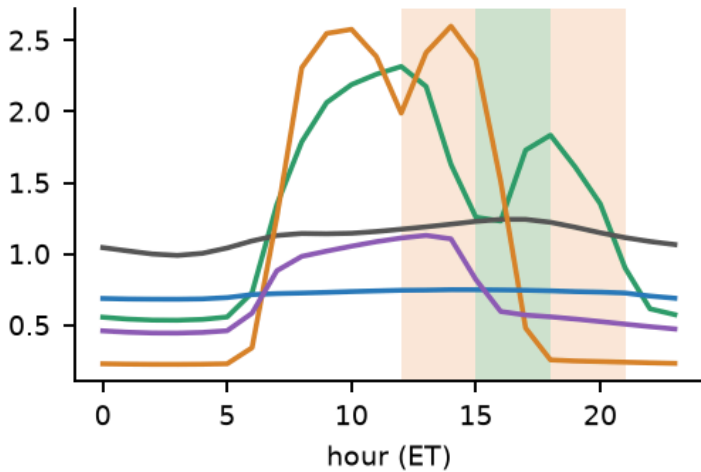

Monthly energy (normalised)

juice harvest Dec-May; schools dip Jun-Jul

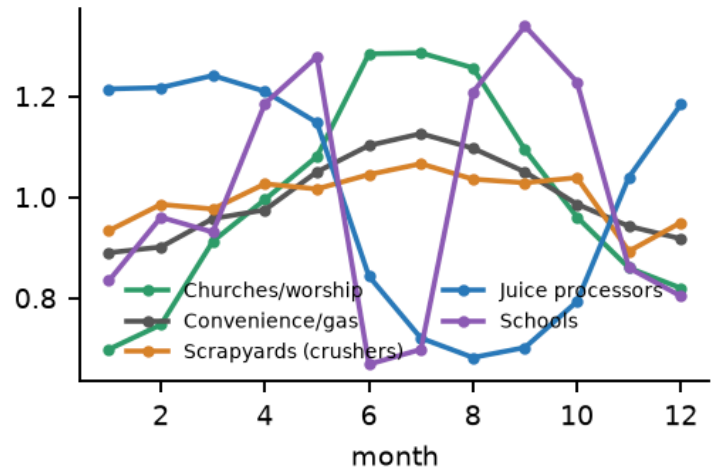

Segment load characteristics (medians)

Segment	Accts	Peak kW	LF	% wrong	Bill/yr
Juice processors	60	4,960	0.60	15%	\$2.2M
Hospitals	300	2,595	0.56	13%	\$1.2M
Large manufacturing	2,000	1,158	0.48	14%	\$529,574
Cold storage	400	1,022	0.62	47%	\$526,808
Large commercial	3,500	742	0.38	24%	\$289,926
Scrapyards (crushers)	1,500	373	0.10	66%	\$84,626
Schools	7,000	238	0.21	71%	\$62,557
Medium GSD	60K	70	0.49	14%	\$30,746
Churches/worship	40K	38	0.10	87%	\$8,524
Restaurants	70K	36	0.34	60%	\$13,069
Convenience/gas	35K	28	0.65	77%	\$16,810
Small retail	230K	13	0.38	12%	\$5,861
Small office	220K	11	0.29	11%	\$3,910
Other small comm.	330K	9	0.30	10%	\$3,322

Highlights

- Scrapyards:** crusher and shredder spikes give a load factor of about 0.10. Because demand dominates the bill, 66% are on a wrong rate; GSDT/SDTR bill only on-peak or 3-6 PM demand, and moving crushing to before noon adds more.
- Juice processors (Tropicana-style):** run 24x7 at a load factor of about 0.60, with the citrus harvest peak Dec-May and a low Jun-Sep season. HLFT and SDTR are the levers, and 15% are mis-rated.
- Medium GSD and large commercial:** AC-driven afternoon peaks mean most are right on GSD-1/GSLD-1. The exceptions are sites with low 3-6 PM demand, where SDTR Option B wins.

Synthetic 100,000-customer stratified sample (80K residential / 20K C&I, C&I oversampled) weighted to a 6.0M-customer design population (5.0M residential, 1.0M C&I). 15-min interval history = calendar 2025 (synthetic weather); next 12 months projected with weather normalisation and segment trend; bills priced on FPL Section 8 sheets effective 2026-01-01 (base, demand, energy, fuel, conservation, capacity, environmental, storm protection, transition rider, 2.6% GRT/RAF; franchise fees and taxes excluded). Savings = rate switch only, no behaviour change; materiality = max(\$25, 2% of annual bill). Generated 2026-09-28.