


Speech intelligibility index

ANSI S3.5-1997 speech intelligibility index. Rating per ANSI S3.5-1997 (one-third-octave-band method).

Listening condition: Conversational speech in low-frequency ambient noise

One-third-octave band audibility

f [Hz]	E' _i [dB]	I _i	A _i
160	32.4	0.0083	0.00
200	34.5	0.0095	0.05
250	34.8	0.0150	0.09
315	34.0	0.0289	0.12
400	34.6	0.0440	0.21
500	34.3	0.0578	0.26
630	32.1	0.0653	0.26
800	28.3	0.0711	0.21
1000	25.0	0.0818	0.16
1250	23.0	0.0844	0.16
1600	20.1	0.0882	0.14
2000	17.3	0.0898	0.10
2500	13.2	0.0868	0.03
3150	11.6	0.0844	0.05
4000	9.3	0.0771	0.00
5000	5.3	0.0527	0.00
6300	2.6	0.0364	0.00
8000	1.1	0.0185	0.00

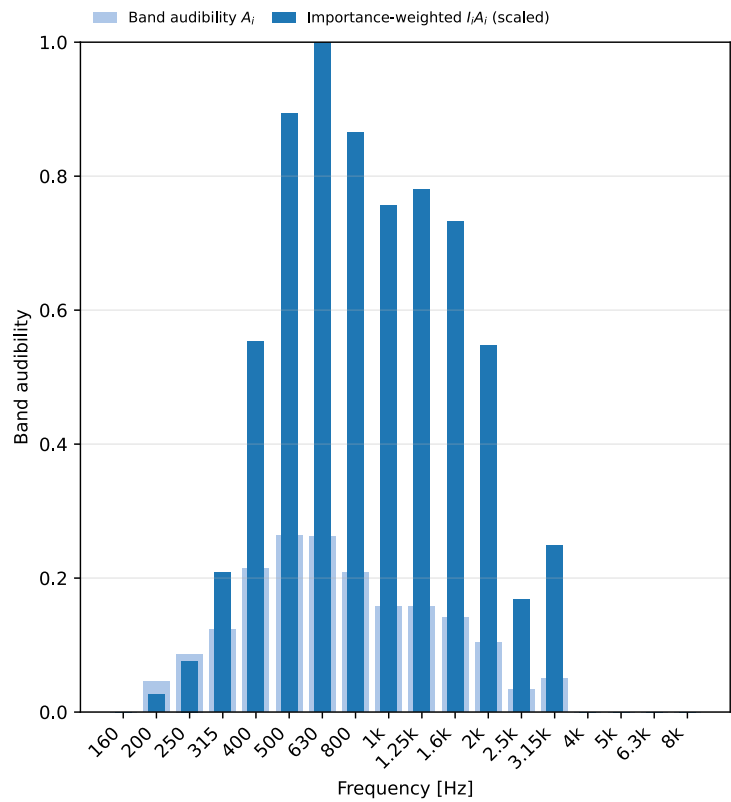

SII = 0.117

Result vs requirement: SII = 0.117, required $\geq 0.750 \rightarrow$ **FAIL**

Laboratory: Phonometry Reference Laboratory

Signature: _____

■ The results relate only to the tested specimen.

Generated by phonometry.