


# Speech transmission index

IEC 60268-16 speech transmission index. Rating per IEC 60268-16:2020 (full STI, indirect method).

System: Concourse voice-alarm loudspeaker line

Octave-band modulation transfer index  
MTI

| f [Hz] | MTI  |
|--------|------|
| 125    | 0.56 |
| 250    | 0.62 |
| 500    | 0.59 |
| 1000   | 0.61 |
| 2000   | 0.62 |
| 4000   | 0.61 |
| 8000   | 0.60 |

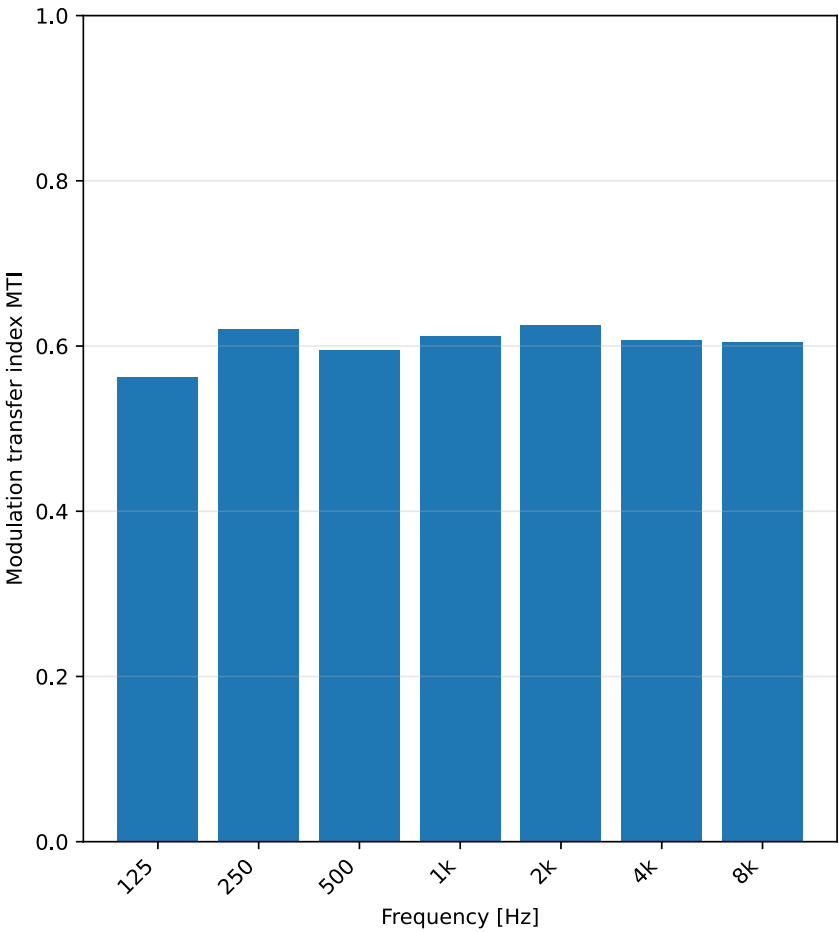

STI = 0.61

Qualification band (IEC 60268-16 Annex F): D  
Method: full STI, indirect method

Result vs requirement: STI = 0.61, required  $\geq 0.50$  → **PASS**

Laboratory: Phonometry Reference Laboratory  
Signature: \_\_\_\_\_

■ The results relate only to the tested specimen.  
Generated by phonometry.