


Room noise rating

ANSI/ASA S12.2 octave-band measurement of room noise. Noise Criteria (NC) rating by the tangency method (ANSI/ASA S12.2-2019).

Client:	Example client	Room:	Office A (example)
Description:	Open-plan office, air handling at nominal flow	Room volume V [m ³]:	180
Floor area S [m ²]:	60	Instrumentation:	Class 1 sound level meter + octave filter set (example)
Temperature [°C]:	22	Relative humidity [%]:	42
Ambient pressure [kPa]:	101.2	Date of test:	2026-07-21

Octave-band sound pressure levels

Frequency f [Hz]	L _p [dB]
16	79.0
31.5	69.0
63	59.0
125	51.0
250	50.0
500	39.0
1000	36.0
2000	34.0
4000	33.0
8000	32.0

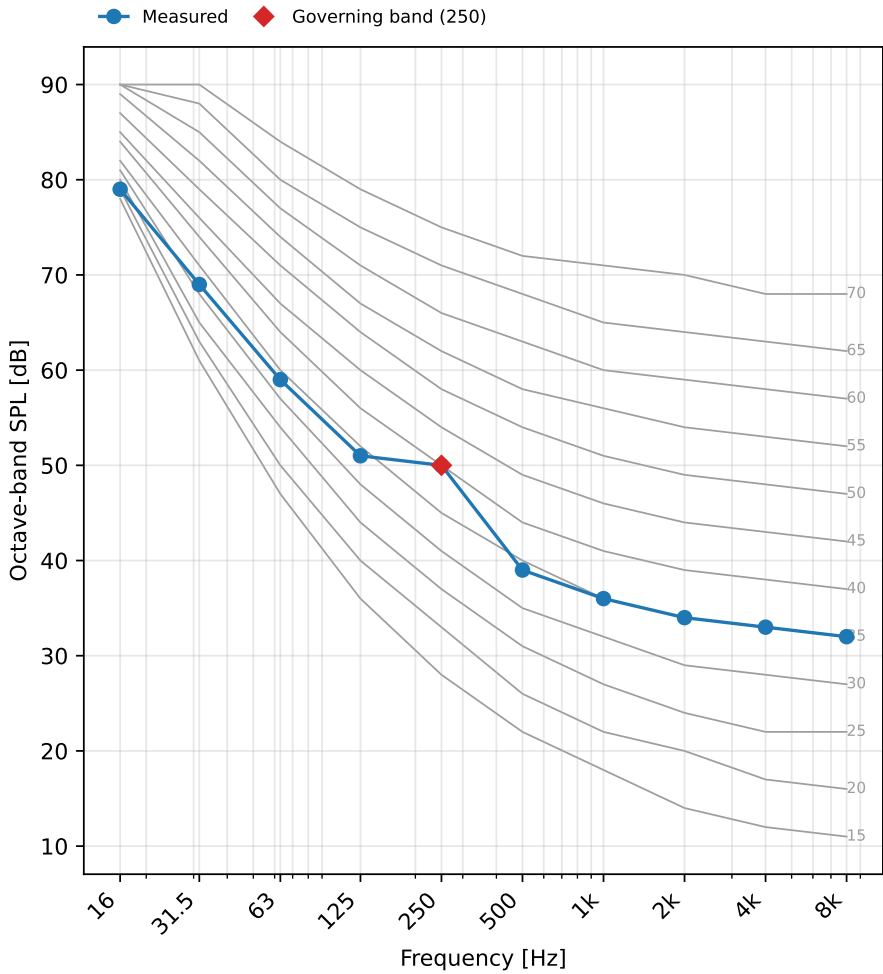

NC-40

Governing band: 250 Hz
Rated by the tangency method (ANSI/ASA S12.2-2019).

Result vs requirement: NC 40, required $\leq 40 \rightarrow$ **PASS**

Laboratory: Phonometry reference example

Report no.: EXAMPLE-S122-NC

Date: 2026-07-21

Operator: phonometry Signature: _____

■ The results relate only to the tested specimen.
Generated by phonometry.