


Sound absorption rating

ISO 354 laboratory measurement of sound absorption. Rating per ISO 11654:1997.

Client:	Example client	Manufacturer:	Example acoustics
Description:	50 mm porous absorber over a 100 mm air gap	Sample area S [m ²]:	10.8
Mounting:	Type A (mounted directly against a rigid wall)	Test room:	Reverberation room (example)
Date of test:	2026-07-20	Temperature [°C]:	21.4
Relative humidity [%]:	54	Ambient pressure [kPa]:	101

Octave-band α_p

Frequency f [Hz]	α_p
250	0.35
500	1.00
1000	0.65
2000	0.60
4000	0.55

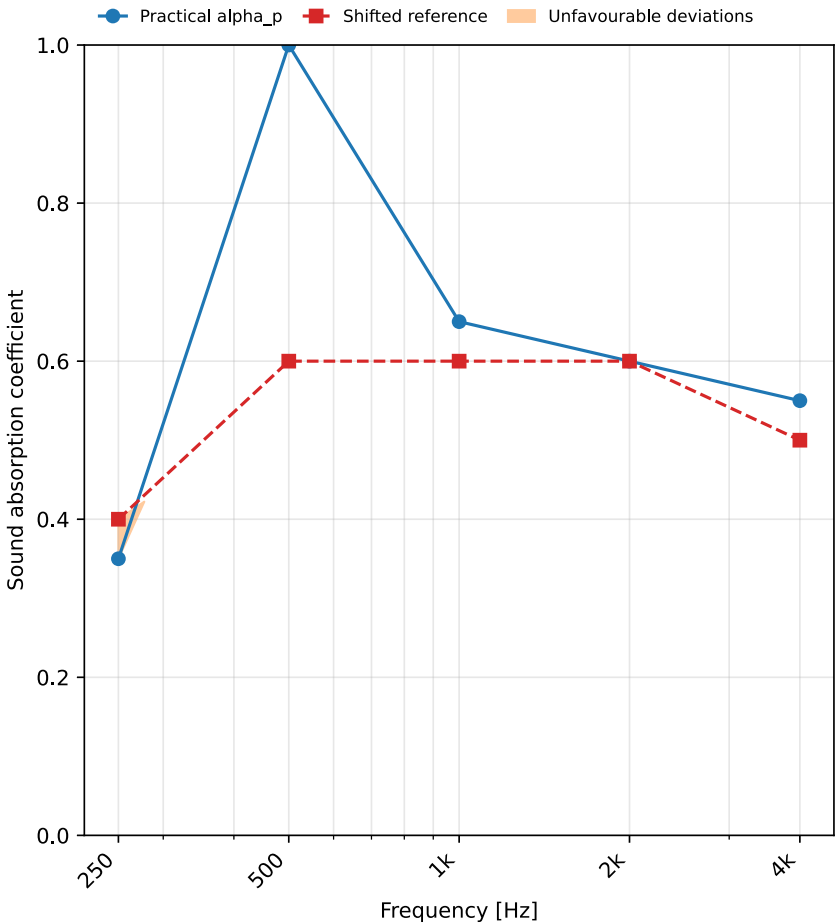

$\alpha_w = 0.60$ (M)

Absorption class: C
Shape indicator: M
Applied shift: 0.40

Result vs requirement: $\alpha_w = 0.60$, required $\geq 0.55 \rightarrow$ **PASS**

Laboratory: Phonometry reference example

Report no.: EXAMPLE-11654

Date: 2026-07-20

Operator: phonometry **Signature:** _____

■ The results relate only to the tested specimen.
Generated by phonometry.