


CO2—
LVAC—
LA
ADW
DHR
DHW
HWS
HWS

AS-L00-031 - ISOMETRIC
AS-L00-031SCALE:

AS-L00-031 AS-L00-031SCALE: 1/2" = 1'-0"


A1	A3	B1	В3
A2	A4	B2	B4

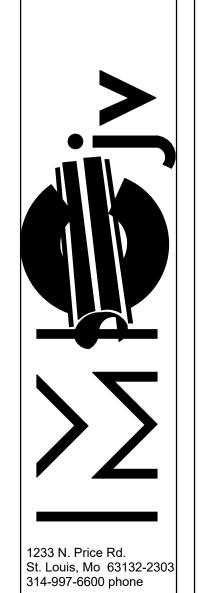

JOB: WASH U NRB

тіскет: AS-L00-031

DATE: 03/11/21

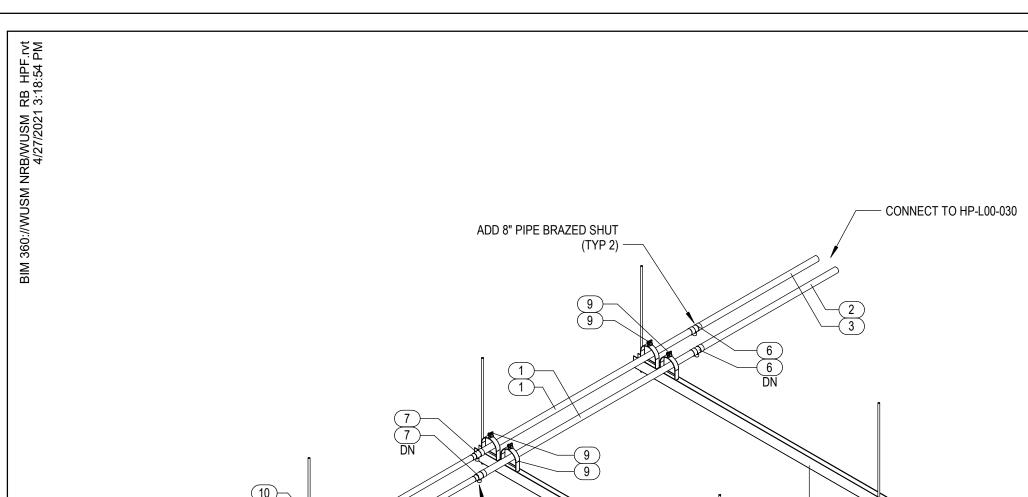


10 10 10	ADD 8" PIPE BRAZED SHUT (TYP 2)	11 (TYP 4)
HIP LOOSE		
NNECT TO HP-L00-032		
ISOMETRIC		






A1	A3	B1	B3
A2	A4	B2	B4

Mark	Qty	Size	Description	Length	Strut Width	Rod 1 Length	Rod 2 Length	
1	2	1 1/2"	Cerro Type K Hard Copper Pipe	6'-2"]
2	1	1 1/2"	Cerro Type K Hard Copper Pipe	3'-11 5/8"				
3	1	1 1/2"	Cerro Type K Hard Copper Pipe	3'-5 5/8"]
4	1	1 1/4"	Cerro Type K Hard Copper Pipe	10'-1 9/16"				
5	1	1 1/4"	Cerro Type K Hard Copper Pipe	9'-7 9/16"				1
6	2	1 1/2"x3/4"	Nibco Wrot 611R CxCxC Reducing Tee					1
7	2	1 1/2"x1 1/4"x3/4"	Nibco Wrot 611R CxCxC Reducing Tee					1
8	2	1 1/4"	Nibco Wrot 600 Dimpled Stop Coupling CxC					1
9	4	4.5"	B-Line B2000 ZN Sch 40 Pipe Clamp		0"	0"	0"	1
10	4	3"	B-Line B2000 ZN Sch 40 Pipe Clamp		0"	0"	0"	1
11	4	80"	B-Line 1-5/8 GLV 12GA Bk/Bk 2in Slotted Unistrut		7` - 2"	2` - 7 5/8"	2` - 7 5/8"	38
			6 3/16"	3/16"				JOB: WASH U NRB

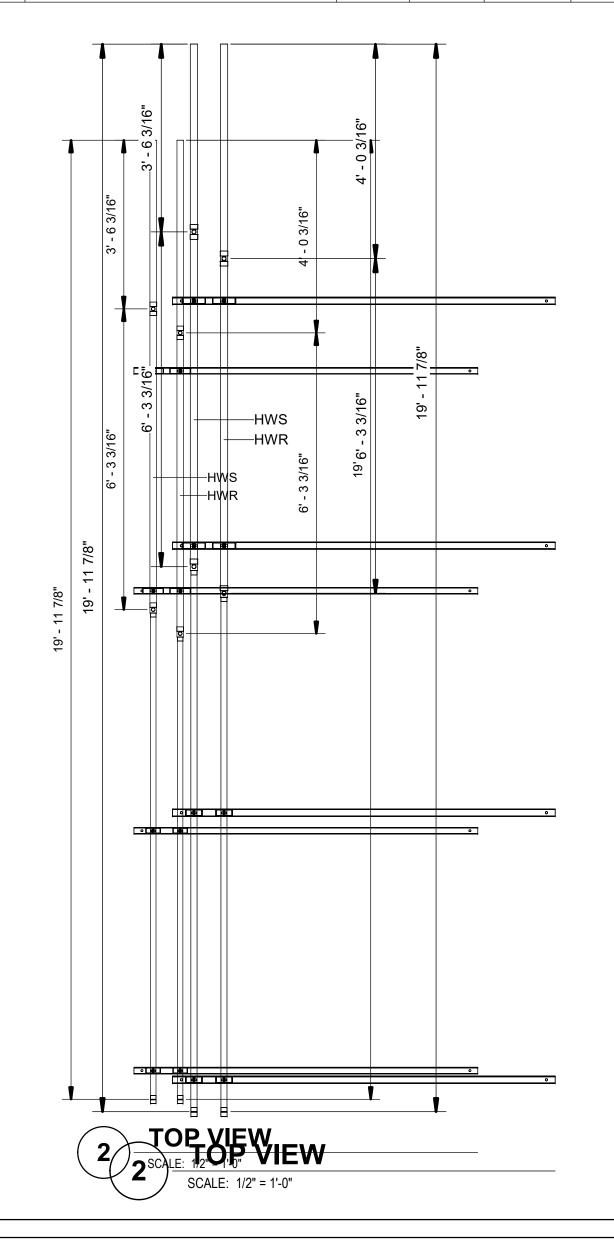

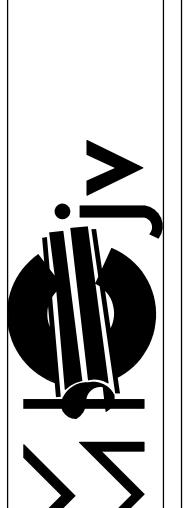

тіскет: HP-L00-031

1233 N. Price Rd. St. Louis, Mo 63132-2303 314-997-6600 phone