




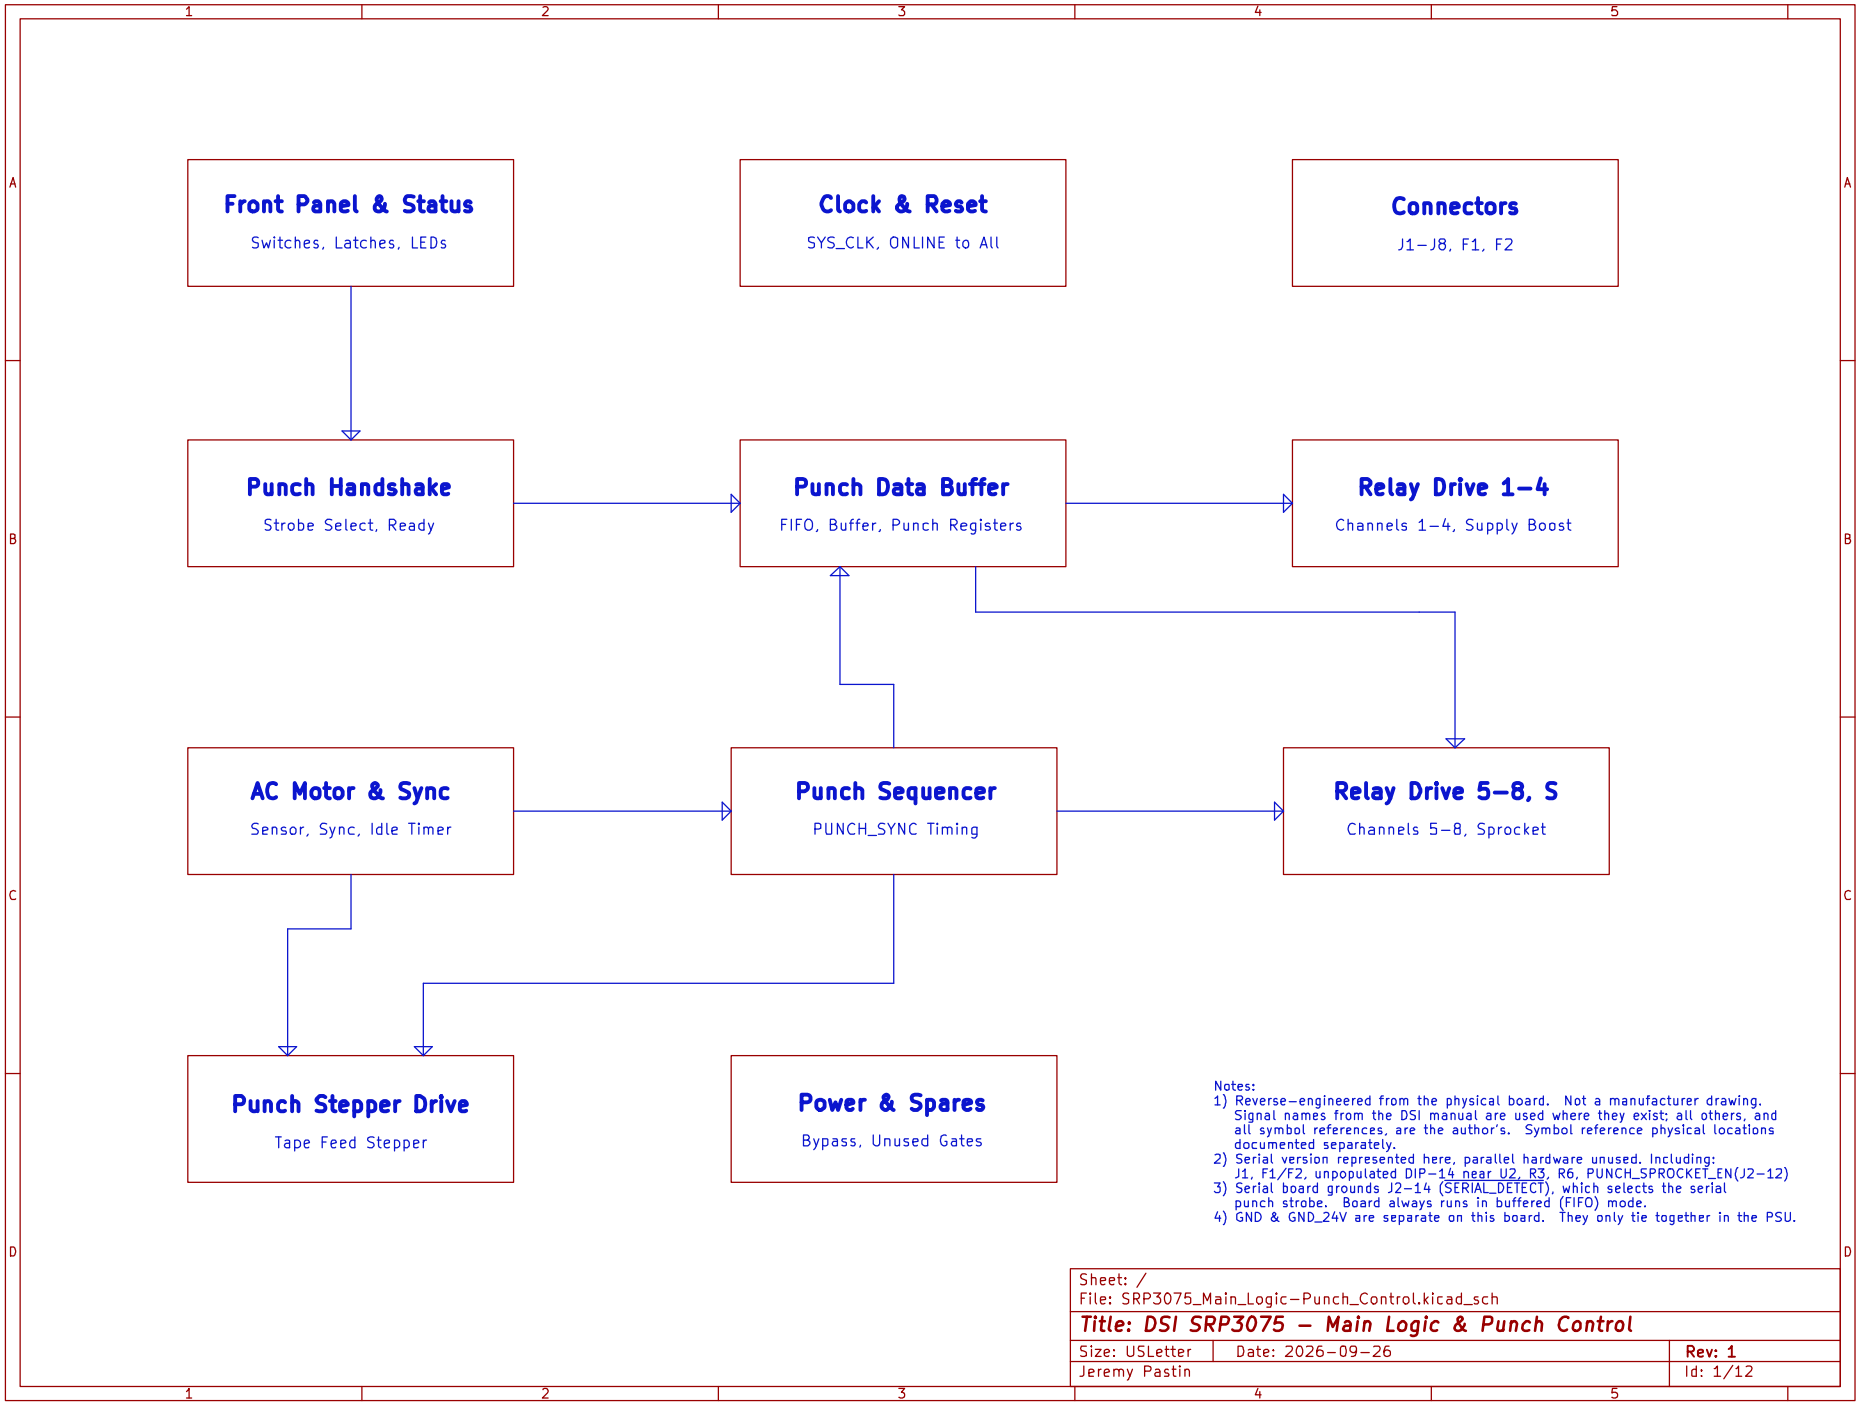

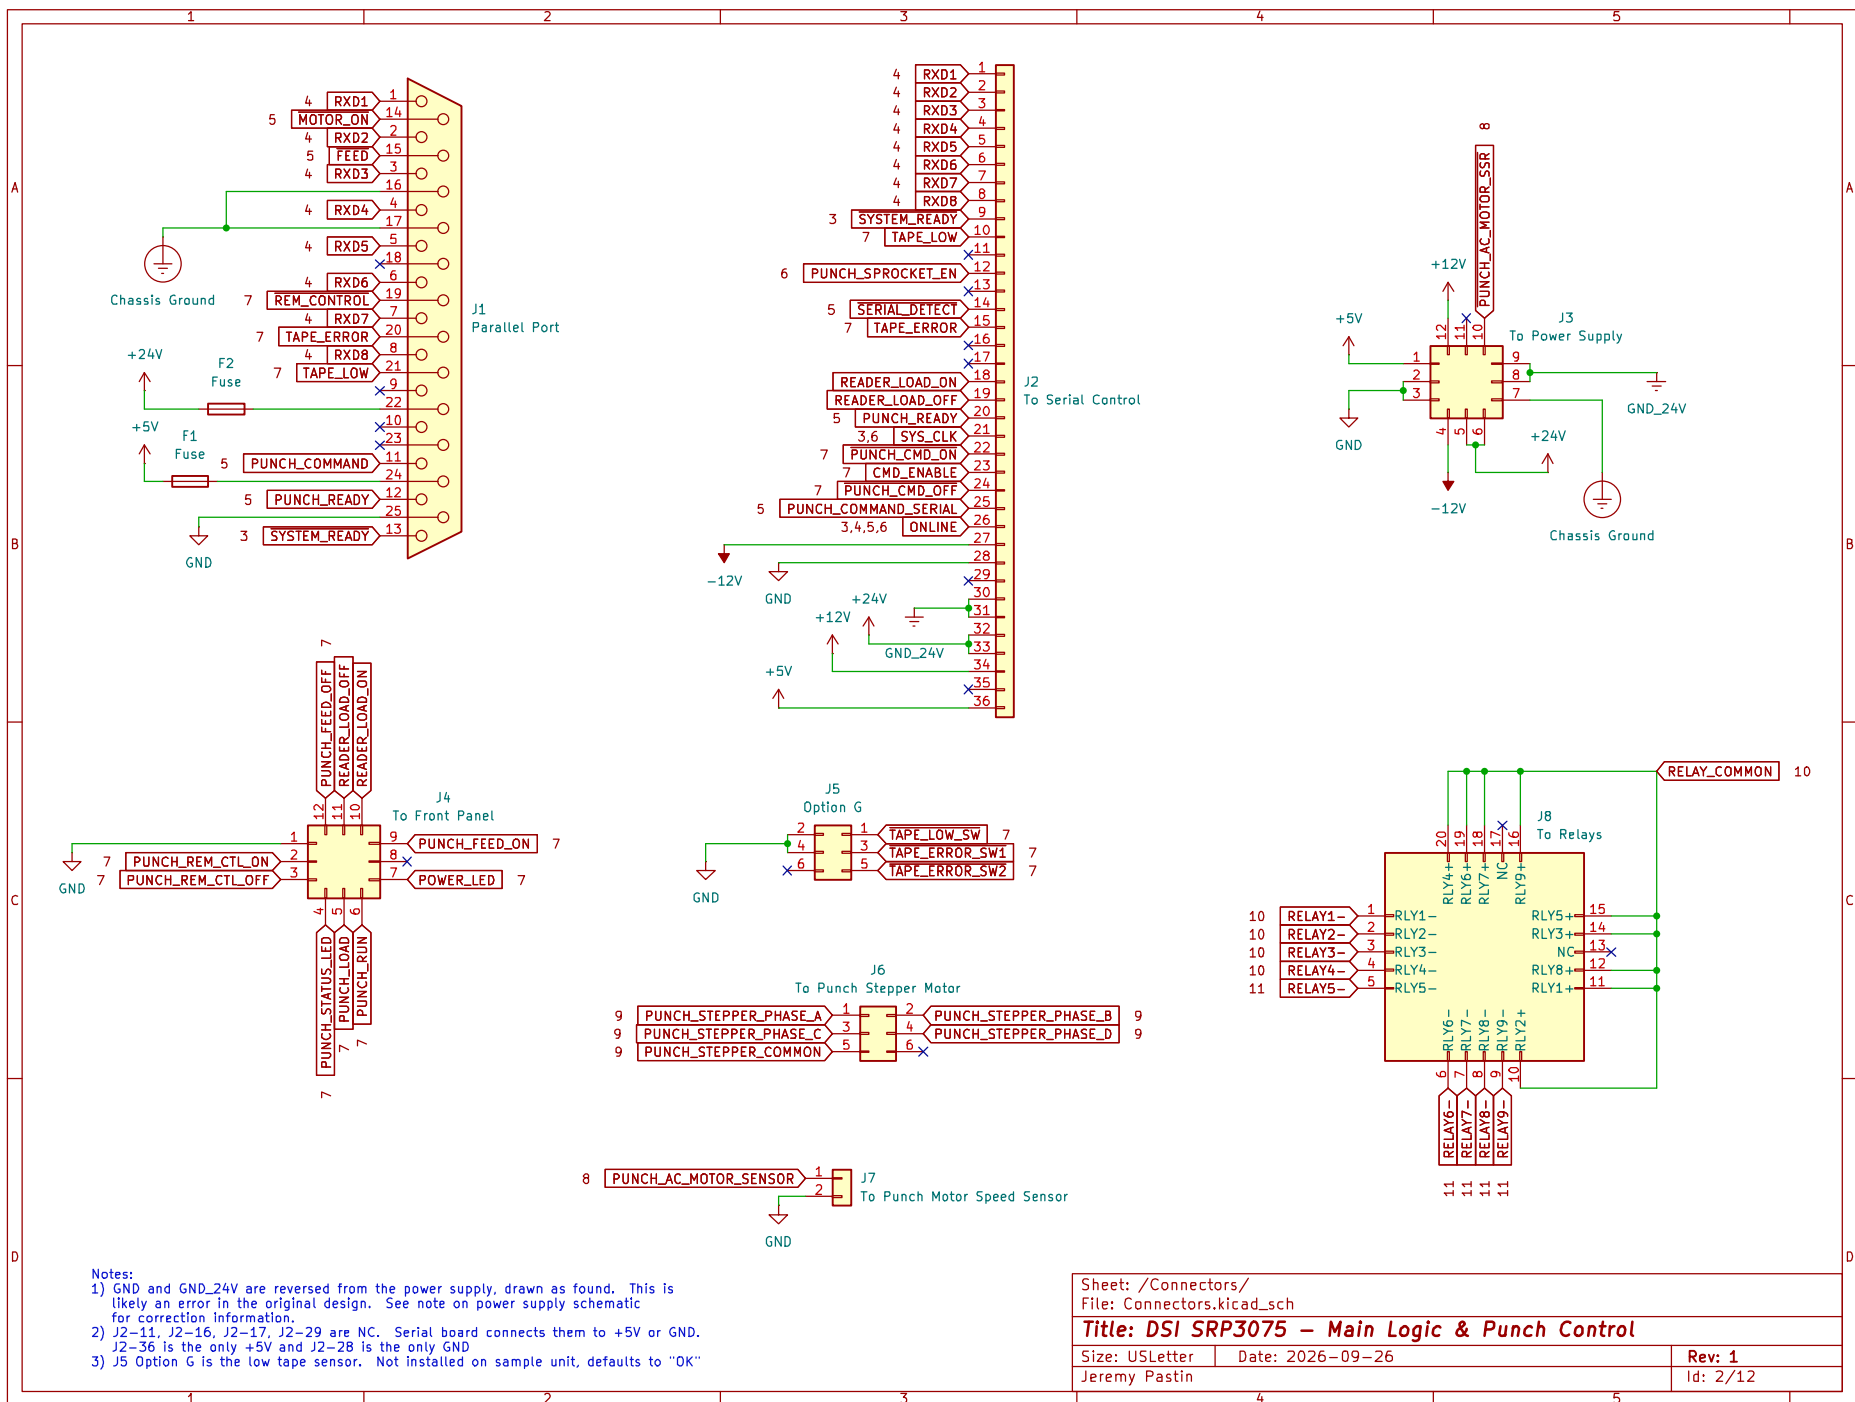

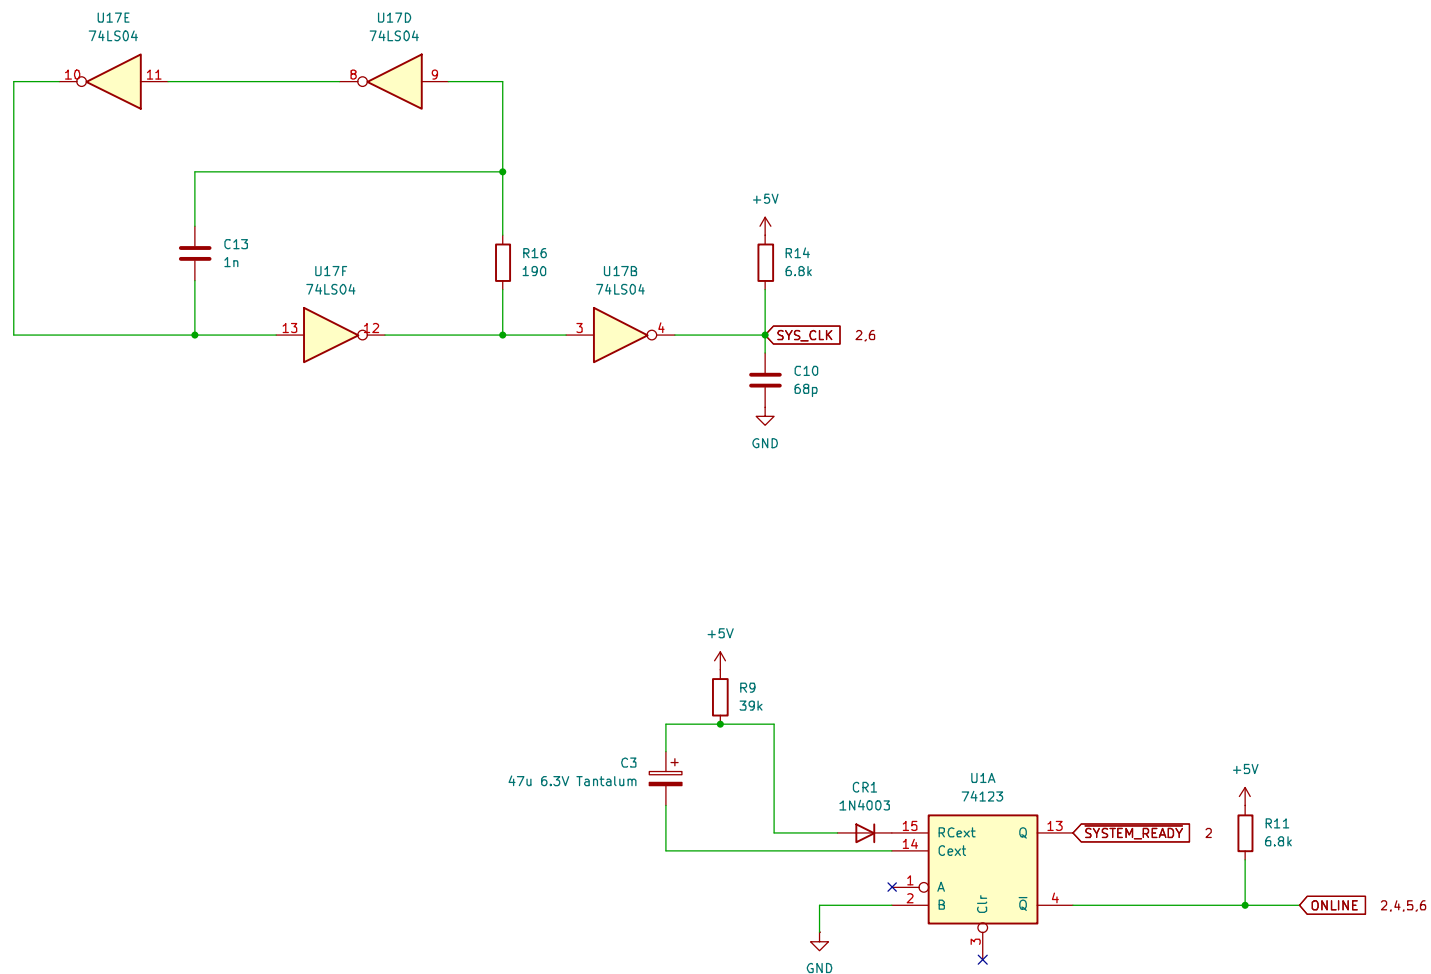

Notes:
 1) SYS_CLK also clocks the serial board
 2) U1A has no trigger, power on pulse is ~0.5s. SYSTEM_READY also drives UART master reset on serial board.

Sheet: /Clock & Reset/ File: ClockReset.kicad_sch		
Title: DSI SRP3075 – Main Logic & Punch Control		
Size: USLetter	Date: 2026-09-26	Rev: 1
Jeremy Pastin		Id: 3/12

