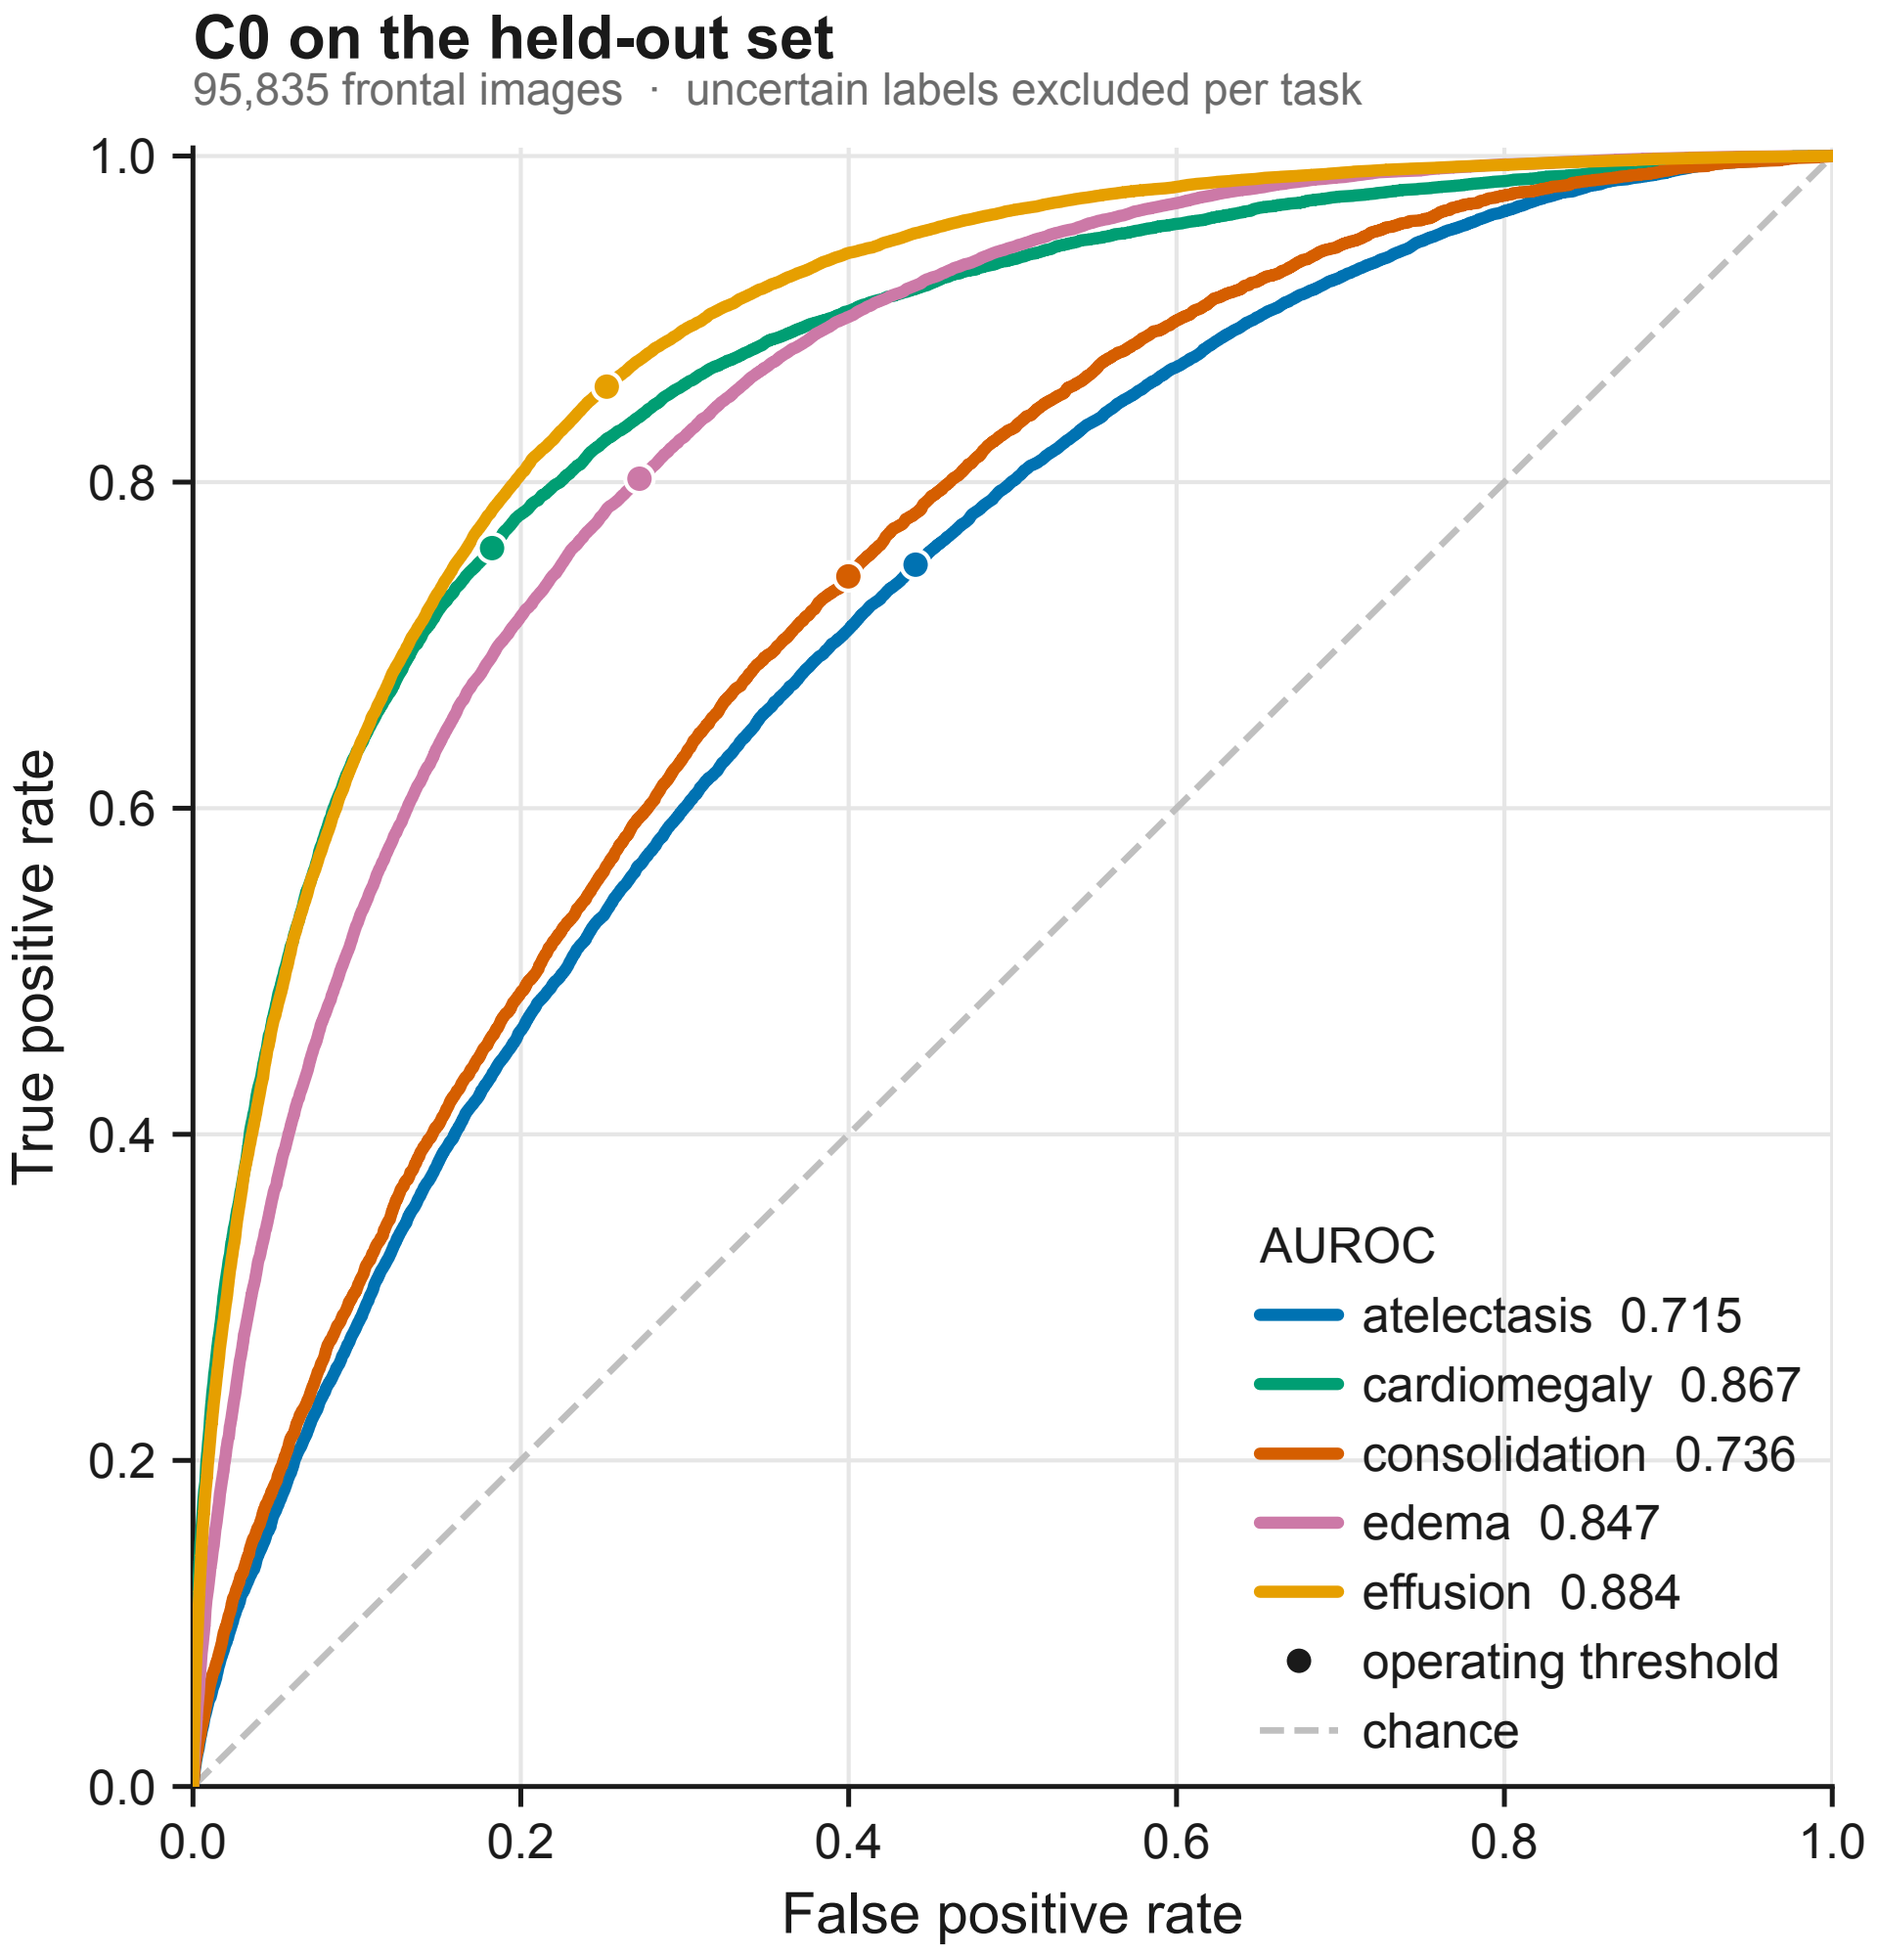

C0 on the held-out set
95,835 frontal images · uncertain labels excluded per task
True positive rate
False positive rate
0.0
0.2
0.4
0.6
0.8
1.0
AUROC
atelectasis 0.715
cardiomegaly 0.867
consolidation 0.736
edema 0.847
effusion 0.884
operating threshold
chance