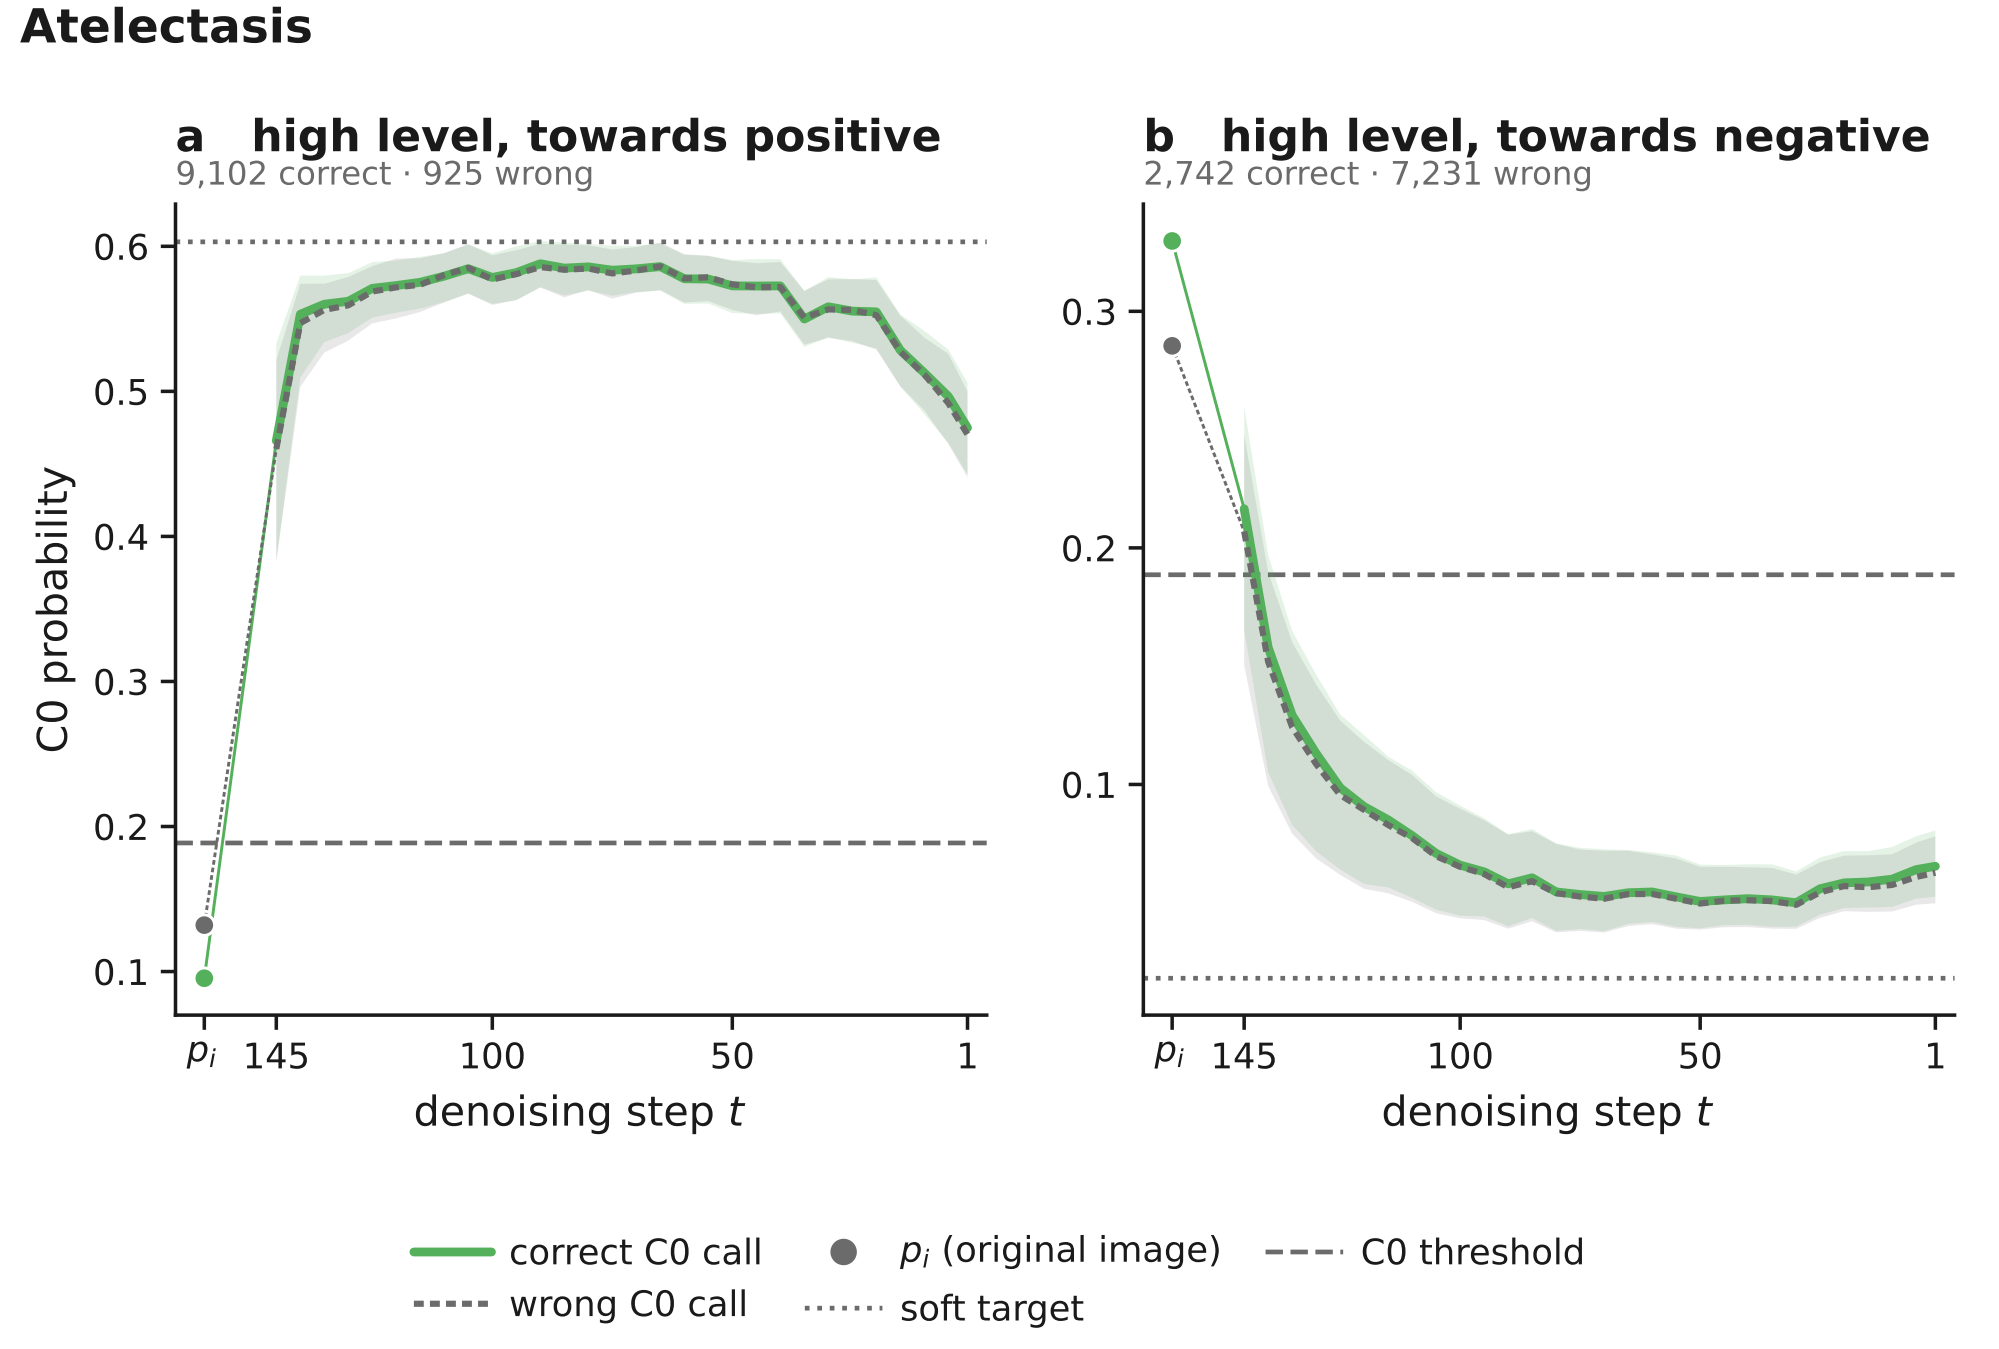
Atelectasis
a high level, towards positive
9,102 correct · 925 wrong
b high level, towards negative
2,742 correct · 7,231 wrong
C0 probability
0.6
0.5
0.4
0.3
0.2
0.1
p_i
145
100
50
1
denoising step t
correct C0 call
wrong C0 call
p_i (original image)
soft target
C0 threshold