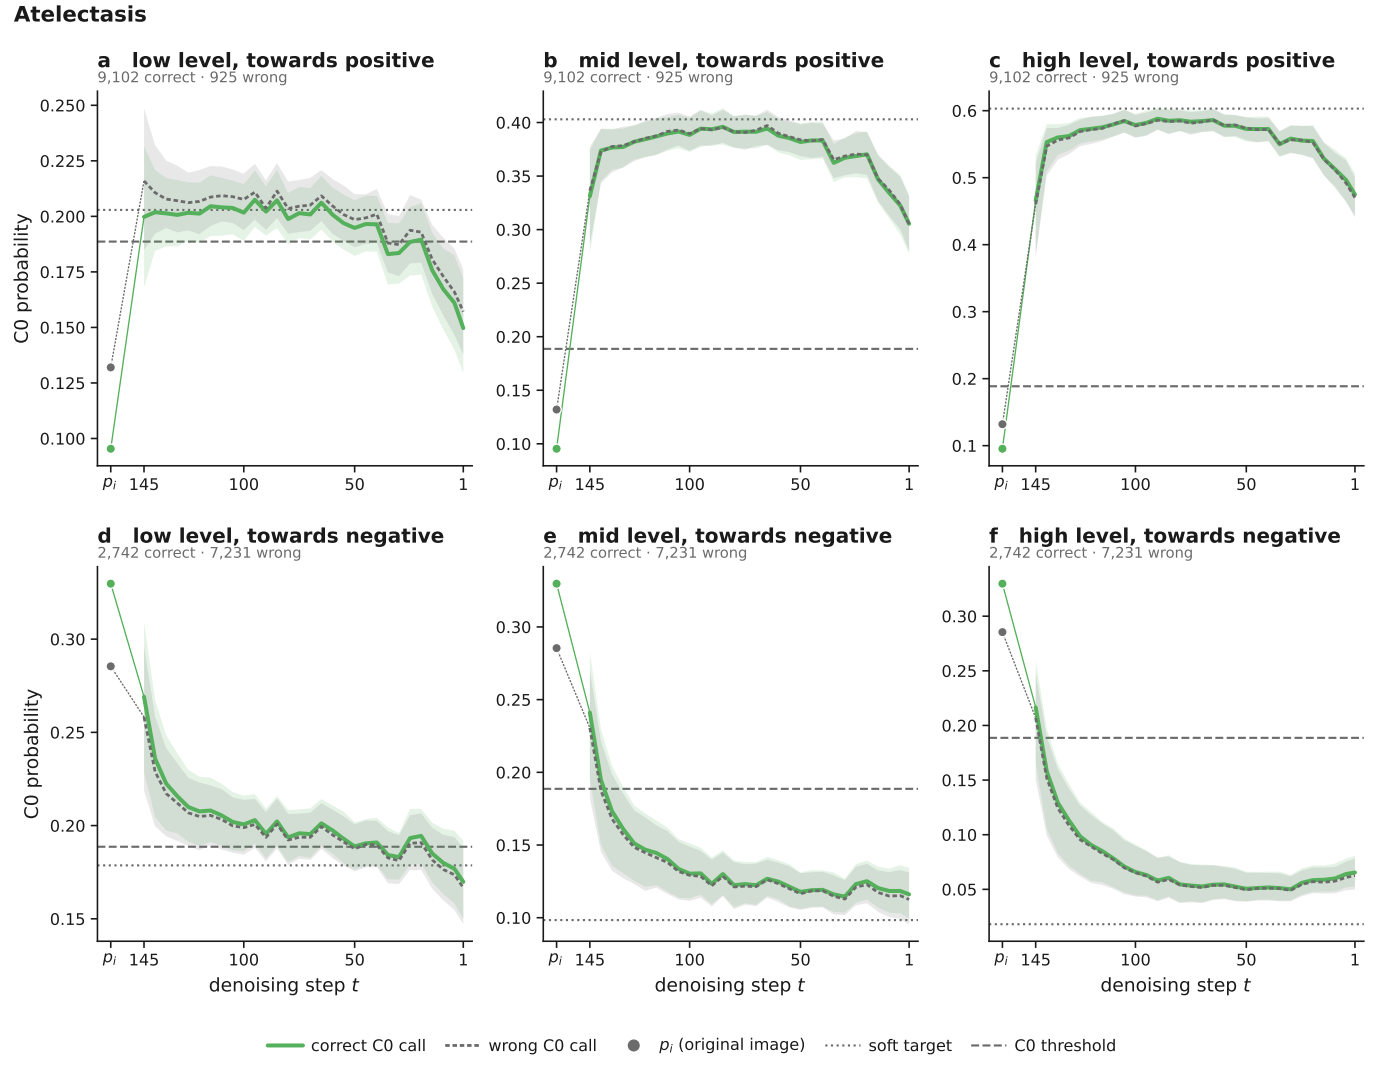
Atelectasis
a low level, towards positive
9,102 correct · 925 wrong
b mid level, towards positive
9,102 correct · 925 wrong
c high level, towards positive
9,102 correct · 925 wrong
d low level, towards negative
2,742 correct · 7,231 wrong
e mid level, towards negative
2,742 correct · 7,231 wrong
f high level, towards negative
2,742 correct · 7,231 wrong
C0 probability
denoising step t
p_i
145
100
50
1
correct C0 call
wrong C0 call
p_i (original image)
soft target
C0 threshold