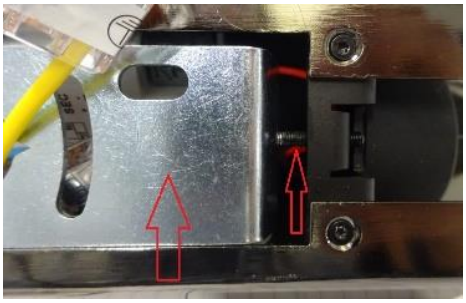
☑ CTL Provisional DECISION SHEET (PDSH)

☐ CTL DECISION SHEET (DSH)

Standard(s) (incl. year)	**Subclause(s)**	**Tracking No.**
IEC 60598-1:2020	7.2	2275
Category		
LITE		
Subject	**Keywords**	**Provided to**
Earthing connection	Earthing connection	ETF 5

Question

Are the following constructions acceptable?

Picture 1	Picture 2
	

The earthing connection for the metal bar which is fixed to the ceiling is made by two screws on each side. The force of the screws will make the connection.

Can this connection be considered as permanent and reliable?


Or is an additional connection needed by screws or other means which are more reliable?

For a class I luminaire which is fixed to the ceiling a cover is used to protect the parts with basic insulation. This cover is not fixed by screws but by a couple of springs (minimum 2) in Picture 1; the springs scratch into the metal of the cover. In Picture 2 they don't.

Disclaimer: This document is controlled and has been released electronically.

Only the version on the IECEE Website is the current document version.



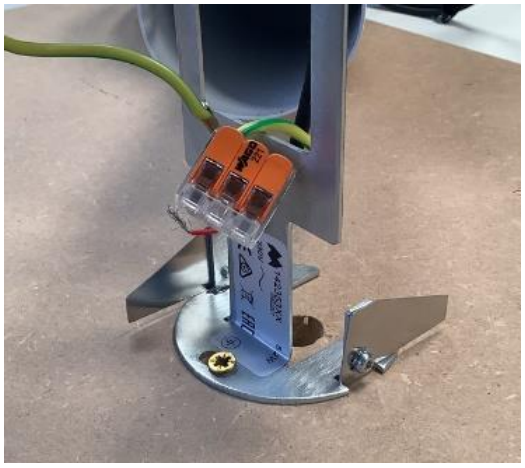


According to 7.2.1, the protective earthing contact shall be permanently and reliably connected to a protective earthing terminal or protective earthing.

Question 1: Are springs like the two examples above considered as permanent earthing contact if the product complies with 8.2.6 and can withstand a force of 20 N perpendicular to the mount surface?

Question 2: If not, can these examples be considered as screwless terminals and be tested to §15?

Question 3: Can fix metal cutters which are pushed into the metal part of the cover be used forpermanent earth connection if they comply with 8.2.6 (applying a test force of 20 N)? See illustration below.

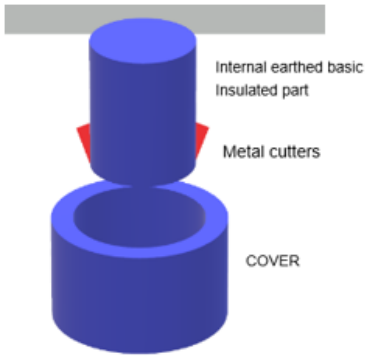

Decision

These kinds of earthing connections are acceptable if clauses 7.2.1 and 7.2.3 for screw connection are fulfilled.

Explanatory notes

Enquiry: OSMLUM ETF 5 minutes §9.1.6 2024

Date: 2024-05-23

PDSH:

Year of publication: 2025

To be approved at CTL plenary: 2025-03

DSH

Publication date: N/A