# ■ CTL Provisional DECISION SHEET (PDSH)
# ☐ CTL DECISION SHEET (DSH)

| Standard(s) (incl. year) | Subclause(s) | Tracking No. |
|---|---|---|
| IEC 62619:2017<br>IEC 62619:2022 | 7.2.3 | 2267 |
| **Category** | | |
| BATT | | |
| **Subject** | **Keywords** | **Developed by** |
| Test unit requirement for drop test | Drop test, stand-alone BMS design. | ETF 13 |

**Question**

For batteries that by design the BMS unit is a stand-alone unit (i.e. not integrated), when conducting the drop test, should the BMS unit also be included during the test (and also inclusive when considering the weight of the test unit)?

**Decision**

According to Note b of Table 1 and the definition in Clause 3.11, the manufacturer may declare a smaller battery system including the battery and its BMS as the test unit.

For example: 1 BMS+ 1 PACK which can function and represent the final battery system.

**Explanatory notes**


Enquiry:
Date: 2023-05-09

PDSH:
Year of publication: 2024
To be approved at CTL plenary: 2025

DSH
Publication date:

Nowadays more and more battery systems have with "stack-up design" (that can have more units of batteries connected/stacked together). Most of the time, for this design, the BMS unit is a separate unit, i.e. each battery unit only has a monitoring function while the controlling function is within the BMS unit.

Example:

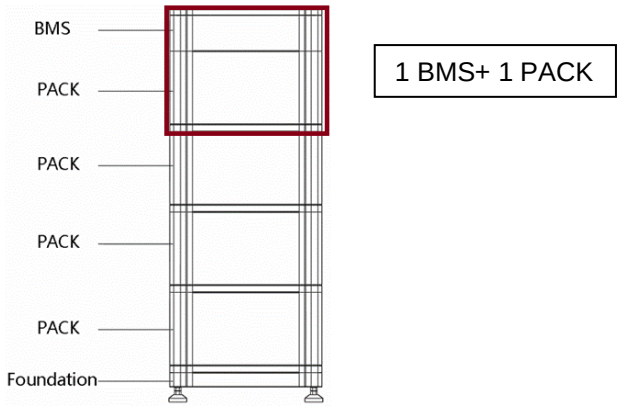


Disclaimer: This document is controlled and has been released electronically.
Only the version on the IECEE Website is the current document version.