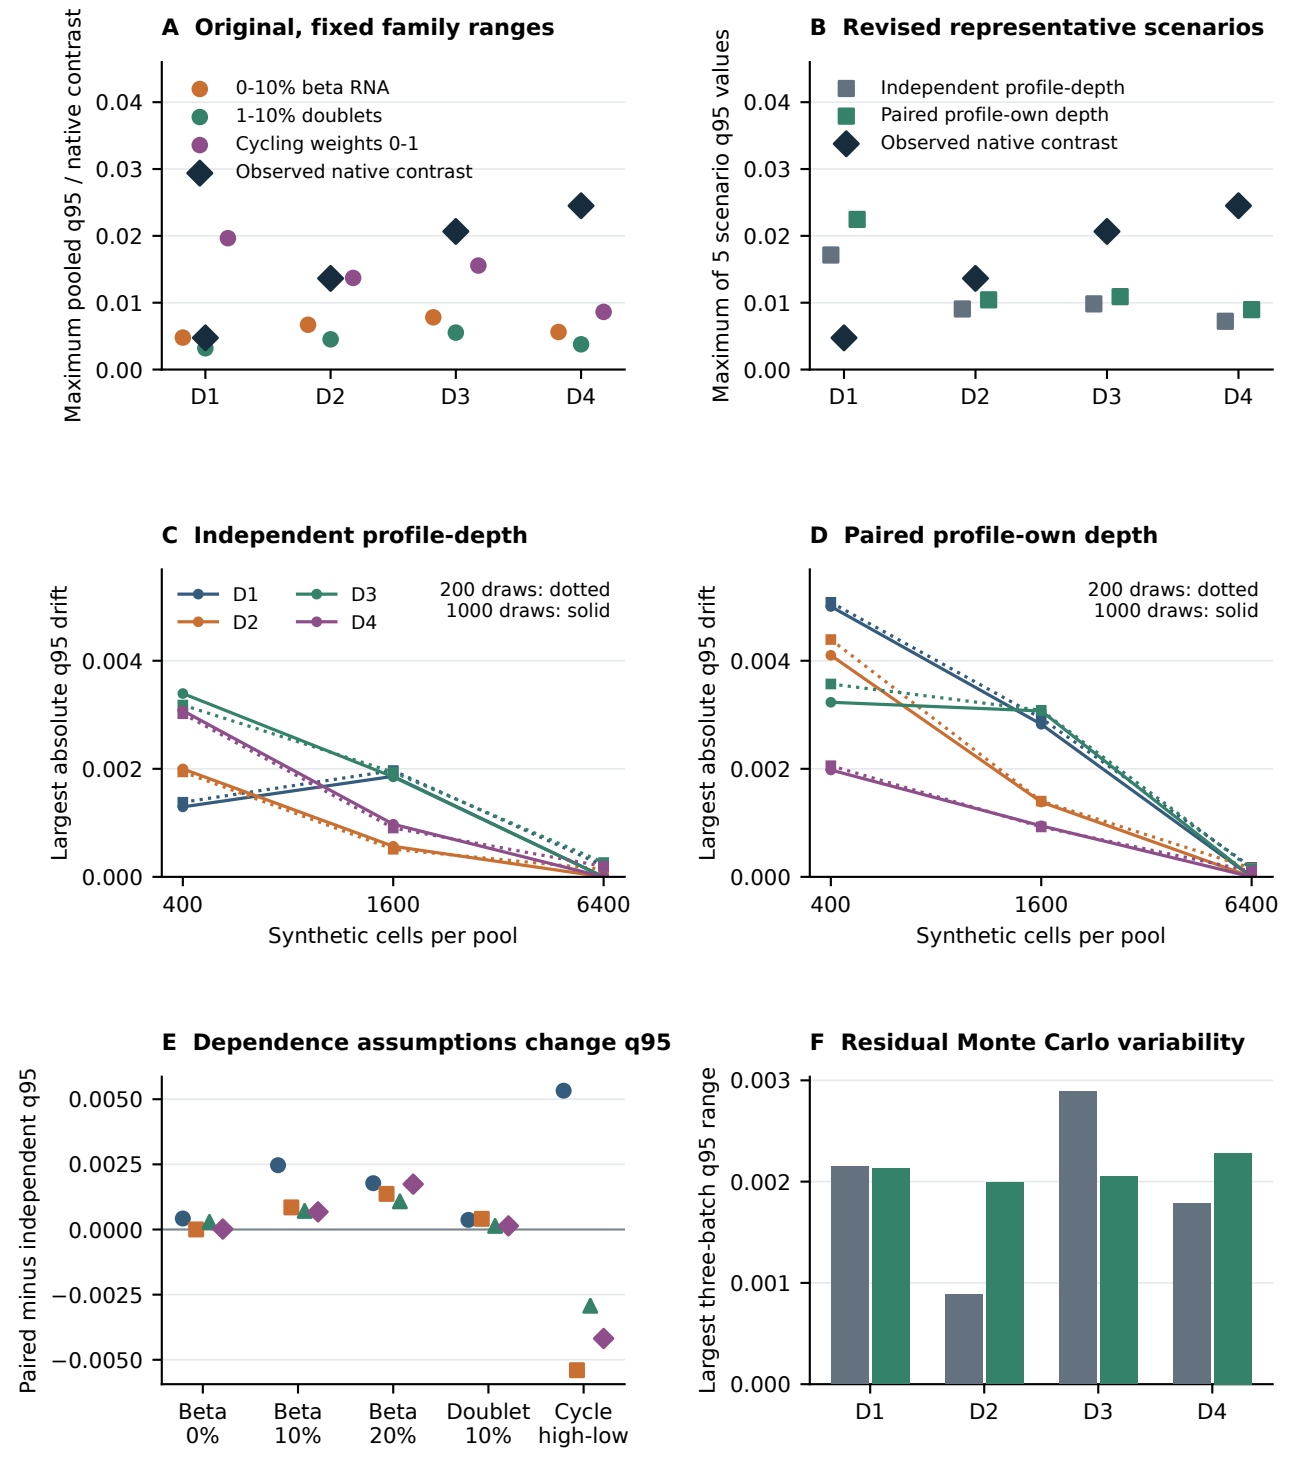

B,E,F: pools 6400, 1000 group draws per batch, 3 batches. C,D: maximum over the 5 scenarios relative to that setting. Conditional MC diagnostics are not calibrated contamination bounds or convergence guarantees.