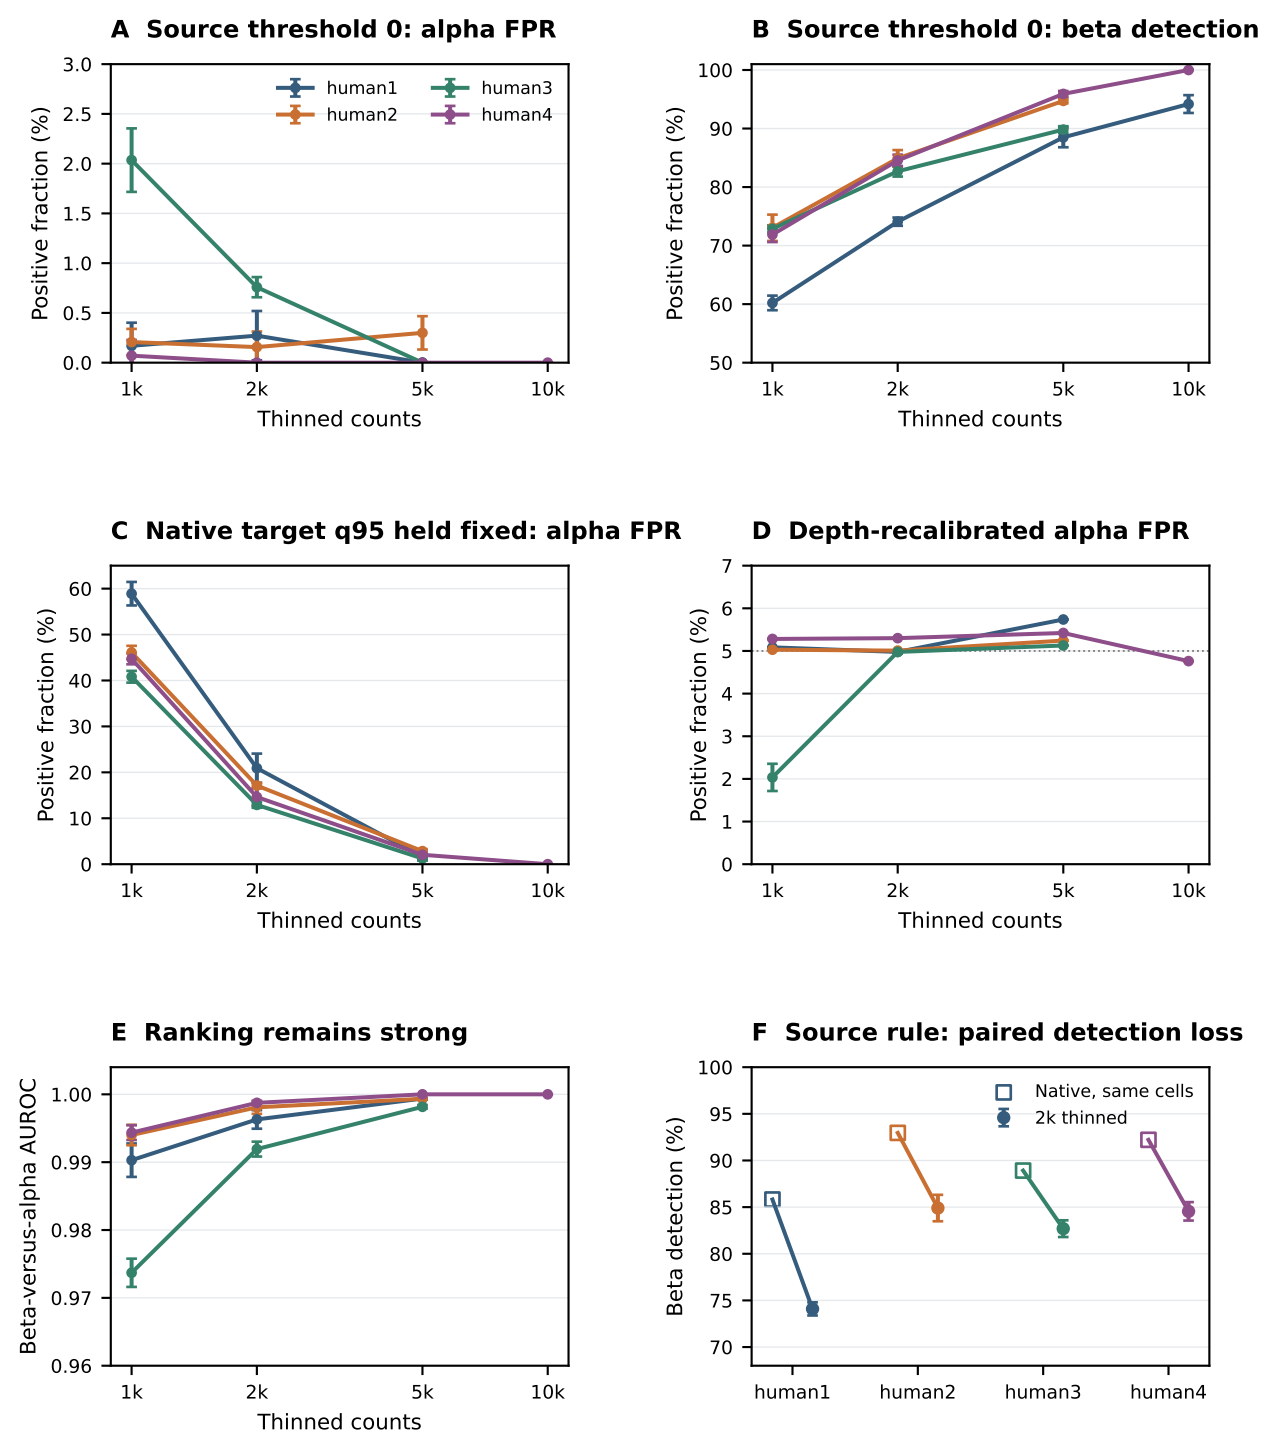
A Source threshold 0: alpha FPR
Positive fraction (%)
Thinned counts
human1
human2
human3
human4
B Source threshold 0: beta detection
C Native target q95 held fixed: alpha FPR
D Depth-recalibrated alpha FPR
E Ranking remains strong
Beta-versus-alpha AUROC
F Source rule: paired detection loss
Beta detection (%)
Native, same cells
2k thinned