SIEMENS

Installation Instructions
Model XLS-RCC13F-ADPT

Adapter Kit

INTRODUCTION

Use the Model XLS-RCC13F(R)-ADPT Adapter Kit from Siemens Industry, Inc., to upgrade existing MXL Remote Command Centers installed in Model RCC-1F(R) and RCC-3F(R) backboxes to FireFinder-XLS/Desigo Fire Safety Modular/Cerberus PRO Modular System Status Displays. The XLS-RCC13F(R)-ADPT Adapter Kit consists of an adapter plate and door. The XLS-RCC13F-ADPT door (S54430-Z13-A1) is black and the XLS-RCC13FR-ADPT door (S54430-Z13-A2) is red. The XLS-RCC13F-ADPT and the XLS-RCC13FR-ADPT are identical in all other ways and will be referred to in the remainder of this document as XLS-RCC13F-ADPT.

The adapter plate installs over the existing studs in an RCC-1F or RCC-3F backbox and provides threaded holes on which to mount an SSD System Status Display.

NOTE

The XLS-RCC13F-ADPT is for indoor use only in dry environments.

To convert an RCC-1F or RCC-3F backbox from an MXL component to an XLS/Desigo Fire Safety Modular/Cerberus PRO Modular component, you must first disassemble the RCC and then assemble the SSD. This two-part procedure is described in detail below.

DISASSEMBLY OF RCC REMOTE COMMAND CENTER

NOTE

Remove all system power, first battery and then AC.

1. Remove and discard the outer door.
2. Disconnect the MKB Keyboard panel and remove it from the standoffs.
3. Remove the standoffs and retain them for later use.
4. Disconnect and remove all modules from the backbox, making sure to mark all wires for easier rewiring to the XLS/Desigo Fire Safety Modular/Cerberus PRO Modular system.

ASSEMBLY OF SSD SYSTEM STATUS DISPLAY

The two parts of the XLS-RCC13F-ADPT are installed separately. The adapter plate is installed first, followed by the door.

Adapter Plate

The XLS-RCC13F-ADPT adapter plate has holes in it that fit over the studs in an RCC backbox. The two larger holes in the bottom of the bracket are for clearance of studs in the RCC-1F backbox.

CAUTION

In an RCC-3F backbox, the XLS-RCC13F-ADPT must be mounted with the four holes at the bottom of the bracket as shown in Figure 1.

1. Place the XLS-RCC13F-ADPT over the studs in the RCC-1F or RCC-3F backbox. Refer to the locations marked “A” in Figure 1.

Siemens Industry, Inc.
Building Technologies Division

2. Secure the adapter plate in place with the four standoffs removed while dismounting the MKB keyboard.

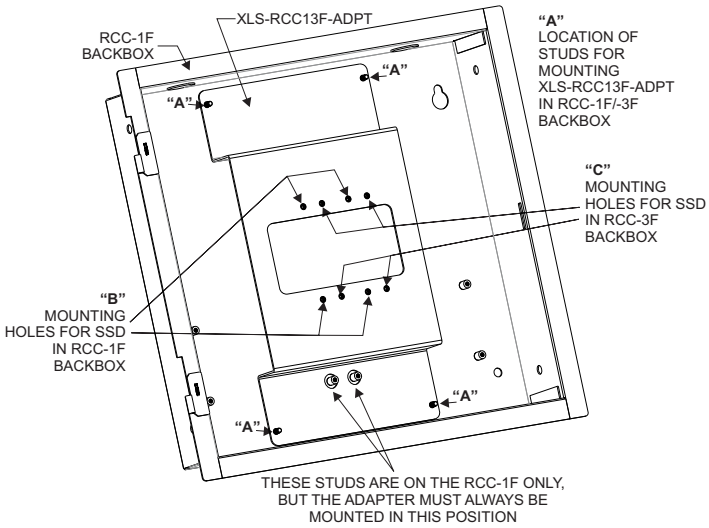


Figure 1
Installing the XLS-RCC13F-ADPT Adapter Plate in an RCC-1F or RCC-3F Backbox

3. An SSD System Status Display can be mounted on the XLS-RCC13F-ADPT using the locations shown in Figure 1 marked "B" for an RCC-1F backbox or marked "C" for an RCC-3F backbox.
4. Follow the directions in the applicable SSD Installation Instructions listed below to mount and wire the SSD in the RCC backbox. Use the four #6-32 x 1/2" Phillips screws provided to mount the SSD to the XLS-RCC13F-ADPT.

TABLE 1
SSD MODULES AND INSTALLATION INSTRUCTIONS

MODULES	INSTALLATION INSTRUCTIONS
SSD / SSD-INTL	P/N 315-034170
SSD-C / SSD-C-INTL	P/N 315-048733
SSD-C-REM	P/N 315-034773

Install the Outer Door

1. Insert the hinge pins on the outer door in the hinges on the backbox.
2. Close the outer door and secure with the key latch.

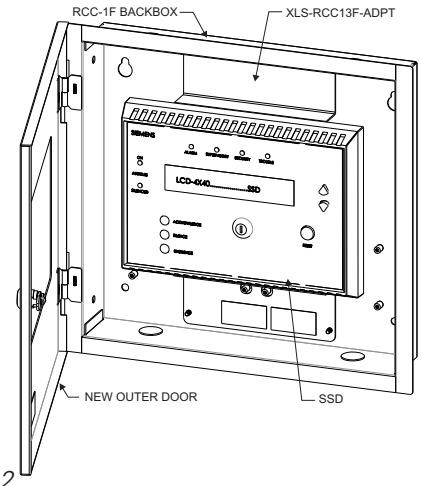


Figure 2
SSD Mounted in RCC-1F Backbox

Cyber security disclaimer

Siemens products and solutions provide security functions to ensure the secure operation of building comfort, fire safety, security management and physical security systems. The security functions on these products and solutions are important components of a comprehensive security concept.

It is, however, necessary to implement and maintain a comprehensive, state-of-the-art security concept that is customized to individual security needs. Such a security concept may result in additional site-specific preventive action to ensure that the building comfort, fire safety, security management or physical security system for your site are operated in a secure manner. These measures may include, but are not limited to, separating networks, physically protecting system components, user awareness programs, defense in depth, etc.

For additional information on building technology security and our offerings, contact your Siemens sales or project department. We strongly recommend customers to follow our security advisories, which provide information on the latest security threats, patches and other mitigation measures.

http://www.siemens.com/cert/en/cert-security-advisories.htm

Siemens Industry, Inc.
Building Technologies Division
Florham Park, NJ

Siemens Canada, Ltd.
1577 North Service Road East
Oakville, Ontario
L6H 0H6 Canada

Document ID A6V10328638_enUS_b