SIEMENS

Installation Instructions
Model MOM2-XMP

MOM-2 Mounting Plate

INTRODUCTION

The Model MOM2-XMP Mounting Plate from Siemens Industry, Inc., is used in CAB1, CAB2, CAB3 enclosures for mounting MOM-2 modules. A MOM2-XMP mounts in one position on a CAB-MP system mounting plate.

NOTE

CAB-1 Enclosure is for indoor use only in dry environments.

INSTALLATION

WARNING

Remove all system power before installation, first battery then AC. (To power up, connect the AC first, then the battery.)

Refer to Figure 1.
There is a top and bottom to the MOM2-XMP Mounting Plate. The top end is the end with the longer (1 7/8") cutout.

1. With the top end of the MOM2-XMP facing up, place the MOM-2 on the plate with the terminal blocks (TB4/TB2) of the MOM-2 on the right side.
2. Secure in place with two of the 10-32 screws supplied in the upper and lower threaded holes of the plate.
3. The MOM2-XMP can be installed in any one of the four mounting positions on the CAB-MP, however consideration should be given to wiring requirements. If the terminal blocks of the MOM-2 will be utilized, it is best to place the MOM2-XMP in position 4 of the CAB-MP (See Figure 2).
4. Secure the MOM2-XMP to the CAB-MP with two of the 10-32 screws in the top threaded posts and two of the 10-32 screws in the bottom threaded posts of the CAB-MP.

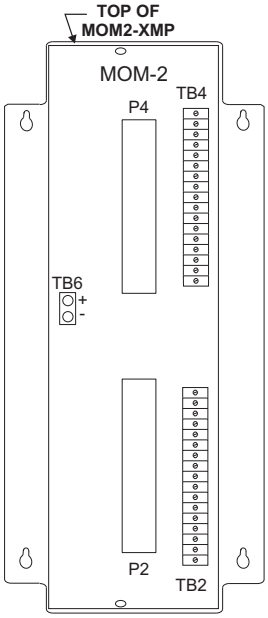


Figure 1
Mounting The MOM-2
On The MOM2-XMP

COMPATIBILITY

The MOM2-XMP can be used in CAB1, CAB2, and CAB3 enclosures.

SPECIFICATIONS

MOM2-XMP Mounting Plate: 4.75"W x 17"H

P/N 315-034822-3

Siemens Industry, Inc.
Building Technologies Division

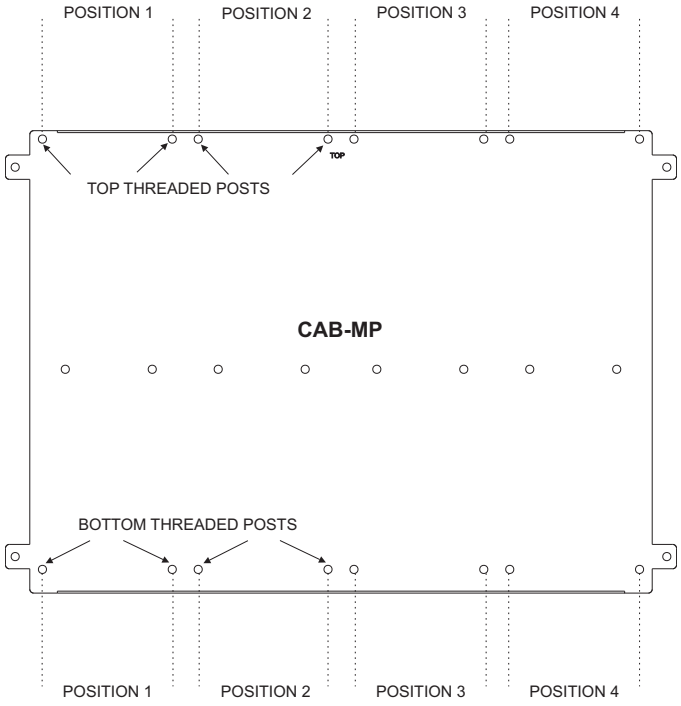


Figure 2
CAB-MP Mounting Positions