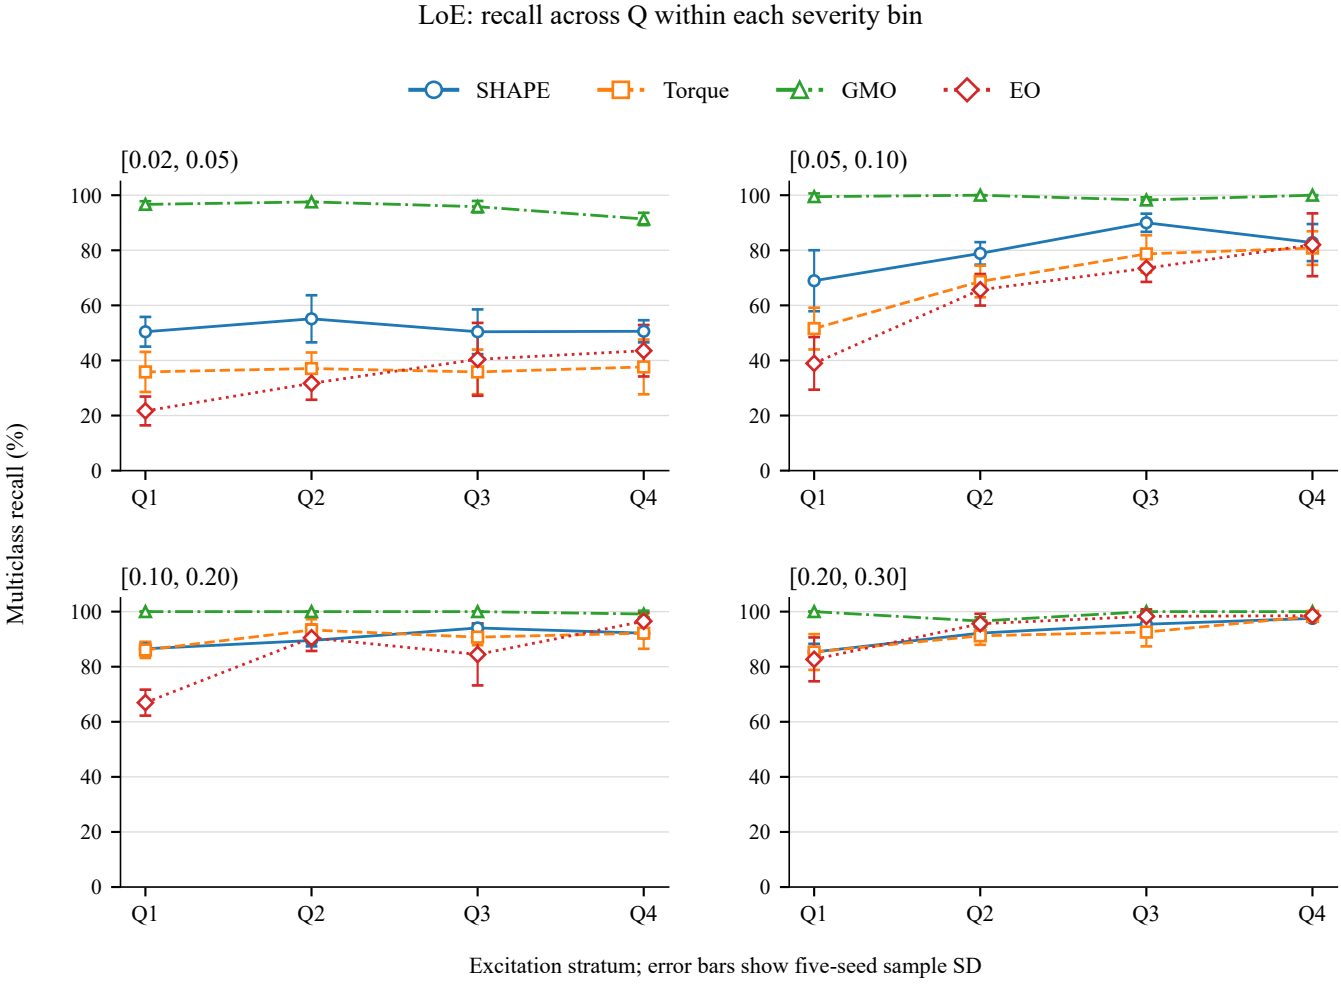
LoE: recall across Q within each severity bin
SHAPE
Torque
GMO
EO
[0.02, 0.05)
[0.05, 0.10)
[0.10, 0.20)
[0.20, 0.30]
Multiclass recall (%)
0
20
40
60
80
100
Q1
Q2
Q3
Q4
Excitation stratum; error bars show five-seed sample SD