
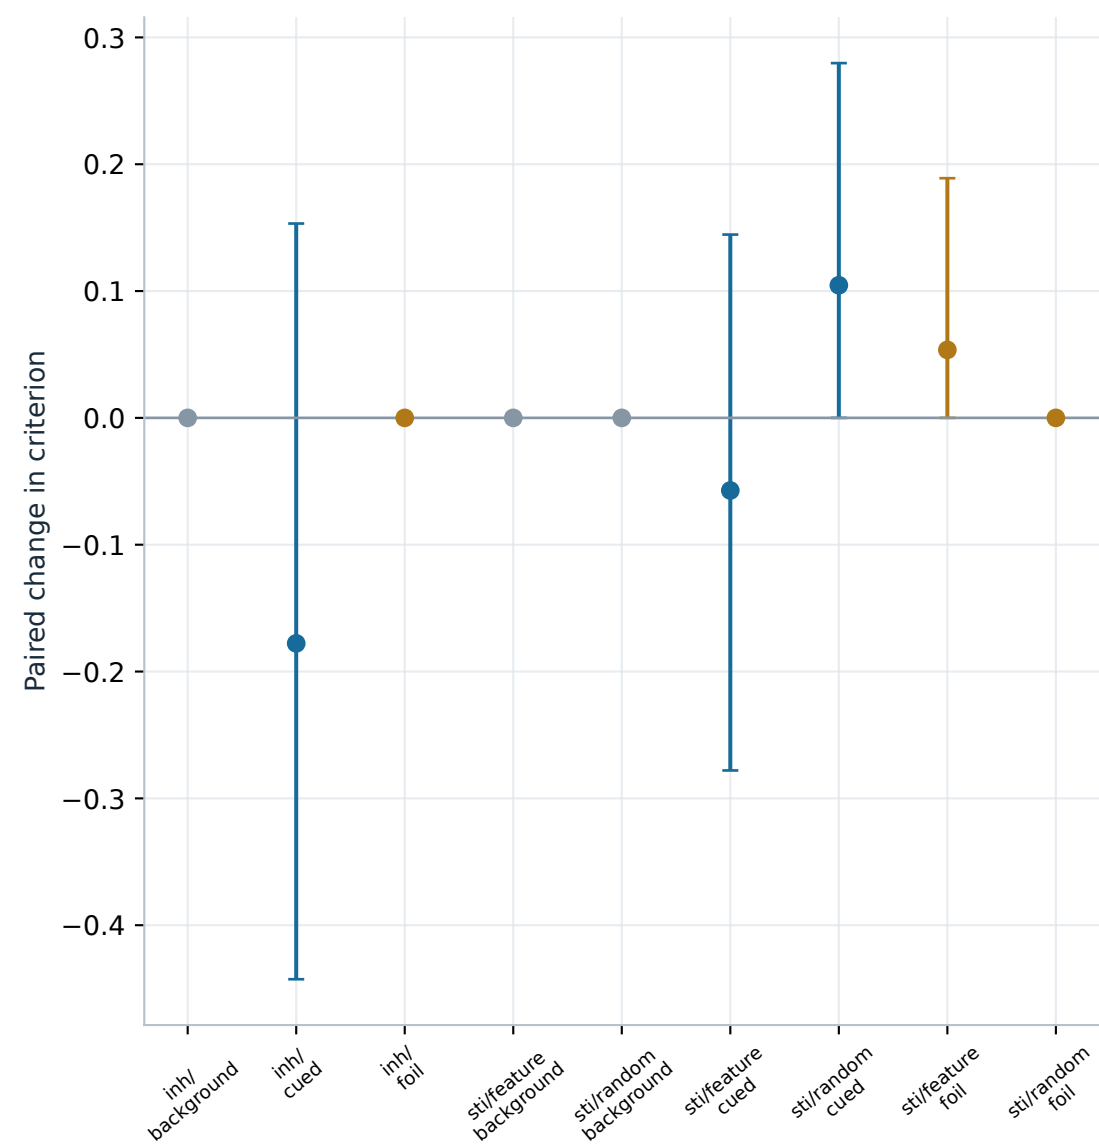


Sensitivity and report criterion must be distinguished

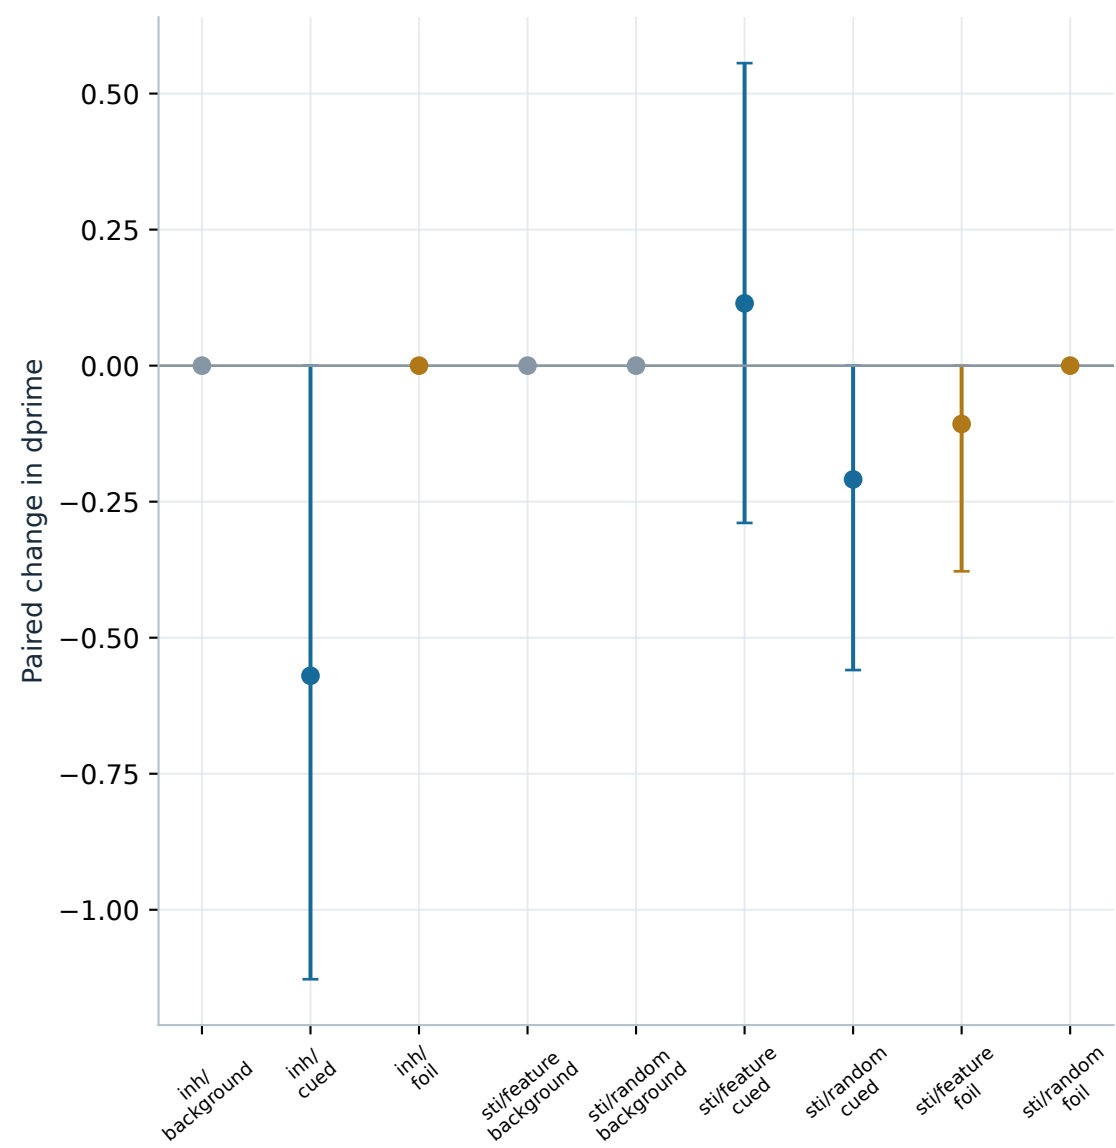

Signal: aligned target rotation. Noise: unchanged or opposite target, pooled explicitly here; separate subtype response rates saved. $d' = Z(\text{hit}) - Z(\text{false alarm})$; criterion = $-[Z(\text{hit}) + Z(\text{false alarm})]/2$. All rates use loglinear($k+.5$)/($n+1$) correction, including ceiling cells. 95% paired trial bootstrap; one checkpoint, exploratory multiple contrasts, no familywise significance claim.