



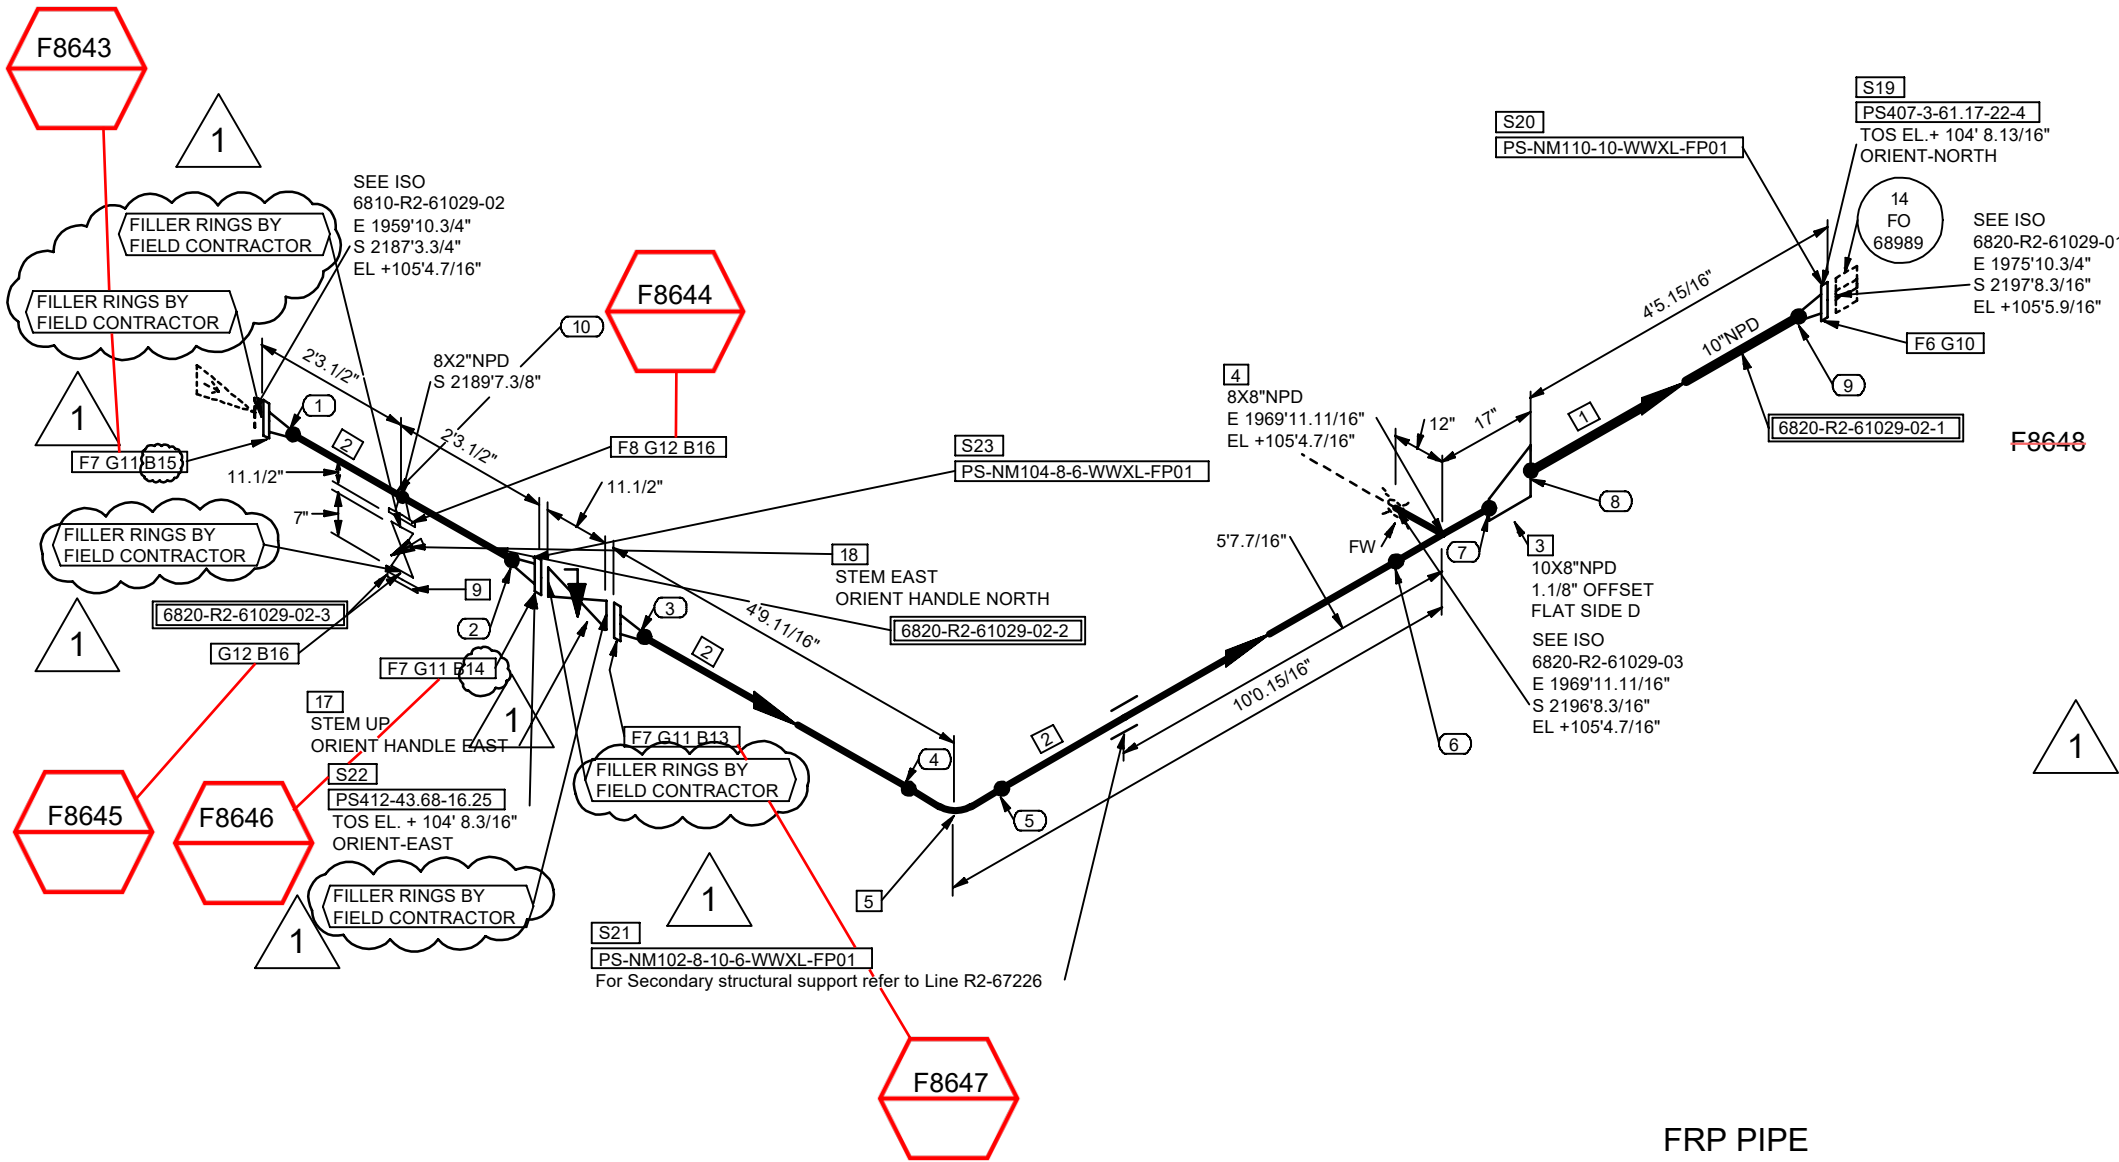

COORDINATE SYSTEM : PLANTCOORDINATES

NOTES:

1. FOR LINE PRESSURES, TEMPERATURES, INSULATION TYPE AND THICKNESS, ETC. REFER TO LATEST REVISION OF LDT.
2. FOR STANDARD PIPE SUPPORT DETAILS SEE PROJECT STANDARD.
3. FIELD SHIM TO SUIT UNLESS OTHERWISE NOTED.
4. FOR PWHT REQUIREMENTS REFER TO LINE CLASS SPECIFICATION.
5. ALL THREADED PIPE LINE SYSTEMS, FIELD SHALL VERIFY DIMENSION PRIOR TO ERECTION.
6. FFW DESIGNATION AT WELDS INDICATES FIELD FIT WELD, WHERE PIPE FABRICATOR IS TO ADD 9 INCH OF PIPE TO THE ISOMETRIC DIMENSION TO ENABLE THE FIELD TO CUT TO FIT AT SITE.
7. REFER TO 202998C-000-W1-1300-0001 FOR FRP AND DUAL-LAM FABRICATION.



Information contained in this document is the work product of one or more legal entities of Technip Energies N.V. and embodies confidential and proprietary information of the applicable entity and/or its client. Use of this information is restricted in accordance with conditions specified by the contract. Technip Energies N.V. and its affiliates disclaim any and all liabilities for any changes or modifications to this document which are made by any person other than the entity that issued the document under the applicable client contract.

THIS DOCUMENT IS UNCONTROLLED WHEN REPRODUCED

REV	DATE	BY	DESCRIPTION	CHKD	MTD	STRESS	APRVD
1	2025-04-18	RVA	ISSUED FOR CONSTRUCTION	SAD	KJK	SMR	GR
0	2024-09-20	RVA	ISSUED FOR CONSTRUCTION	SAD	KJK	SMR	GR

FRP PIPE

Filler Material Requisition

Date: 4-25-25
Line Class: WWXL-FP01
WPS: N/A
Electrode: N/A
Signature: *Glenn Sumrall, Jr.*

SHOP MATERIALS

NO	NPD	DESCRIPTION	IDENT	QTY
1	10	Pipes, -, Prj Std, FRP, PE, -, .701"	C8GYA8YY	3.4
2	8	Pipes, -, Prj Std, FRP, PE, -, .592"	C8GYAA87	13.6
3	10X8	Ecc Reducer, Prj Std, FRP, PE, Prj Std, -, .701" x .592"	C8GYAC9R	1
4	8X8	Eq Te, Prj Std, FRP, PE, Prj Std, -, .592"	C8GYABMY	1
5	8	90° Elb LR, Prj Std, FRP, PE, Prj Std, -, .592"	C8GYATLX	1
6	10	Neck Flg, ASTM D5421, FRP, 150 PSI, FF/PE - Butt & Wrap Type, -, .701"	C8M6VXFE	1
7	8	Neck Flg, ASTM D5421, FRP, 150 PSI, FF/PE - Butt & Wrap Type, -, .592"	C8M6VYS2	3
8	2	Neck Flg, ASTM D5421, FRP, 150 PSI, FF/PE - Butt & Wrap Type, -, .321"	C8M6VY24	1
9	2	Bld Flg, ASTM D5421, FRP, 150 PSI, FF, -	C8JWWH94	1

OTHER THAN SHOP MATERIALS


NO	NPD	DESCRIPTION	IDENT	QTY
10	10	NM Flat Gk, EPDM, 150 Lbs, FF as per ASME B16.5, Full Face, Thk=1/8in, -	C7V61SDZ	1
11	8	NM Flat Gk, EPDM, 150 Lbs, FF as per ASME B16.5, Full Face, Thk=1/8in, -	C7V61SEE	3
12	2	NM Flat Gk, EPDM, 150 Lbs, FF as per ASME B16.5, Full Face, Thk=1/8in, -	C7V61SE4	2
13	3/4	SBit 2 HHx N&2W, A193 Gr.B7/A194 Gr.2H, -, Xylan PTFE Coated, Typ B wsh, - 6 in. Length	C7CT0CKJ	8
14	3/4	SBit 2 HHx N&2W, A193 Gr.B7/A194 Gr.2H, -, Extra 1 Hex nut & 2 Lock Wsh, - 7.5 in. Length	C9PNU7E1	8
15	3/4	SBit 2 HHx N&2W, A193 Gr.B7/A194 Gr.2H, -, Extra 1 Hex nut & 2 Lock Wsh, - 13.5 in. Length	C9PNU7C2	8
16	5/8	SBit 2 HHx N&2W, A193 Gr.B7/A194 Gr.2H, -, Xylan PTFE Coated, Typ B wsh, - 4.75 in. Length	C7CT0CGV	8
17	8	Plug Flg, SP, Inverted Tapered Plug, Non Lubricated, API 599, ASTM A395 Gr.60-40-18 PFA Lined, 150 Lbs, RF, Ends as per ASME B16.5, -, GO, -, -, Valve Tag: PL-0618	C6SWL10L	1
18	2	Plug Flg, SP, Inverted Tapered Plug, Non Lubricated, API 599, ASTM A395 Gr.60-40-18 PFA Lined, 150 Lbs, RF, Ends as per ASME B16.5, -, LO, -, -, Valve Tag: PL-0618	C6SWL10P	1

PIPE SUPPORTS

19	10	PS407-3-61.17-22-4	PS407	1
20	10	PS-NM110-10-WWXL-FP01	PS-NM110	1
21	8	PS-NM102-8-10-6-WWXL-FP01	PS-NM102	1
22	8	PS412-43.68-16.25	PS412	1
23	8	PS-NM104-8-6-WWXL-FP01	PS-NM104	1

PIECE MARKS

6820-R2-61029-02-1 6820-R2-61029-02-2 6820-R2-61029-02-3

SERVICE: R2	VAPOR/LIQUID: L	INSUL TYPE: Per LDT	INSUL THK: Per LDT	SHOP: Y	FIELD: Y	PAINT CODE: Per LDT	MODULE: -	
				P&ID: 202998C-001-PID-0021-0305				
				UNIT#: 6800	EWP AREA: 6820	SPEC: WWXL-FP01	STRESS CALC #: CN-0137/CN-0255	
				LINE No: 10"-R2-61029-WWXL-FP01-N				
				DRAWING NUMBER 6820-R2-61029-02				REV. 1
				OxyChem Redstone Battleground PROJECT				

OxyChem Redstone Battleground PROJECT

