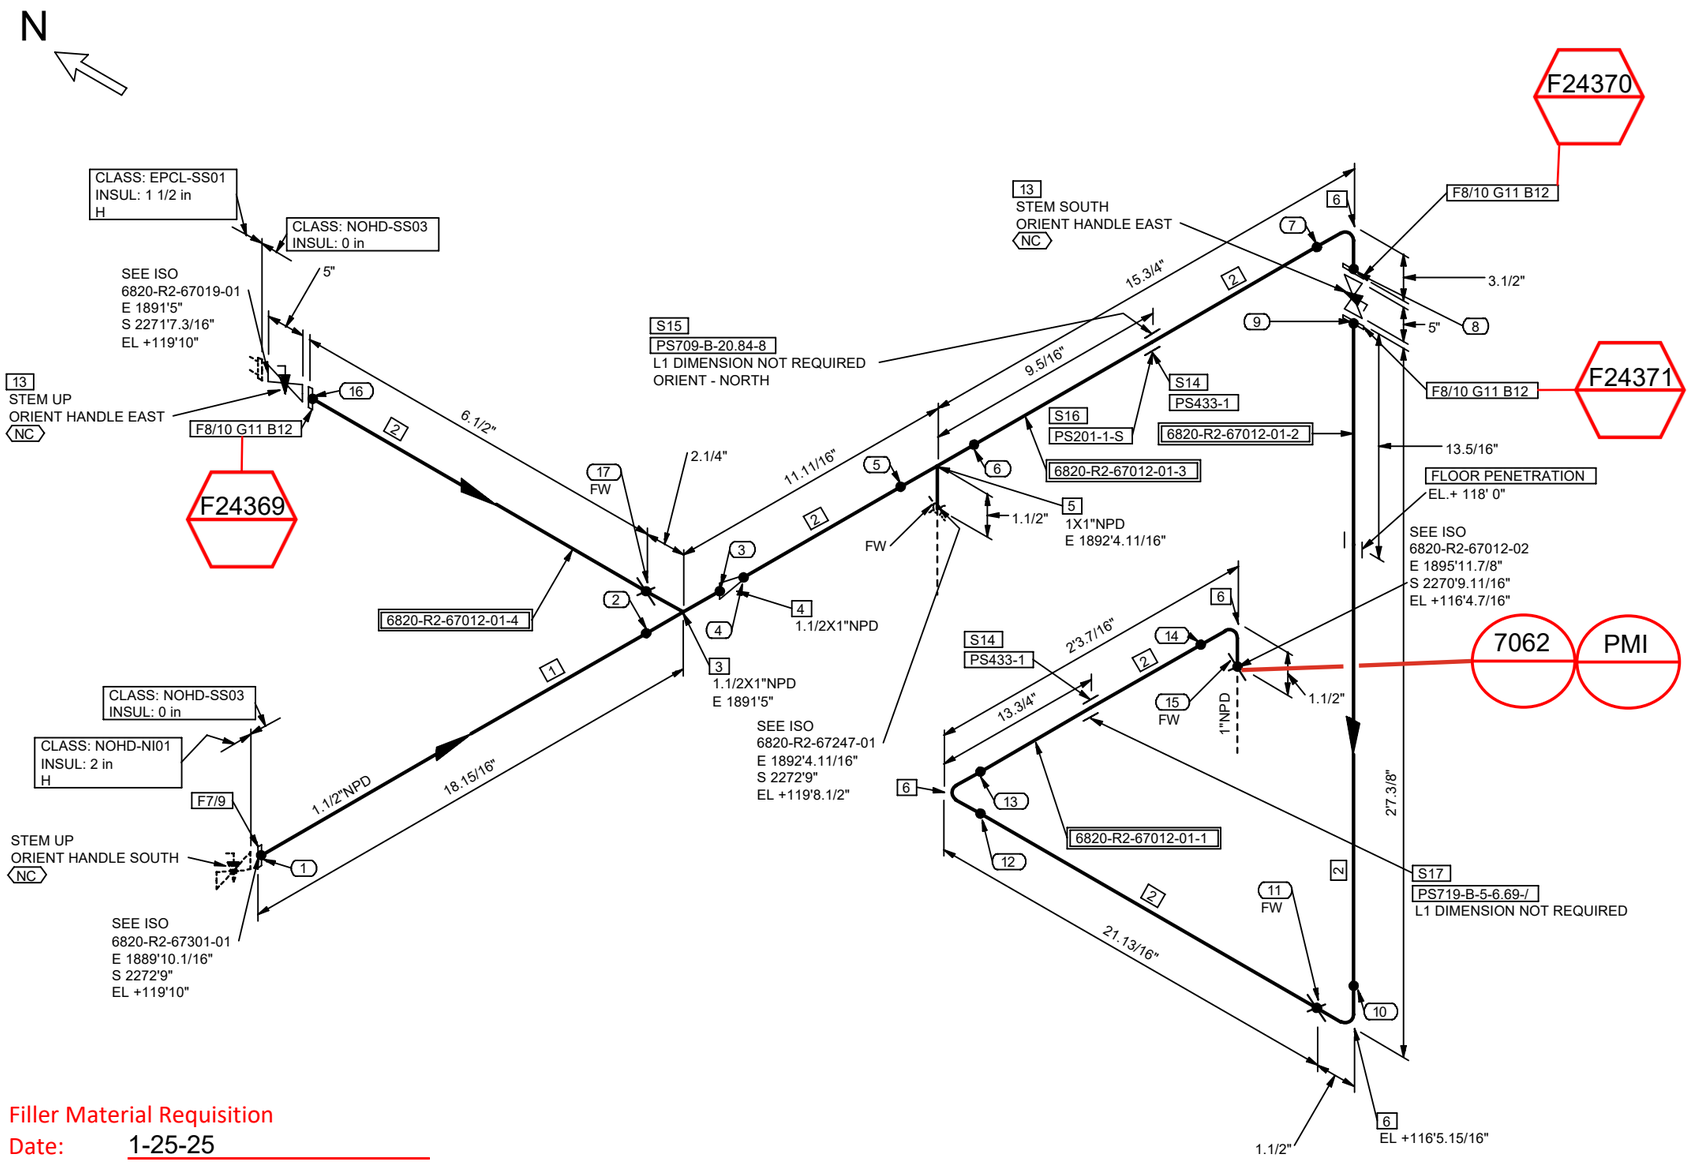

Filler Material Requisition

Date: 1-25-25

Line Class: NOHD-SS03

WPS: 802

Electrode: ER308L

Signature: Glenn Sumrall Jr

COORDINATE SYSTEM : PLANTCOORDINATES

SHOP MATERIALS

NO	NPD	DESCRIPTION	IDENT	QTY
1	1.1/2	Pipes, Seamless, ASME B36.19/B36.10, ASTM A312 Gr.TP304L, BE, -, -, S-40S	C275NB9W	1.3 '
2	1	Pipes, Seamless, ASME B36.19/B36.10, ASTM A312 Gr.TP304L, BE, -, -, S-40S	C275NB8F	7.8 '
3	1.1/2X1	Red Te, Seamless, ASME B16.9, ASTM A403 Gr.WP304L, BW Ends, -,Annealed, S-40S	C80RG9AL	1
4	1.1/2X1	Concentric swage, MSS SP-95, ASTM A403 Gr.WP304L,BE,-, Annealed, S-40S	C80RGE00	1
5	1X1	Eq Te, Seamless, ASME B16.9, ASTM A403 Gr.WP304L, BW Ends, -,Annealed, S-40S	C80RGBVA	1
6	1	90° Elb LR, Seamless, ASME B16.9, ASTM A403 Gr.WP304L, BW Ends, -,Annealed, S-40S	C80RG22P	4
7	1.1/2	LJ Flg, ASME B16.5, ASTM A105 Galv. as per ASTM A153, 150 Lbs, FF, -,	C26WFFF9	1
8	1	LJ Flg, ASME B16.5, ASTM A105 Galv. as per ASTM A153, 150 Lbs, FF, -,	C26WFFF7	3

MISCELLANEOUS COMPONENTS

NO	NPD	DESCRIPTION	IDENT	QTY
9	1.1/2	Stub SP, Seamless, ASME B16.9, ASTM A403 Gr.WP304L, BW Ends, -,Annealed, x S-40S	C8A5BKUC	1
10	1	Stub SP, Seamless, ASME B16.9, ASTM A403 Gr.WP304L, BW Ends, -,Annealed, x S-40S	C8A5BKT4	3

OTHER THAN SHOP MATERIALS

NO	NPD	DESCRIPTION	IDENT	QTY
11	1	NM Flat Gk, Barium Sulfate filled PTFE, 150 Lbs, RF as per ASME B16.5, -, Thk=1/8in, -,	C6S4K87F	3
12	1/2	SBlt 2 HHx N, A193 Gr.B7/A194 Gr.2H, -, Xylan PTFE Coated, - 2.75 in. Length	C6S4K87U	12
13	1	Plug Flg,SP, Tapered Plug, Non Lubricated, API 599, ASTM A351 Gr.CF8M, 150 Lbs, RF, Ends as per ASME B16.5, -, LO,-, -, Valve Tag: PL-0548	C76KHSRR	2

PIPE SUPPORTS

14	1	PS433-1	PS433	2
15	1	PS709-B-20.84-8	PS709	1
16	1	PS201-1-S	PS201	1
17	1	PS719-B-5-6.69-/	PS719	1

PIECE MARKS

6820-R2-67012-01-1 6820-R2-67012-01-2 6820-R2-67012-01-3
6820-R2-67012-01-4

Turner Industries Group, LLC
Received
January 24,2025
DOCUMENT CONTROL

NOTES:

1. FOR LINE PRESSURES, TEMPERATURES, INSULATION TYPE AND THICKNESS, ETC. REFER TO LATEST REVISION OF LDT.
2. FOR STANDARD PIPE SUPPORT DETAILS SEE PROJECT STANDARD.
3. FIELD SHIM TO SUIT UNLESS OTHERWISE NOTED.
4. FOR PWHT REQUIREMENTS REFER TO LINE CLASS SPECIFICATION.
5. ALL THREADED PIPE LINE SYSTEMS, FIELD SHALL VERIFY DIMENSION PRIOR TO ERECTION.
6. FFW DESIGNATION AT WELDS INDICATES FIELD FIT WELD, WHERE PIPE FABRICATOR IS TO ADD 9 INCH OF PIPE TO THE ISOMETRIC DIMENSION TO ENABLE THE FIELD TO CUT TO FIT AT SITE.
7. REFER TO 202998C-000-W1-1300-0001 FOR FRP AND DUAL-LAM FABRICATION.

T.EN TECHNIP ENERGIES

information contained in this document is the work product of one or more legal entities of Technip Energies N.V. and embodies confidential and proprietary information of the applicable entity and/or its client.use of this information is restricted in accordance with conditions specified by the contract.Technip Energies N.V. and its affiliates disclaim any and all liabilities for any changes or modifications to this document which are made by any person other than the entity that issued the document under the applicable client contract.

THIS DOCUMENT IS UNCONTROLLED WHEN REPRODUCED

REV	DATE	BY	DESCRIPTION	CHKD	MTO	STRESS	APRVD
0	2025-01-17	RVA	ISSUED FOR CONSTRUCTION	SAD	KJK	SMR	GR

SERVICE:	VAPOR/LIQUID:	INSUL TYPE:	INSUL THK:	SHOP:	FIELD:	PAINT CODE:	MODULE:
R2	L	Per LDT	Per LDT	Y	Y	Per LDT	-

OXY

OxyChem Redstone Battleground PROJECT

P&ID: 202998C-001-PID-0021-0320

UNIT#:	EWP AREA:	SPEC:	STRESS CALC #:
6800	6820	NOHD-SS03	-

LINE No. 1.5"-R2-67012-NOHD-SS03-N

DRAWING NUMBER: 6820-R2-67012-01

REV: 0

17 JAN 2025 06:46