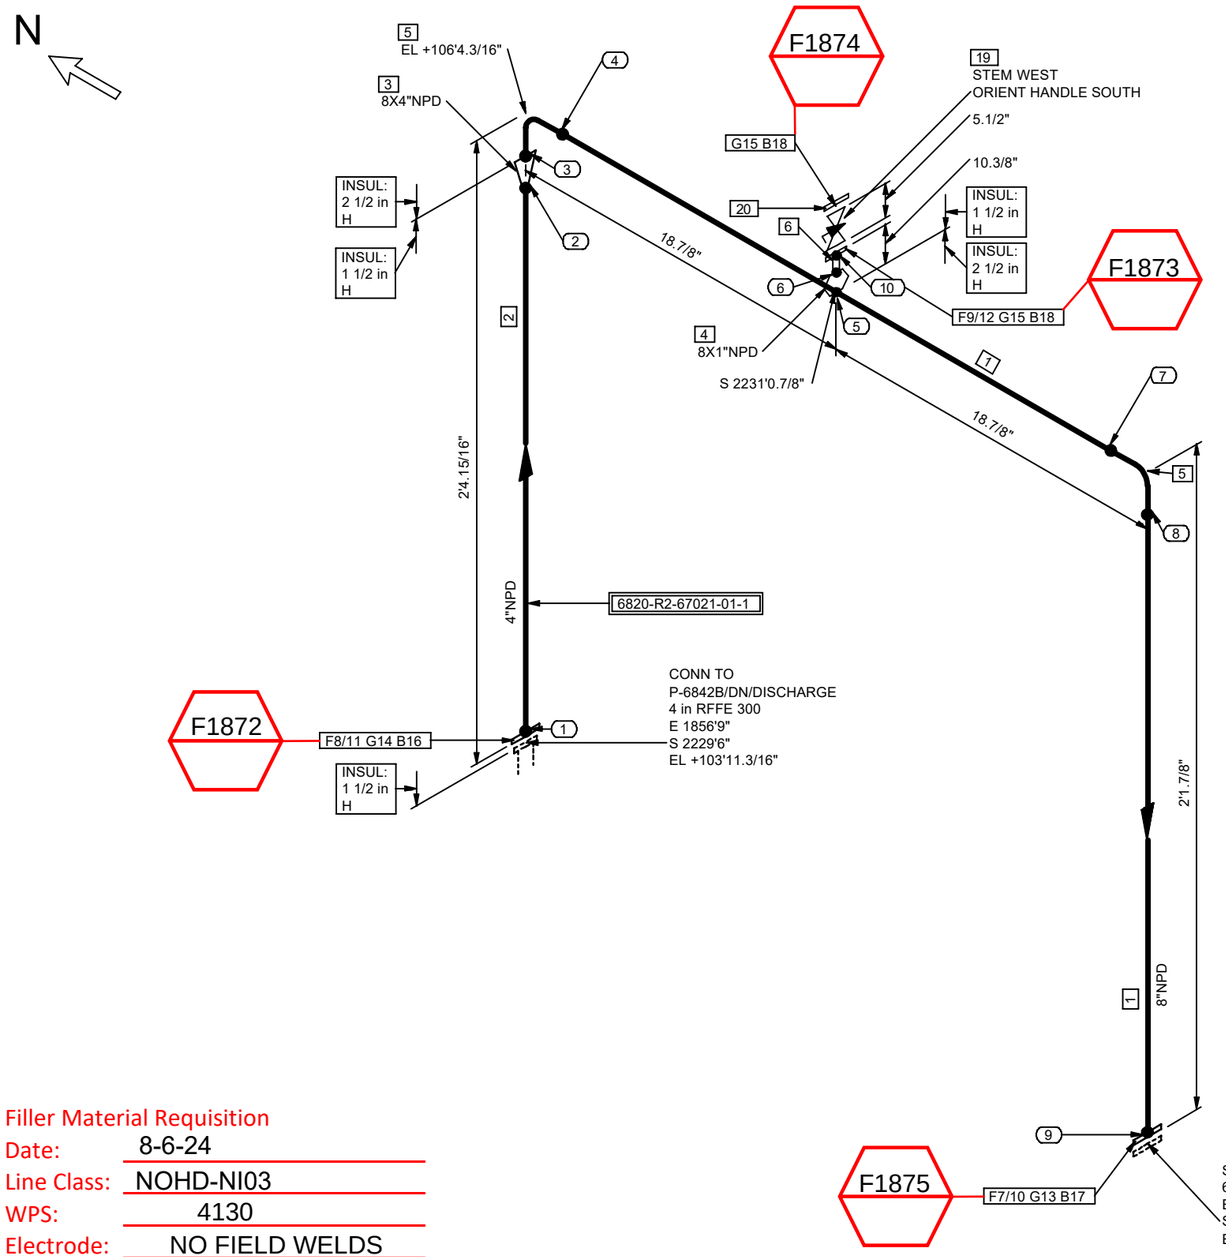

Filler Material Requisition

Date: 8-6-24

Line Class: NOHD-NI03

WPS: 4130

Electrode: NO FIELD WELDS

Signature: Pedro Morin

COORDINATE SYSTEM : PLANTCOORDINATES

SHOP MATERIALS

NO	NPD	DESCRIPTION	IDENT	QTY
1	8	Pipes, EFW, ASME B36.19/B36.10, ASTM B725 UNS N02200 annealed, BE, -, -, S-10S	C7ZWWML7	2.0 '
2	4	Pipes, Seamless, ASME B36.19/B36.10, ASTM B161 UNS N02200, BE, -, -, S-10S	C7ZWWMYB	0.5 '
3	8X4	Conc Reducer, Seamless, ASME B16.9, ASTM B366 Gr.WPN, BW Ends, -,Annealed, S-10S	C7ZWYUD2	1
4	8X1	Weldolet, MSS SP-97, ASTM B366 Gr.WPN, BW Ends, Annealed, S-10S	C7ZX02D9	1
5	8	90° Elb LR, Seamless, ASME B16.9, ASTM B366 Gr.WPN, BW Ends, -,Annealed, S-10S	C7ZWX04P	2
6	1	Nipple, ASTM B161 UNS N02200, BE, L = 3in, -, S-10S	C7ZWWN3N	1
7	8	LJ Flg, ASME B16.5, ASTM A182 Gr.F316/316L, 150 Lbs, FF, -,	C15RCMM6	1
8	4	LJ Flg, ASME B16.5, ASTM A182 Gr.F316/316L, 300 Lbs, FF, -,	C421W6HZ	1
9	1	LJ Flg, ASME B16.5, ASTM A182 Gr.F316/316L, 150 Lbs, FF, -,	C15RCMLV	1

MISCELLANEOUS COMPONENTS

NO	NPD	DESCRIPTION	IDENT	QTY
10	8	Stub SP, Seamless, ASME B16.9, ASTM B366 Gr.WPN, BW Ends, -,-, x S-10S	C98MYDV5	1
11	4	Stub SP, Seamless, ASME B16.9, ASTM B366 Gr.WPN, BW Ends, -,-, x S-10S	C98MYDRV	1
12	1	Stub SP, Seamless, ASME B16.9, ASTM B366 Gr.WPN, BW Ends, -,-, x S-10S	C98MYD7N	1

OTHER THAN SHOP MATERIALS

NO	NPD	DESCRIPTION	IDENT	QTY
13	8	NM Flat Gk, Barium Sulfate filled PTFE, 150 Lbs, RF as per ASME B16.5, -, Thk=1/8in, -,	C6SBWZF4	1
14	4	NM Flat Gk, Barium Sulfate filled PTFE, 300 Lbs, RF as per ASME B16.5, -, Thk=1/8in, -,	C6S4K87C	1
15	1	NM Flat Gk, Barium Sulfate filled PTFE, 150 Lbs, RF as per ASME B16.5, -, Thk=1/8in, -,	C6S4K87F	2
16	3/4	SBlt 2 HHx N, A193 Gr.B7/A194 Gr.2H, -, Xylan PTFE Coated, - 4 in. Length	C6S4K8BB	8
17	3/4	SBlt 2 HHx N, A193 Gr.B7/A194 Gr.2H, -, Xylan PTFE Coated, - 5 in. Length	C6S4K8BF	8
18	1/2	SBlt 2 HHx N, A193 Gr.B7/A194 Gr.2H, -, Xylan PTFE Coated, - 2.75 in. Length	C6S4K87U	8
19	1	Plug Flg,SP, Inverted Tapered Plug, Non Lubricated, API 599, ASTM B564 UNS N02200, 150 Lbs, RF, Ends as per ASME B16.5, -, LO,-, -, Valve Tag: PL-1194	C99ZZ9D2	1
20	1	Bld Flg, ASME B16.5, ASTM B564 UNS N02200, 150 Lbs, RF, -,	C7T63YAU	1

PIECE MARKS

6820-R2-67021-01-1

Turner Industries Group, LLC
Received
August 6,2024
DOCUMENT CONTROL

NOTES:

1. FOR LINE PRESSURES, TEMPERATURES, INSULATION TYPE AND THICKNESS, ETC. REFER TO LATEST REVISION OF LDT.
2. FOR STANDARD PIPE SUPPORT DETAILS SEE PROJECT STANDARD.
3. FIELD SHIM TO SUIT UNLESS OTHERWISE NOTED.
4. FOR PWHT REQUIREMENTS REFER TO LINE CLASS SPECIFICATION.
5. ALL THREADED PIPE LINE SYSTEMS, FIELD SHALL VERIFY DIMENSION PRIOR TO ERECTION.
6. FFW DESIGNATION AT WELDS INDICATES FIELD FIT WELD, WHERE PIPE FABRICATOR IS TO ADD 9 INCH OF PIPE TO THE ISOMETRIC DIMENSION TO ENABLE THE FIELD TO CUT TO FIT AT SITE.
7. REFER TO 202998C-000-W1-1300-0001 FOR FRP AND DUAL-LAM FABRICATION.

TECHNIP ENERGIES

information contained in this document is the work product of one or more legal entities of Technip Energies N.V. and embodies confidential and proprietary information of the applicable entity and/or its client.use of this information is restricted in accordance with conditions specified by the contract.Technip Energies N.V. and its affiliates disclaim any and all liabilities for any changes or modifications to this document which are made by any person other than the entity that issued the document under the applicable client contract.

THIS DOCUMENT IS UNCONTROLLED WHEN REPRODUCED

REV	DATE	BY	DESCRIPTION	CHKD	MTO	STRESS	APRVD
0	2024-08-02	RVA	ISSUED FOR CONSTRUCTION	SAD	KJK	BRD	GR

SERVICE:	VAPOR/LIQUID:	INSUL TYPE:	INSUL THK:	SHOP:	FIELD:	PAINT CODE:	MODULE:
R2	L	Per LDT	Per LDT	Y	Y	Per LDT	-

OXY

OxyChem Redstone Battleground
PROJECT

P&ID: 202998C-001-PID-0021-0322

UNIT#:	EWP AREA:	SPEC:	STRESS CALC #:
6800	6820	NOHD-NI03	CN-0388

LINE No. 8"-R2-67021-NOHD-NI03-H

DRAWING NUMBER: 6820-R2-67021-01

REV.: 0