



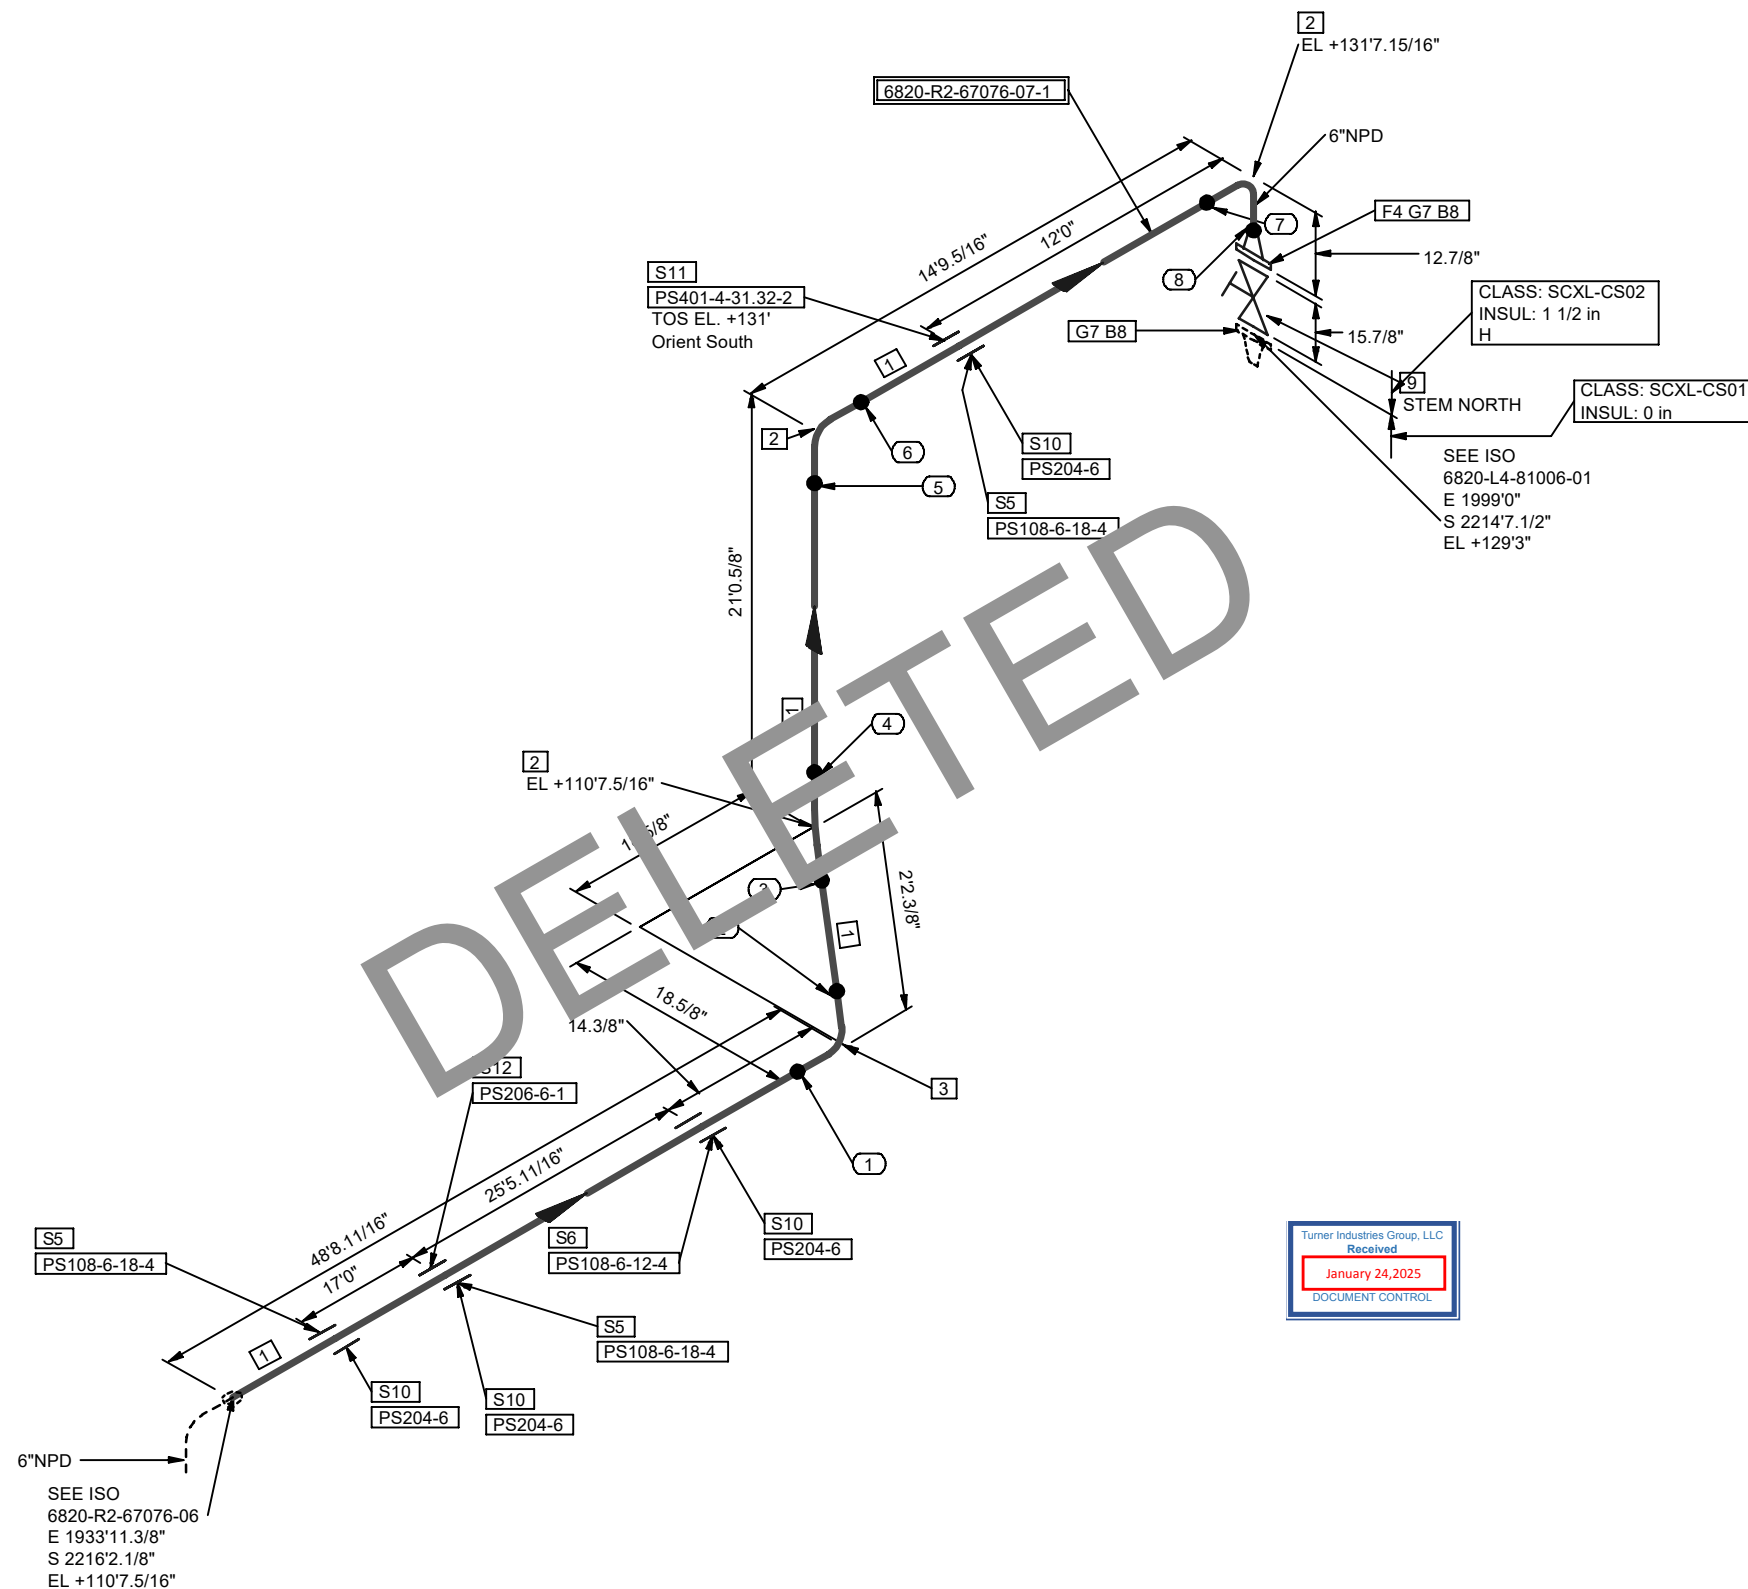

NOTES:

1. FOR LINE PRESSURES, TEMPERATURES, INSULATION TYPE AND THICKNESS, ETC. REFER TO LATEST REVISION OF LDT.
2. FOR STANDARD PIPE SUPPORT DETAILS SEE PROJECT STANDARD.
3. FIELD SHIM TO SUIT UNLESS OTHERWISE NOTED.
4. FOR PWHT REQUIREMENTS REFER TO LINE CLASS SPECIFICATION.
5. ALL THREADED PIPE LINE SYSTEMS, FIELD SHALL VERIFY DIMENSION PRIOR TO ERECTION.
6. FFW DESIGNATION AT WELDS INDICATES FIELD FIT WELD, WHERE PIPE FABRICATOR IS TO ADD 9 INCH OF PIPE TO THE ISOMETRIC DIMENSION TO ENABLE THE FIELD TO CUT TO FIT AT SITE.
7. REFER TO 202998C-000-W1-1300-0001 FOR FRP AND DUAL-LAM FABRICATION.



1	2025-01-17	RVA	ISSUED FOR DELETION	SAD	KJK	SMR	GR
0	2024-07-26	RVA	ISSUED FOR CONSTRUCTION	SAD	KJK	BRD	GR
REV	DATE	BY	DESCRIPTION	CHKD	MTD	STRESS	APRV

OTHER THAN SHOP MATERIALS				
NO	NPD	DESCRIPTION	IDENT	QTY
7	6	NM Flat Gk, Barium Sulfate filled PTFE, 300 Lbs, RF as per ASME B16.5, Full Face, Thk=1/8in, -,	C7CX7CST	2
8	3/4	SBlT 2 HHx N, A193 Gr.B7/A194 Gr.2H, -, Xylan PTFE Coated, - 5 in. Length	C6S4K8BF	24
9	6	Gat Flg, -, API 600, ASTM A216 Gr.WCB,300 Lbs, RF, Ends as per ASME B16.5, HO,-, Valve Tag: GA-1192	C99ZZ9EJ	1
<u>PIPE SUPPORTS</u>				
10	6	PS204-6	PS204	4
11	6	PS401-4-31.32-2	PS401	1
12	6	PS206-6-1	PS206	1

SERVICE: R2	VAPOR/LIQUID: L	INSUL TYPE: Per LDT	INSUL THK: Per LDT	SHOP: Y	FIELD: Y	PAINT CODE: Per LDT	MODULE: -
				P&ID: 202998C-001-PID-0021-0325			
				UNIT#: 6800	LEW AREA: 6820	SPEC: SCXL-CS02	STRESS CALC #: CN-0394
				LINE No. 6"-R2-67076-SCXL-CS02-H			
				DRAWING NUMBER 6820-R2-67076-07			
OxyChem Redstone Battleground PROJECT							