


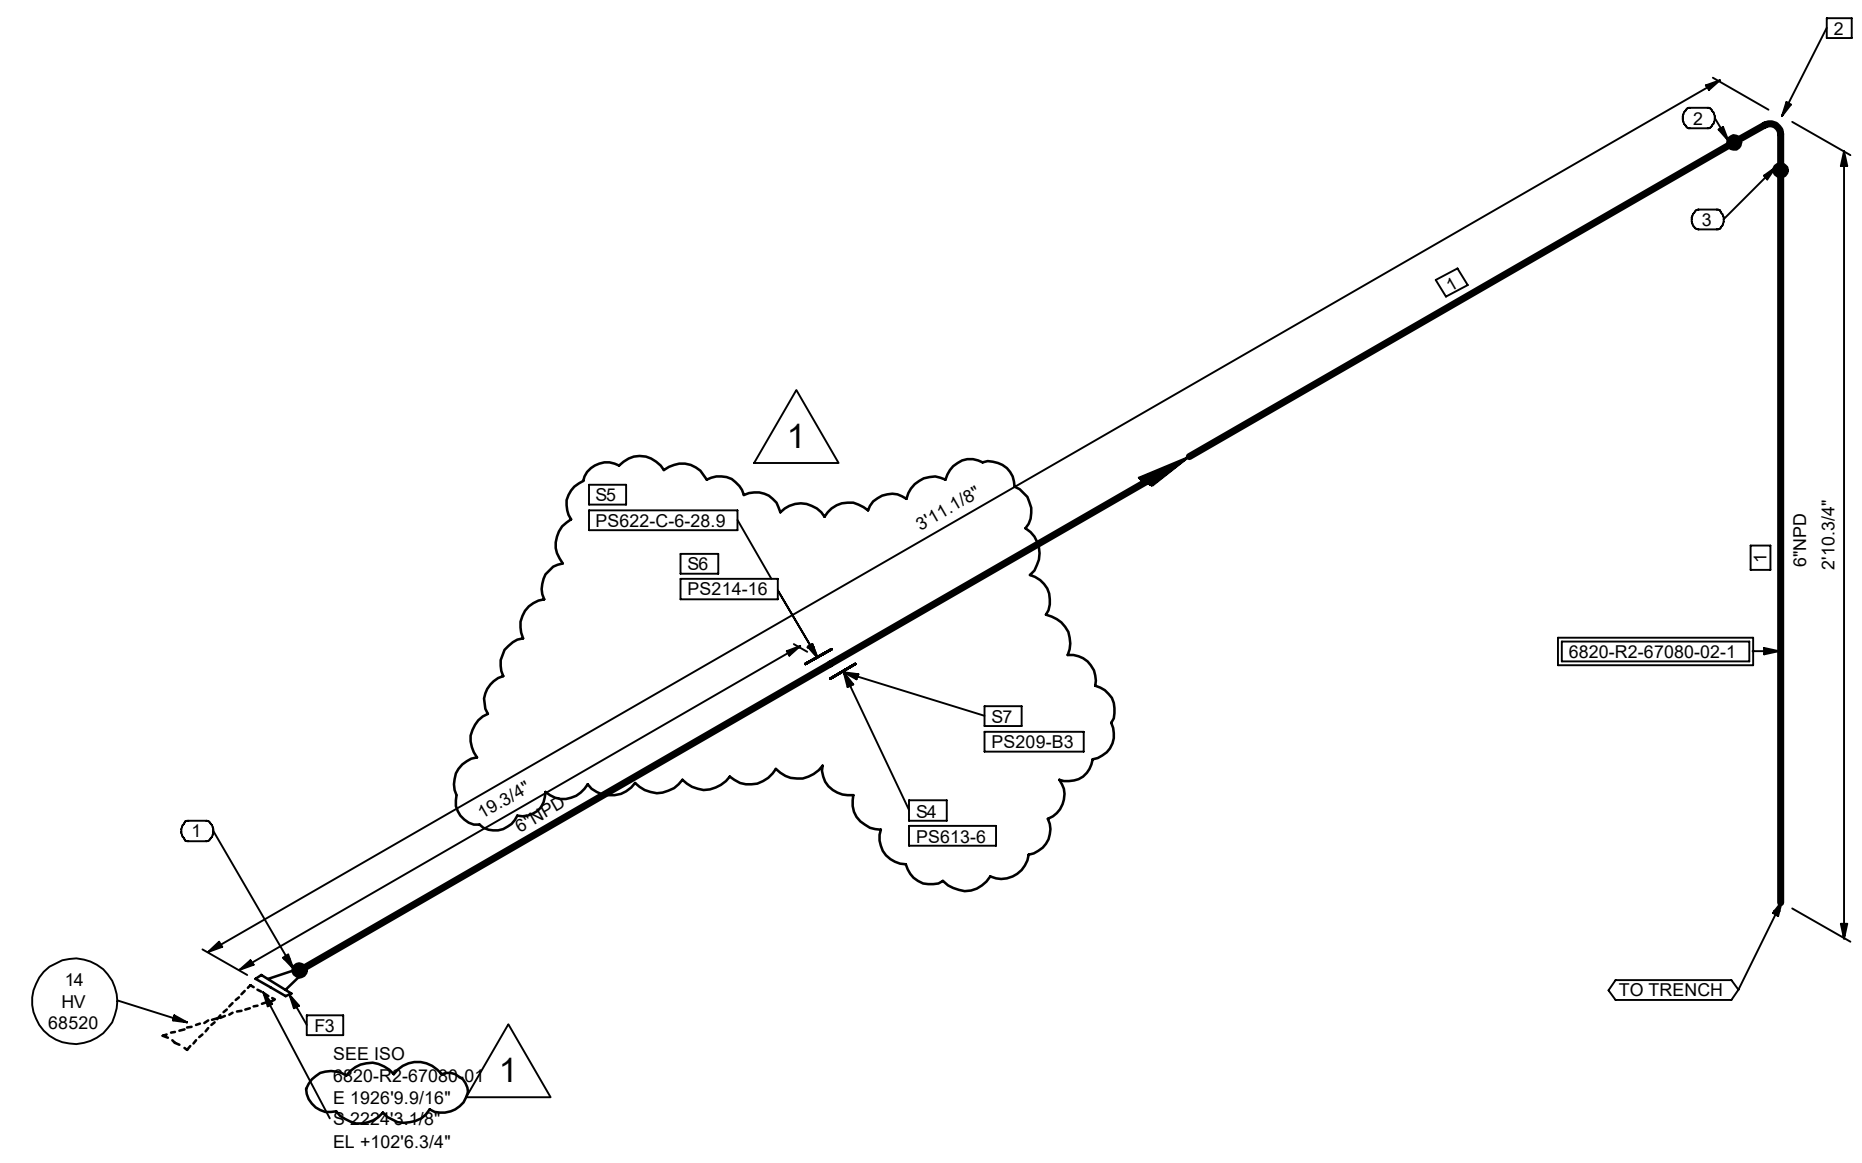

NOTES:

FOR LINE PRESSURES, TEMPERATURES, INSULATION TYPE AND THICKNESS, ETC.
REFER TO LATEST REVISION OF LDT.

FOR STANDARD PIPE SUPPORT DETAILS SEE PROJECT STANDARD.


FIELD SHIM TO SUIT UNLESS OTHERWISE NOTED.

FOR PWHT REQUIREMENTS REFER TO LINE CLASS SPECIFICATION.

ALL THREADED PIPE LINE SYSTEMS, FIELD SHALL VERIFY DIMENSION PRIOR TO ERECTION.

FFW DESIGNATION AT WELDS INDICATES FIELD FIT WELD, WHERE PIPE FABRICATOR IS TO ADD 9 INCH OF PIPE TO THE ISOMETRIC DIMENSION TO ENABLE THE FIELD TO CUT TO FIT AT SITE.

REFER TO 202998C-000-W1-1300-0001 FOR FRP AND DUAL-LAM FABRICATION.



1	2025-01-17	RVA	ISSUED FOR CONSTRUCTION	SAD	KJK	SMR	GR
0	2024-09-14	RVA	ISSUED FOR CONSTRUCTION	SAD	KJK	SMR	GR
REV	DATE	BY	DESCRIPTION	CHKD	MTD	STRESS	APRVD

Turner Industries Group, LLC
Received
January 24, 2025
DOCUMENT CONTROL

SHOP MATERIALS

Nº	NPD	DESCRIPTION	IDENT	QTY
1	6	Pipes, Seamless, ASME B36.10, ASTM A106 Gr.B, BE, -, -, S-STD	CPP00336	5.0'
2	6	90° Elb LR, Seamless, ASME B16.9, ASTM A234 Gr.WPB, BW Ends, -, -, S-STD	CDB66GNP	1
3	6	WN Flg, ASME B16.5, ASTM A105N, 300 Lbs, RF/BW End, -, -, S-STD	CFG6WKU7	1
PIPE SUPPORTS				
4	6	PS613-6	PS613	1
5	6	PS622-C-6-28.9	PS622	1
OTHER THAN SHOP MATERIALS				
Nº	NPD	DESCRIPTION	IDENT	QTY
PIPE SUPPORTS				
6	6	PS214-16	PS214	1
7	6	PS209-B3	PS209	1
PIECE MARKS				
6820-R2-67080-02-1				

Turner Industries Group, LLC
Received
January 24, 2025
DOCUMENT CONTROL

SERVICE: R2	VAPOR/LIQUID: L	INSUL TYPE: Per LDT	INSUL THK: Per LDT	SHOP: Y	FIELD: Y	PAINT CODE: Per LDT	MODULE: -
----------------	--------------------	------------------------	-----------------------	------------	-------------	------------------------	--------------

OxyChem Redstone Battleground PROJECT

P&ID:
202998C-001-PID-0021-0325

UNIT#: 6800

EWP AREA: 6820

SPEC: SCXL-CS02

STRESS CALC #:
CN-0394/CN-0695

LINE No.
6"-R2-67080-SCXL-CS02-P

DRAWING NUMBER
6820-R2-67080-02

REV.
1