




SEE ISO
6820-R2-67081-03
E 1924'1.3/16"
S 2217'7.5/8"
EL +114'3.7/8"

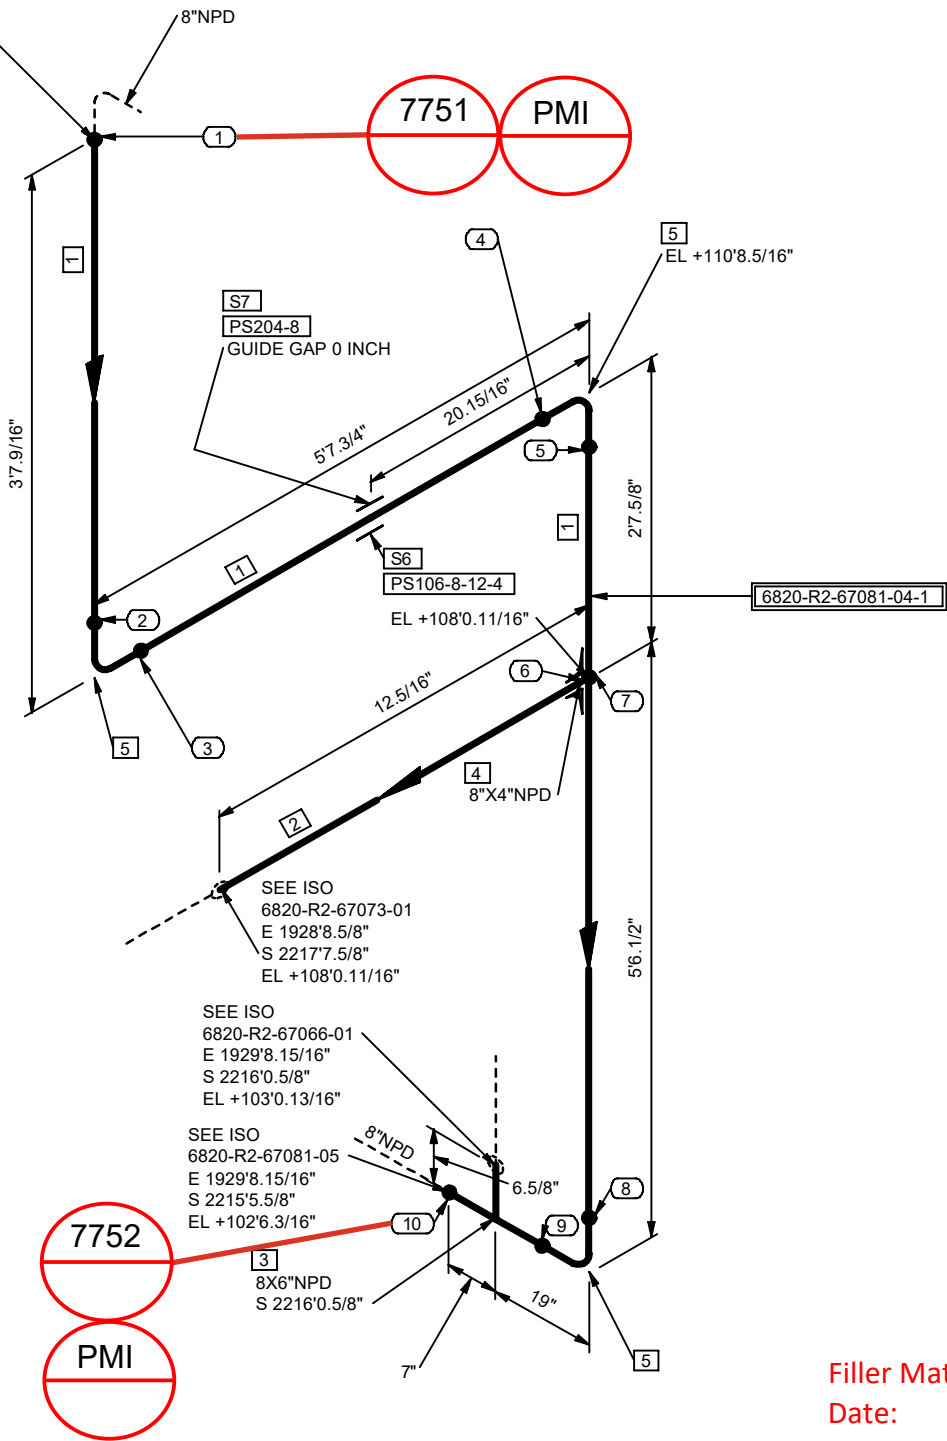

Filler Material Requisition

Date: 12-3-24
Line Class: NOHD-SS01
WPS: 802
Electrode: ER316L
Signature: *Glenn Sumrall Jr*

SHOP MATERIALS

NO	NPD	DESCRIPTION	IDENT	QTY
1	8	Pipes, Seamless, ASME B36.19/B36.10, ASTM A312 Gr.TP316L, BE, -, -, S-10S	CPPFEGLE	12.5 '
2	4	Pipes, Seamless, ASME B36.19/B36.10, ASTM A312 Gr.TP316L, BE, -, -, S-10S	CPP5F90U	0.8 '
3	8X6	Red Te, Seamless, ASME B16.9, ASTM A403 Gr.WP316L, BW Ends, -,Annealed, S-10S	C6SDNT84	1
4	8X4	Reinforcing Pad 90 Degree, Prj Std, ASTM A312 Gr.TP316L, BE, -, S-10S RPad Width: 2 in	CMBWKW1	1
5	8	90° Elb LR, Seamless, ASME B16.9, ASTM A403 Gr.WP316L, BW Ends, -,Annealed, S-10S	C6SDP2WP	3

PIPE SUPPORTS

6	8	PS106-8-12-4	PS106	1
---	---	--------------	-------	---

OTHER THAN SHOP MATERIALS

NO	NPD	DESCRIPTION	IDENT	QTY
7	8	PS204-8	PS204	1

PIECE MARKS

6820-R2-67081-04-1

COORDINATE SYSTEM : PLANTCOORDINATES

NOTES:

- FOR LINE PRESSURES, TEMPERATURES, INSULATION TYPE AND THICKNESS, ETC. REFER TO LATEST REVISION OF LDT.
- FOR STANDARD PIPE SUPPORT DETAILS SEE PROJECT STANDARD.
- FIELD SHIM TO SUIT UNLESS OTHERWISE NOTED.
- FOR PWHT REQUIREMENTS REFER TO LINE CLASS SPECIFICATION.
- ALL THREADED PIPE LINE SYSTEMS, FIELD SHALL VERIFY DIMENSION PRIOR TO ERECTION.
- FFW DESIGNATION AT WELDS INDICATES FIELD FIT WELD, WHERE PIPE FABRICATOR IS TO ADD 9 INCH OF PIPE TO THE ISOMETRIC DIMENSION TO ENABLE THE FIELD TO CUT TO FIT AT SITE.
- REFER TO 202998C-000-W1-1300-0001 FOR FRP AND DUAL-LAM FABRICATION.



Information contained in this document is the work product of one or more legal entities of Technip Energies N.V. and embodies confidential and proprietary information of the applicable entity and/or its client use of this information is restricted in accordance with conditions specified by the contract. Technip Energies N.V. and its affiliates disclaim any and all liabilities for any changes or modifications to this document which are made by any person other than the entity that issued the document under the applicable client contract.

THIS DOCUMENT IS UNCONTROLLED WHEN REPRODUCED

0	2024-11-22	RVA	ISSUED FOR CONSTRUCTION	SAD	KJK	SMR	GR		
REV	DATE	BY	DESCRIPTION	CHKD	MTO	STRESS	APRVD		

SERVICE:	VAPOR/LIQUID:	INSUL TYPE:	INSUL THK:	SHOP:	FIELD:	PAINT CODE:	MODULE:	
R2	L	Per LDT	Per LDT	Y	Y	Per LDT	-	
				P&ID:				
				202998C-001-PID-0021-0326				
				UNIT#:	EWIP AREA:	SPEC:	STRESS CALC #:	
				6800	6820	NOHD-SS01	CN-0393	
				LINE No:				
OxyChem Redstone Battleground PROJECT				8"-R2-67081-NOHD-SS01-H				
				DRAWING NUMBER				
				6820-R2-67081-04				
				REV:		0		

