



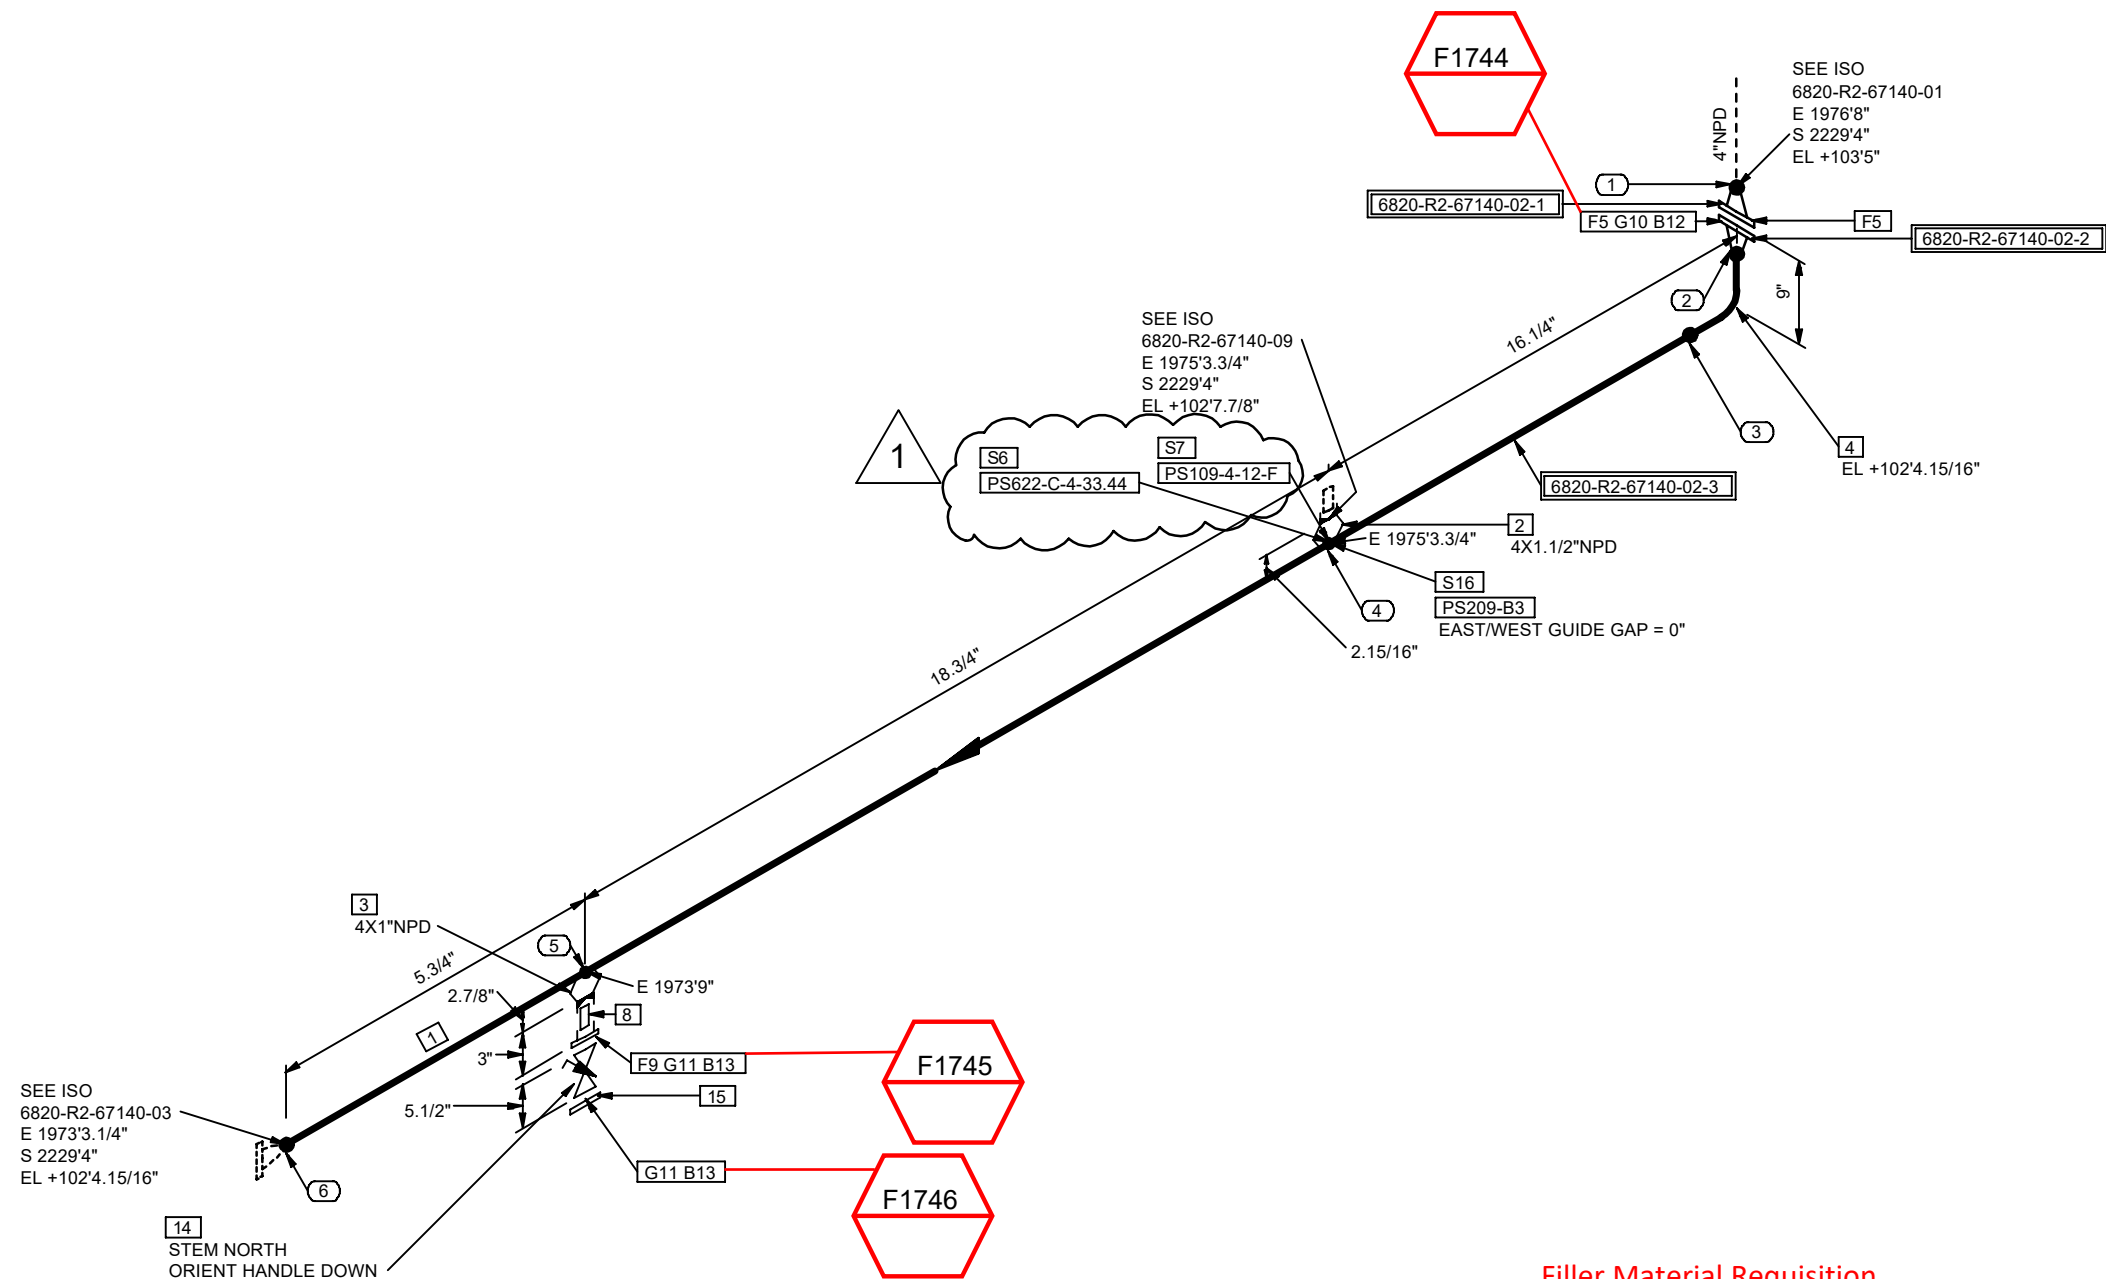

NOTES:

1. FOR LINE PRESSURES, TEMPERATURES, INSULATION TYPE AND THICKNESS, ETC. REFER TO LATEST REVISION OF LDT.
2. FOR STANDARD PIPE SUPPORT DETAILS SEE PROJECT STANDARD.
3. FIELD SHIM TO SUIT UNLESS OTHERWISE NOTED.
4. FOR PWHT REQUIREMENTS REFER TO LINE CLASS SPECIFICATION.
5. ALL THREADED PIPE LINE SYSTEMS, FIELD SHALL VERIFY DIMENSION PRIOR TO ERECTION.
6. FFW DESIGNATION AT WELDS INDICATES FIELD FIT WELD, WHERE PIPE FABRICATOR IS TO ADD 9 INCH OF PIPE TO THE ISOMETRIC DIMENSION TO ENABLE THE FIELD TO CUT TO FIT AT SITE.
7. REFER TO 202998C-000-W1-1300-0001 FOR FRP AND DUAL-LAM FABRICATION.



1	2025-01-17	RVA	ISSUED FOR CONSTRUCTION	SAD	KJK	BRD	GR
0	2024-08-02	RVA	ISSUED FOR CONSTRUCTION	SAD	KJK	BRD	GR
REV	DATE	BY	DESCRIPTION	CHKD	MTO	STRESS	APRVD

Date: 1-25-25

Line Class: CTWL-CS01

WPS: 10245

Electrode: ER70S-2

Signature: *Glenn Summell Jr.*

OTHER THAN SHOP MATERIALS				
NO	NPD	DESCRIPTION	IDENT	QTY
8	1	Nipple, ASTM A106 Gr.B Galv. as per ASTM A153, NPTM Ends, L = 3in, -, S-XS	C41B2D94	1
9	1	THD Flg, ASME B16.5, ASTM A105N Galv. as per ASTM A153, 150 Lbs, RF/NPTF End, -,	C1DR2JM	1
10	4	NM Flat Gk, Aramid Fiber Reinforced SBR, 150 Lbs, RF as per ASME B16.5, Full Face, Thk=1/8in, -,	C76KHSS7	1
11	1	NM Flat Gk, Aramid Fiber Reinforced SBR, 150 Lbs, RF as per ASME B16.5, Full Face, Thk=1/8in, -,	C76KHSRZ	2
12	5/8	SBlT 2 HHx N, A193 Gr.B7/A194 Gr.2H, -, Xylan PTFE Coated, - 3.75 in. Length	C6S4K88S	8
13	1/2	SBlT 2 HHx N, A193 Gr.B7/A194 Gr.2H, -, Xylan PTFE Coated, - 2.75 in. Length	C6S4K87U	8
14	1	Plug Flg,SP, Inverted Tapered Plug, Non Lubricated, API 599, ASTM A395 Gr.60-40-18, 150 Lbs, RF, Ends as per ASME B16.5, -, LO,-, -, Valve Tag: PL-0546	C76RJXHV	1
15	1	Bld Flg, ASME B16.5, ASTM A105N Galv. as per ASTM A153, 150 Lbs, RF, -,	C1DR2JV	1

16	4	PS209-B3	PS209	1
----	---	----------	-------	---

6820-R2-67140-02-1 6820-R2-67140-02-2 6820-R2-67140-02-3

