


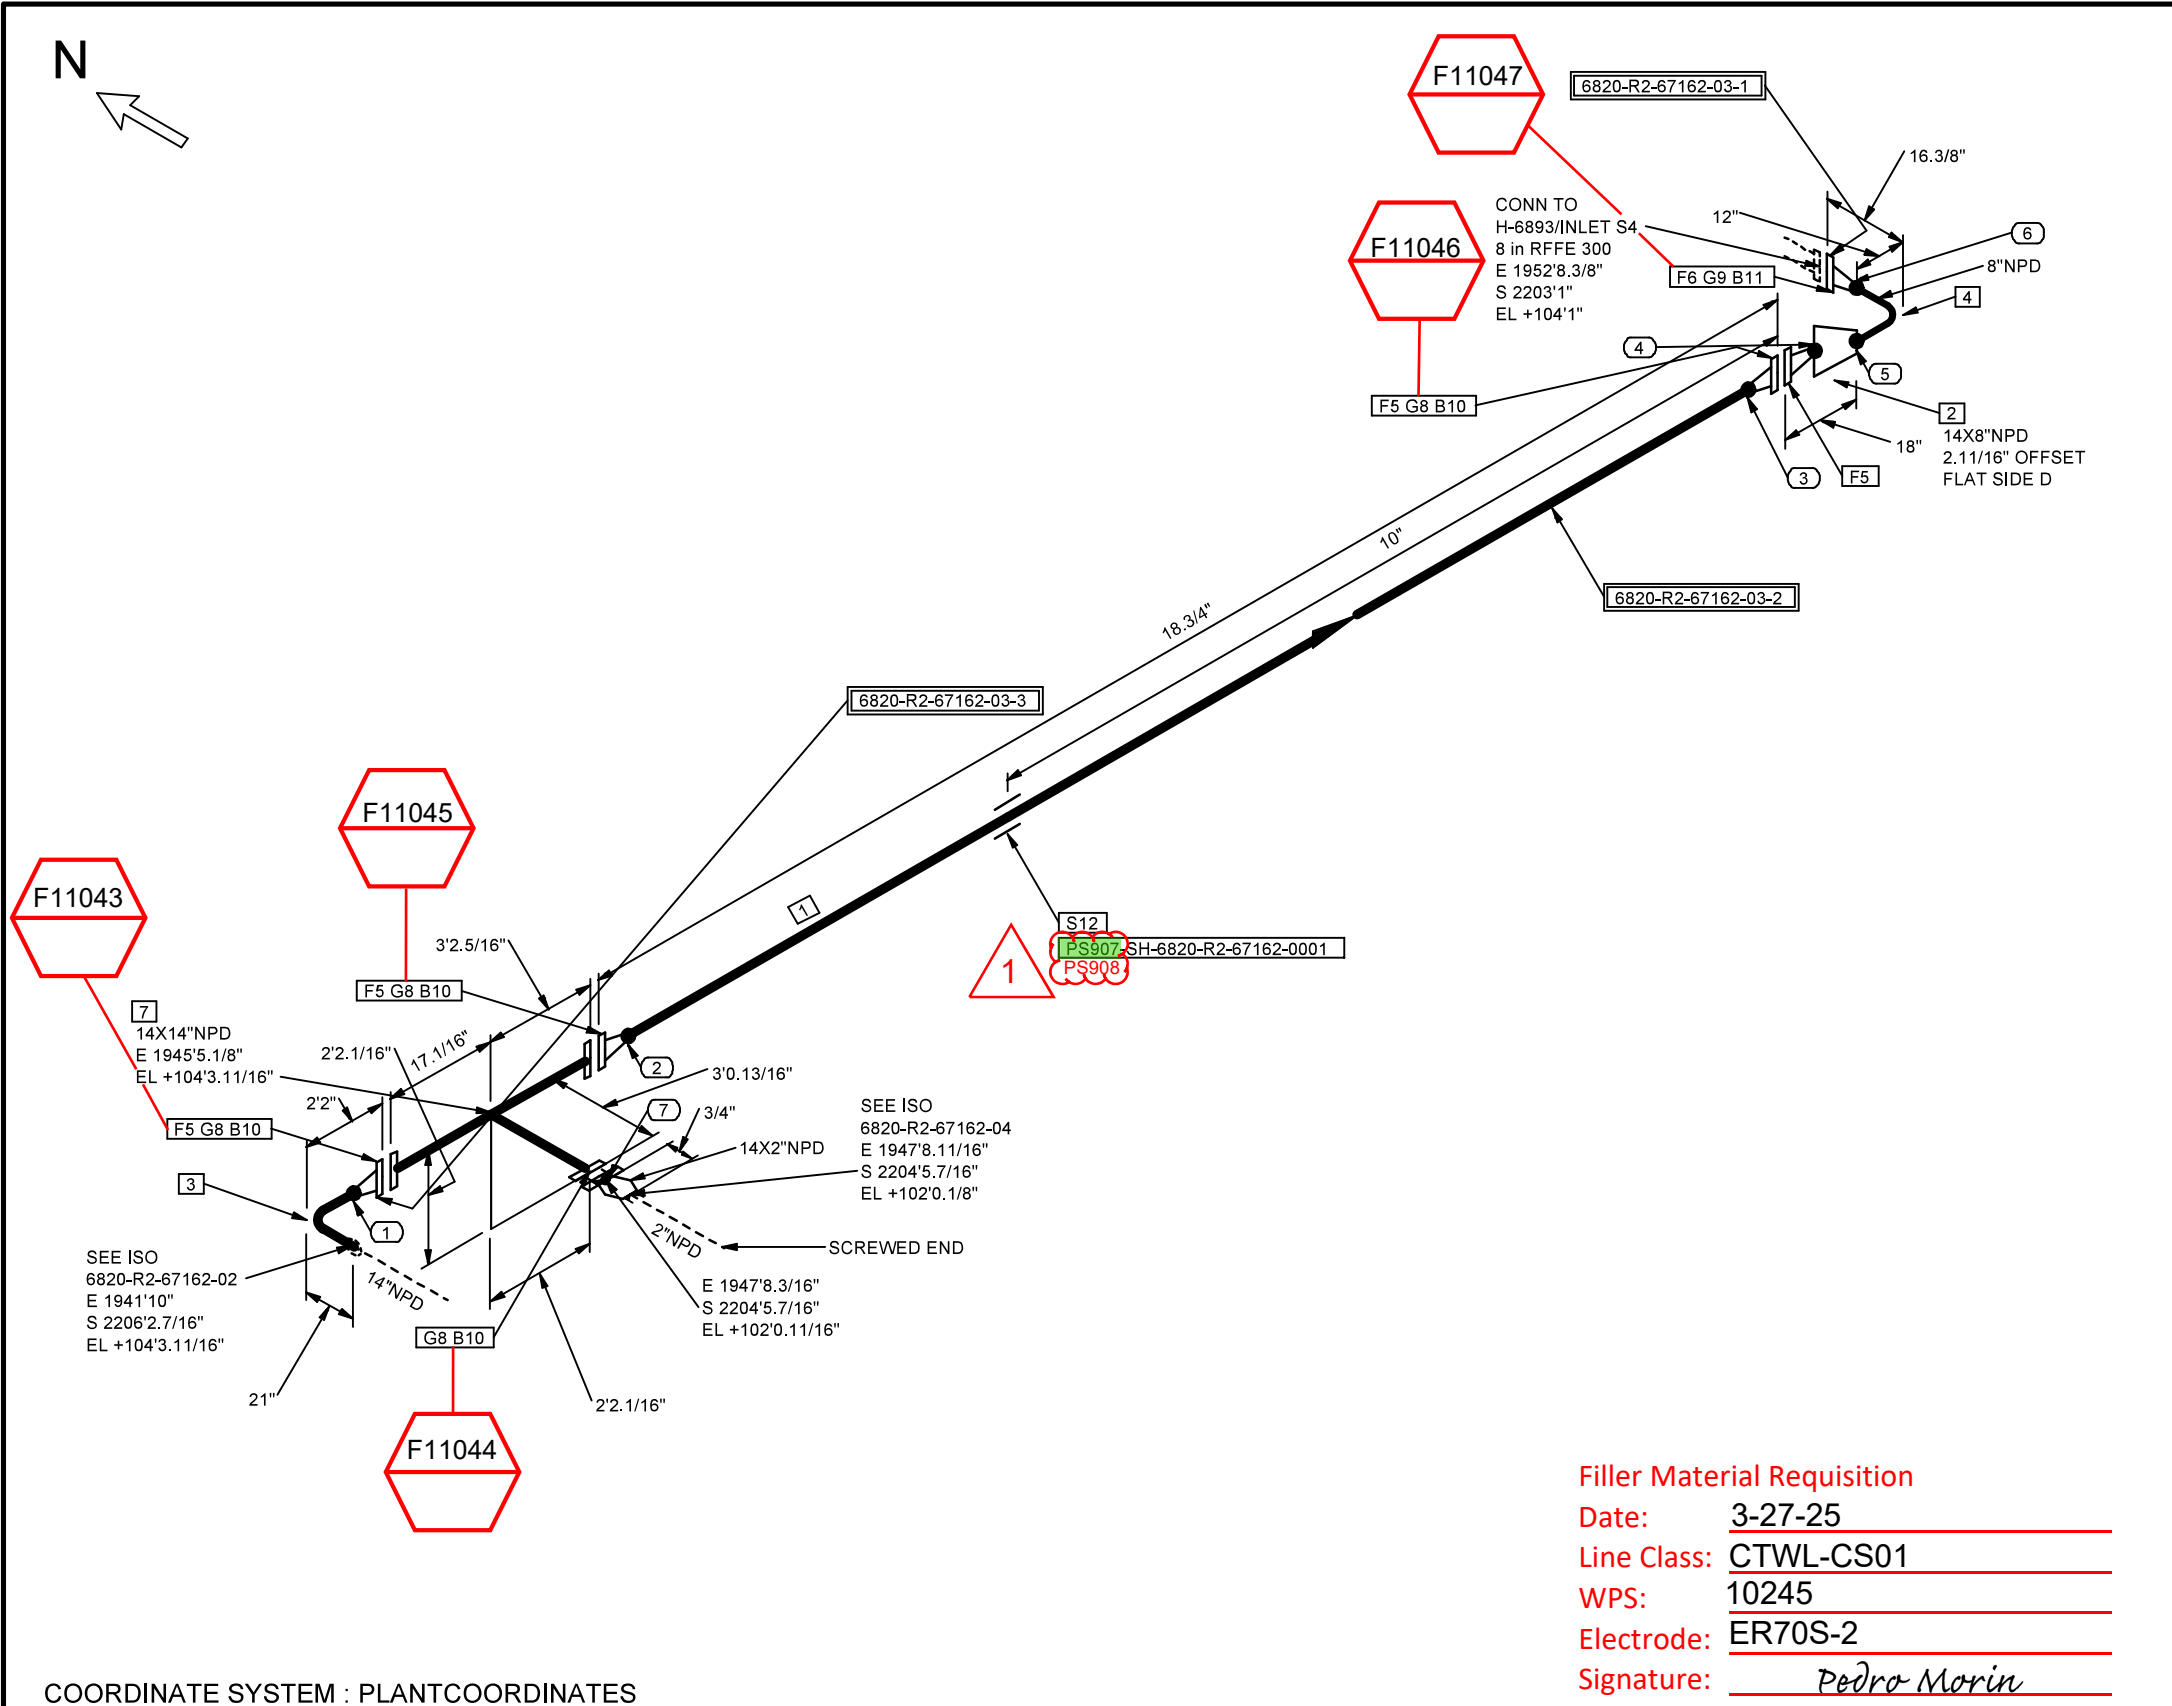

Filler Material Requisition
Date: 3-27-25
Line Class: CTWL-CS01
WPS: 10245
Electrode: ER70S-2
Signature: Pedro Morin

SHOP MATERIALS				
NO	NPD	DESCRIPTION	IDENT	QTY
1	14	Pipes, Seamless, ASME B36.10, ASTM A106 Gr.B, BE, -, -, S-STD	CPP0AMRT	0.8
2	14X8	Ecc Reducer, Seamless, ASME B16.9, ASTM A234 Gr.WPB, BW Ends, -, -, S-STD	CDB6BU5N	1
3	14	90° Elb LR, Seamless, ASME B16.9, ASTM A234 Gr.WPB, BW Ends, -, -, S-STD	CDB6G9K	1
4	8	90° Elb LR, Seamless, ASME B16.9, ASTM A234 Gr.WPB, BW Ends, -, -, S-STD	CDB6GR0	1
5	14	WN Flg, ASME B16.5, ASTM A105N, 150 Lbs, RF/BW End, -, S-STD	CFG6WJ59	4
6	8	WN Flg, ASME B16.5, ASTM A105N, 300 Lbs, RF/BW End, -, S-STD	CFG6WKVH	1

OTHER THAN SHOP MATERIALS				
NO	NPD	DESCRIPTION	IDENT	QTY
7	14X14	SP-6808	SP-6808	1
8	14	NM Flat Gk, Aramid Fiber Reinforced SBR, 150 Lbs, RF as per ASME B16.5, Full Face, Thk=1/8in, -	C76KJLFJ	4
9	8	NM Flat Gk, Aramid Fiber Reinforced SBR, 300 Lbs, RF as per ASME B16.5, Full Face, Thk=1/8in, -	C7BP7ZE8	1
10	1	SBlt 2 HHx N, A193 Gr.B7/A194 Gr.2H, -, Xylan PTFE Coated, - 5.5 in. Length	C6S4K8EA	48
11	7/8	SBlt 2 HHx N, A193 Gr.B7/A194 Gr.2H, -, Xylan PTFE Coated, - 5.75 in. Length	C6S4K8CX	12

PIPE SUPPORTS				
12	14	PS908 PS907 SH-6820-R2-67162-0001	PS907	1

PIECE MARKS
6820-R2-67162-03-1 6820-R2-67162-03-2 6820-R2-67162-03-3

COORDINATE SYSTEM : PLANTCOORDINATES

NOTES:
1. FOR LINE PRESSURES, TEMPERATURES, INSULATION TYPE AND THICKNESS, ETC. REFER TO LATEST REVISION OF LDT.
2. FOR STANDARD PIPE SUPPORT DETAILS SEE PROJECT STANDARD.
3. FIELD SHIM TO SUIT UNLESS OTHERWISE NOTED.
4. FOR PWHT REQUIREMENTS REFER TO LINE CLASS SPECIFICATION.
5. ALL THREADED PIPE LINE SYSTEMS, FIELD SHALL VERIFY DIMENSION PRIOR TO ERECTION.
6. FFW DESIGNATION AT WELDS INDICATES FIELD FIT WELD, WHERE PIPE FABRICATOR IS TO ADD 9 INCH OF PIPE TO THE ISOMETRIC DIMENSION TO ENABLE THE FIELD TO CUT TO FIT AT SITE.
7. REFER TO 202998C-000-W1-1300-0001 FOR FRP AND DUAL-LAM FABRICATION.



TECHNIP
ENERGIES

Information contained in this document is the work product of one or more legal entities of Technip Energies N.V. and embodies confidential and proprietary information of the applicable entity and/or its client. Use of this information is restricted in accordance with conditions specified by the contract. Technip Energies N.V. and its affiliates disclaim any and all liabilities for any changes or modifications to this document which are made by any person other than the entity that issued the document under the applicable client contract.

THIS DOCUMENT IS UNCONTROLLED WHEN REPRODUCED

REV	DATE	BY	DESCRIPTION	CHKD	MTO	STRESS	APRVD
1	2025-03-21	RVA	ISSUED FOR CONSTRUCTION	SAD	KJK	SMR	GR
0	2024-11-15	RVA	ISSUED FOR CONSTRUCTION	SAD	KJK	SMR	GR



OxyChem Redstone Battleground
PROJECT

SERVICE: R2	VAPOR/LIQUID: L	INSUL TYPE: Per LDT	INSUL THK: Per LDT	SHOP: Y	FIELD: Y	PAIN CODE: Per LDT	MODULE: -
P&ID: 202998C-001-PID-0021-0333							
UNIT#: 6800	EW P AREA: 6820	SPEC: CTWL-CS01	STRESS CALC #: CN-0403				
LINE No. 14"-R2-67162-CTWL-CS01-N							
DRAWING NUMBER 6820-R2-67162-03							REV. 1

