


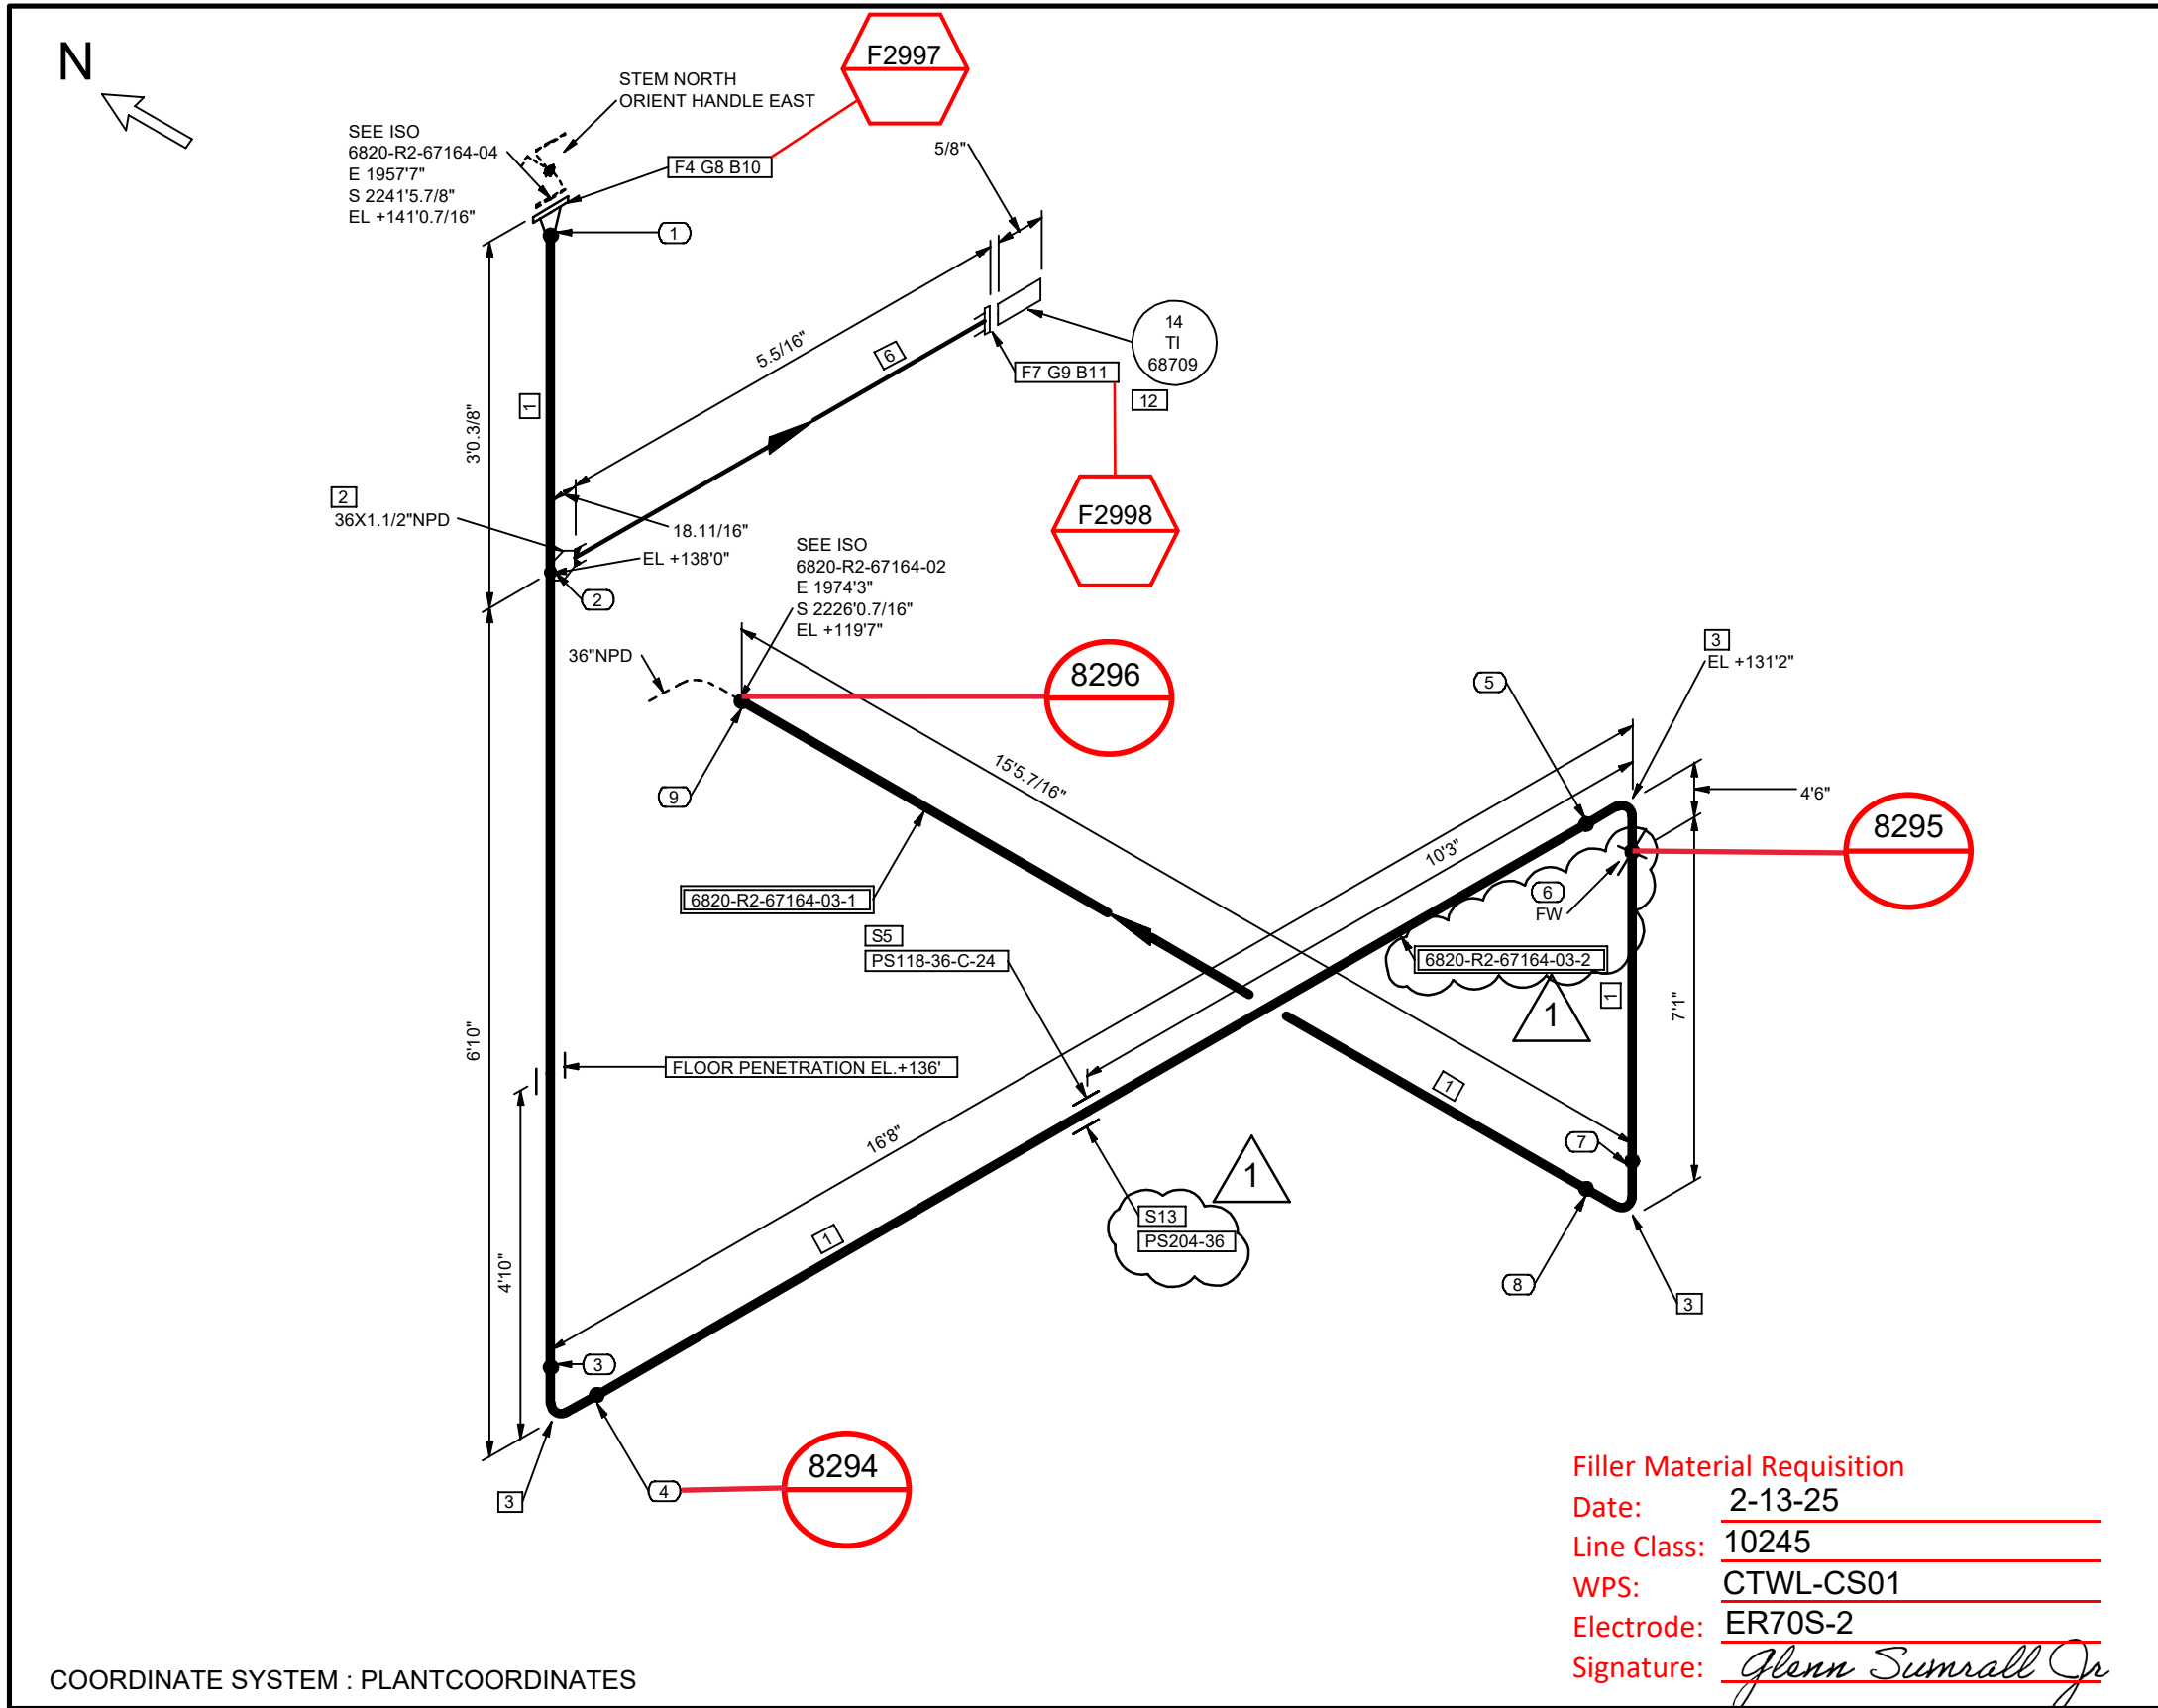

SHOP MATERIALS				
NO	NPD	DESCRIPTION	IDENT	QTY
1	36	Pipes, DSAW, ASME B36.10, API 5L Gr.B PSL1, BE, -, -, .375"	C7SN25MV	26.1
2	36X1.1/2	Thredolet, ASTM A105N Galv. as per ASTM A153, 3000 Lbs, NPTF Ends, -, -	C5MYLG8D	1
3	36	90° Elb LR, Welded + 100% RT, ASME B16.9, ASTM A234 Gr.WPB, BW Ends, -, -, .375"	CE79U10	3
4	36	WN Flg, ASME B16.47 Series A, ASTM A105N, 150 Lbs, FF/BW End, -, .375"	C8USKMSB	1
PIPE SUPPORTS				
5	36	PS118-36-C-24	PS118	1
OTHER THAN SHOP MATERIALS				
NO	NPD	DESCRIPTION	IDENT	QTY
6	1.1/2	Pipes, Seamless, ASME B36.10, ASTM A106 Gr.B Galv. as per ASTM A153, NPTM Ends, w/ coupling, -, S-XS	CPPD3S3F	0.5
7	1.1/2	THD Flg, ASME B16.5, ASTM A105N Galv. as per ASTM A153, 150 Lbs, RF/NPTF End, -	C1DR2JP	1
8	36	NM Flat Gk, Aramid Fiber Reinforced SBR, 150 Lbs, FF as per ASME B16.47 Series A, Full Face, Thk=1/8in, -	C9CT3XUN	1
9	1.1/2	NM Flat Gk, Aramid Fiber Reinforced SBR, 150 Lbs, RF as per ASME B16.5, Full Face, Thk=1/8in, -	C76KHSS1	1
10	1.1/2	SBlT 2 HHx N, A193 Gr.B7/A194 Gr.2H, -, Xylan PTFE Coated, - 18.75 in. Length	C6S4K8LH	32
11	1/2	SBlT 2 HHx N, A193 Gr.B7/A194 Gr.2H, -, Xylan PTFE Coated, - 3 in. Length	C6S4K87V	4
INSTRUMENTS				
12	1.1/2	14-TI-68709	14-TI-68709	1
PIPE SUPPORTS				
13	36	PS204-36	PS204	1
PIECE MARKS				
6820-R2-67164-03-1 6820-R2-67164-03-2				

Filler Material Requisition
Date: 2-13-25
Line Class: 10245
WPS: CTWL-CS01
Electrode: ER70S-2
Signature: *Glenn Sumrall Jr*

NOTES:

- FOR LINE PRESSURES, TEMPERATURES, INSULATION TYPE AND THICKNESS, ETC. REFER TO LATEST REVISION OF LDT.
- FOR STANDARD PIPE SUPPORT DETAILS SEE PROJECT STANDARD.
- FIELD SHIM TO SUIT UNLESS OTHERWISE NOTED.
- FOR PWHT REQUIREMENTS REFER TO LINE CLASS SPECIFICATION.
- ALL THREADED PIPE LINE SYSTEMS, FIELD SHALL VERIFY DIMENSION PRIOR TO ERECTION.
- FFW DESIGNATION AT WELDS INDICATES FIELD FIT WELD, WHERE PIPE FABRICATOR IS TO ADD 9 INCH OF PIPE TO THE ISOMETRIC DIMENSION TO ENABLE THE FIELD TO CUT TO FIT AT SITE.
- REFER TO 202998C-000-W1-1300-0001 FOR FRP AND DUAL-LAM FABRICATION.

T.EN

TECHNIP ENERGIES

Information contained in this document is the work product of one or more legal entities of Technip Energies N.V. and embodies confidential and proprietary information of the applicable entity and/or its client. Use of this information is restricted in accordance with conditions specified by the contract. Technip Energies N.V. and its affiliates disclaim any and all liabilities for any changes or modifications to this document which are made by any person other than the entity that issued the document under the applicable client contract.

THIS DOCUMENT IS UNCONTROLLED WHEN REPRODUCED

REV	DATE	BY	DESCRIPTION	CHKD	MTO	STRESS	APRVD
1	2025-01-31	RVA	ISSUED FOR CONSTRUCTION	SAD	KJK	SMR	GR
0	2024-08-17	RVA	ISSUED FOR CONSTRUCTION	SAD	KJK	SMR	GR

SERVICE: R2

VAPOR/LIQUID: L

INSUL TYPE: Per LDT

INSUL THK: Per LDT

SHOP: Y

FIELD: Y

PAINT CODE: Per LDT

MODULE: -

OXY

OxyChem Redstone Battleground PROJECT

P&ID: 202998C-001-PID-0021-0327

UNIT#: 6800 EWP AREA: 6820 SPEC: CTWL-CS01 STRESS CALC #: CN-0408

LINE No: 36"-R2-67164-CTWL-CS01-N

DRAWING NUMBER: 6820-R2-67164-03

REV: 1

01 FEB 2025 03:20