


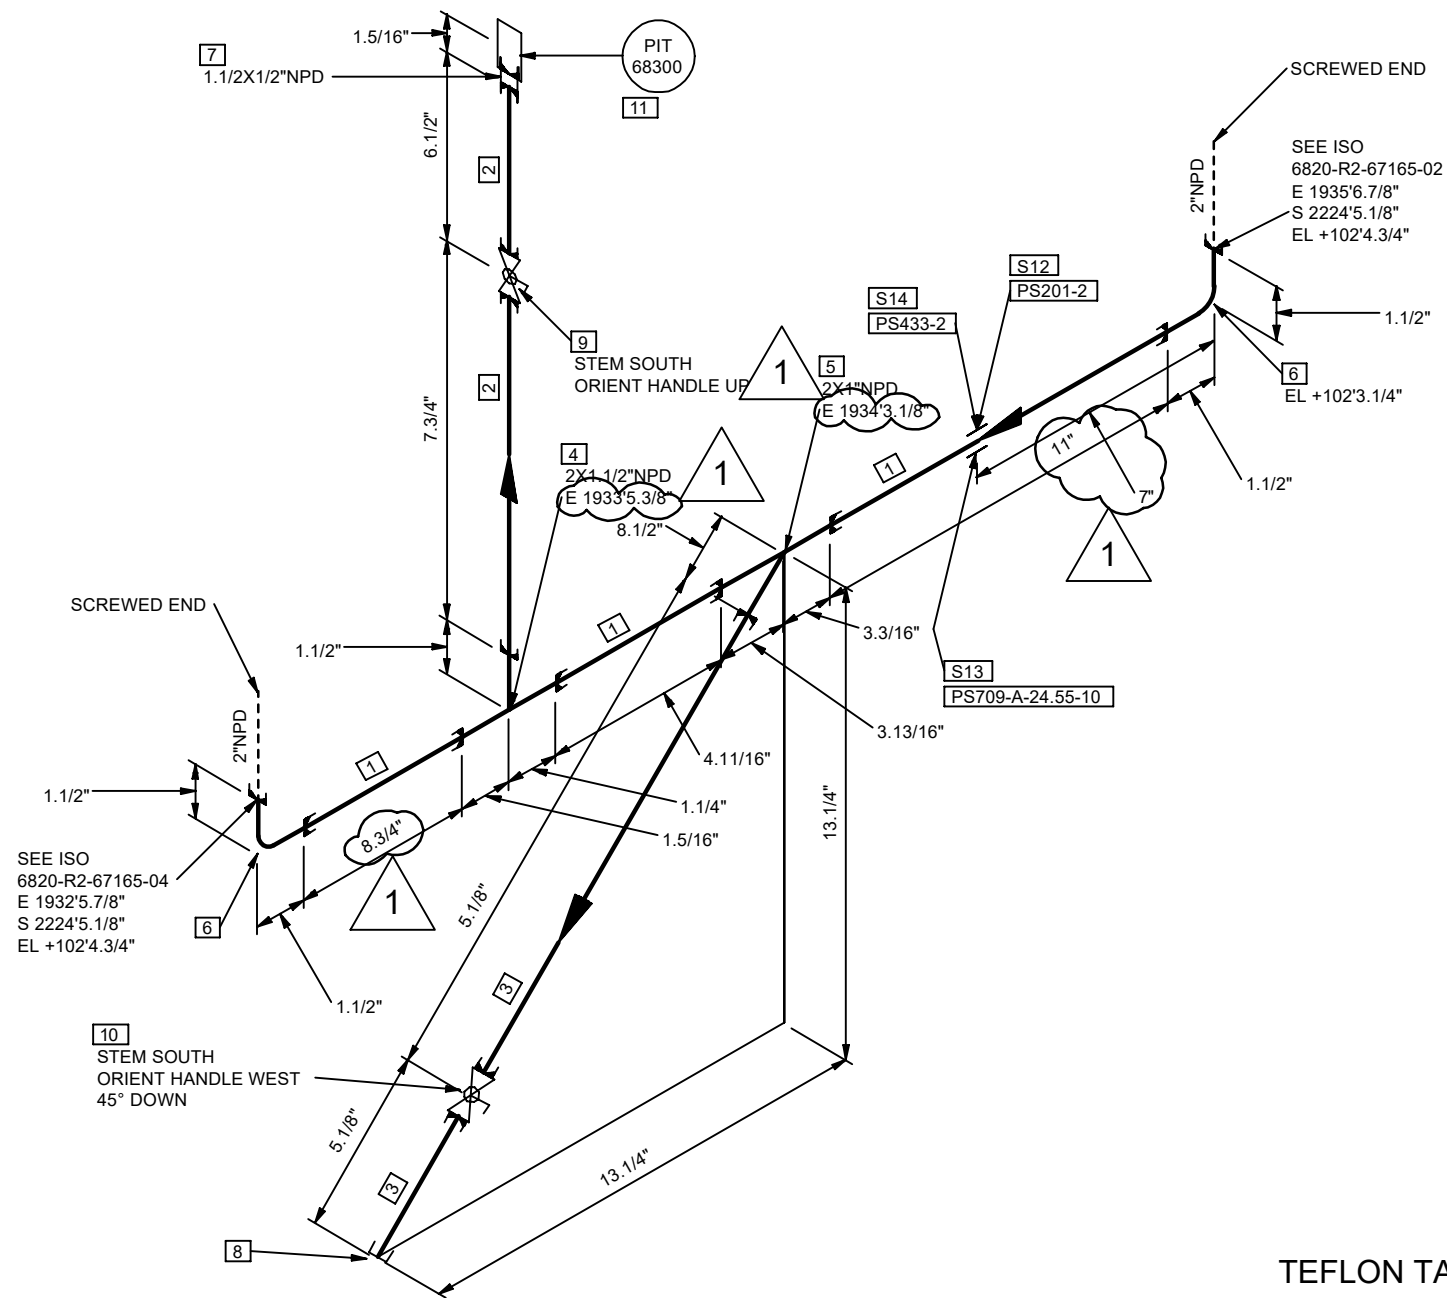

COORDINATE SYSTEM : PLANTCOORDINATES

TEFLON TAPE

Filler Material Requisition

Date: 3-27-25

Line Class: POWL-XX01

WPS: N/A

Electrode: N/A

Signature: Pedro Morin

OTHER THAN SHOP MATERIALS

NO	NPD	DESCRIPTION	IDENT	QTY
1	2	Pipes, Seamless, ASME B36.10, ASTM A106 Gr.B Galv. as per ASTM A153, NPTM Ends, w/ coupling, NSF-61 Cert, S-XS	C76SD26N	2.1 '
2	1.1/2	Pipes, Seamless, ASME B36.10, ASTM A106 Gr.B Galv. as per ASTM A153, NPTM Ends, w/ coupling, NSF-61 Cert, S-XS	C76SD255	0.9 '
3	1	Pipes, Seamless, ASME B36.10, ASTM A106 Gr.B Galv. as per ASTM A153, NPTM Ends, w/ coupling, NSF-61 Cert, S-XS	C76SD23G	0.7 '
4	2X1.1/2	Red Te, ASME B16.3, ASTM A197 Galv. as per ASTM A153, 150 Lbs, NPTF Ends, NSF-61 Cert.,	C76SDEMP	1
5	2X1	SP-6831	SP-6831	1
6	2	90° Elb, ASME B16.3, ASTM A197 Galv. as per ASTM A153, 150 Lbs, NPTF Ends, NSF-61 Cert.,	C76SDEP8	2
7	1.1/2X1/2	Red Coup, ASME B16.3, ASTM A197 Galv. as per ASTM A153, 150 Lbs, NPTF Ends, NSF-61 Cert.,	C76SDENF	1
8	1	Cap, ASME B16.3, ASTM A197 Galv. as per ASTM A153, 150 Lbs, NPTF End, NSF-61 Cert.,	C76SDEMT	1
9	1.1/2	Bal Fem,FB, MSS SP-110, ASTM A351 Gr.CF8M,1000 PSI CWP, NPTF Ends, LO,NSF-61 Cert, Valve Tag: BA-1196	C9AYWETH	1
10	1	Bal Fem,FB, MSS SP-110, ASTM A351 Gr.CF8M,1000 PSI CWP, NPTF Ends, LO,NSF-61 Cert, Valve Tag: BA-1196	C9P77RM8	1

INSTRUMENTS

11	1/2	PIT-68300	PIT-68300	1
----	-----	-----------	-----------	---

PIPE SUPPORTS

12	2	PS201-2	PS201	1
13	2	PS709-A-24.55-10	PS709	1
14	2	PS433-2	PS433	1



NOTES:


- FOR LINE PRESSURES, TEMPERATURES, INSULATION TYPE AND THICKNESS, ETC. REFER TO LATEST REVISION OF LDT.
- FOR STANDARD PIPE SUPPORT DETAILS SEE PROJECT STANDARD.
- FIELD SHIM TO SUIT UNLESS OTHERWISE NOTED.
- FOR PWHT REQUIREMENTS REFER TO LINE CLASS SPECIFICATION.
- ALL THREADED PIPE LINE SYSTEMS, FIELD SHALL VERIFY DIMENSION PRIOR TO ERECTION.
- FFW DESIGNATION AT WELDS INDICATES FIELD FIT WELD, WHERE PIPE FABRICATOR IS TO ADD 9 INCH OF PIPE TO THE ISOMETRIC DIMENSION TO ENABLE THE FIELD TO CUT TO FIT AT SITE.
- REFER TO 202998C-000-W1-1300-0001 FOR FRP AND DUAL-LAM FABRICATION.



Information contained in this document is the work product of one or more legal entities of Technip Energies N.V. and embodies confidential and proprietary information of the applicable entity and/or its client. Use of this information is restricted in accordance with conditions specified by the contract. Technip Energies N.V. and its affiliates disclaim any and all liabilities for any changes or modifications to this document which are made by any person other than the entity that issued the document under the applicable client contract.

THIS DOCUMENT IS UNCONTROLLED WHEN REPRODUCED

REV	DATE	BY	DESCRIPTION	CHKD	MTO	STRESS	APRVD
1	2025-03-21	RVA	ISSUED FOR CONSTRUCTION	SAD	KJK	SMR	GR
0	2025-02-26	RVA	ISSUED FOR CONSTRUCTION	SAD	KJK	SMR	GR

SERVICE: R2	VAPOR/LIQUID: L	INSUL TYPE: Per LDT	INSUL THK: Per LDT	SHOP: N	FIELD: Y	PAINT CODE: Per LDT	MODULE: -	
 OxyChem Redstone Battleground PROJECT				P&ID: 202998C-001-PID-0031-0946				
				UNIT#: 6800	EWPA AREA: 6820	SPEC: POWL-XX01	STRESS CALC #: -	
				LINE No. 2"-R2-67165-POWL-XX01-N				
				DRAWING NUMBER 6820-R2-67165-03				
				REV. 1				

