




NOTES:

1. FOR LINE PRESSURES, TEMPERATURES, INSULATION TYPE AND THICKNESS, ETC.
REFER TO LATEST REVISION OF LDT.
2. FOR STANDARD PIPE SUPPORT DETAILS SEE PROJECT STANDARD.
3. FIELD SHIM TO SUIT UNLESS OTHERWISE NOTED.
4. FOR PWHT REQUIREMENTS REFER TO LINE CLASS SPECIFICATION.
5. ALL THREADED PIPE LINE SYSTEMS, FIELD SHALL VERIFY DIMENSION PRIOR TO ERECTION.
6. FFW DESIGNATION AT WELDS INDICATES FIELD FIT WELD, WHERE PIPE FABRICATOR IS TO ADD
9 INCH OF PIPE TO THE ISOMETRIC DIMENSION TO ENABLE THE FIELD TO CUT TO FIT AT SITE.
7. REFER TO 202998C-000-WV1-1300-0001 FOR FRP AND DUAL-LAM FABRICATION.

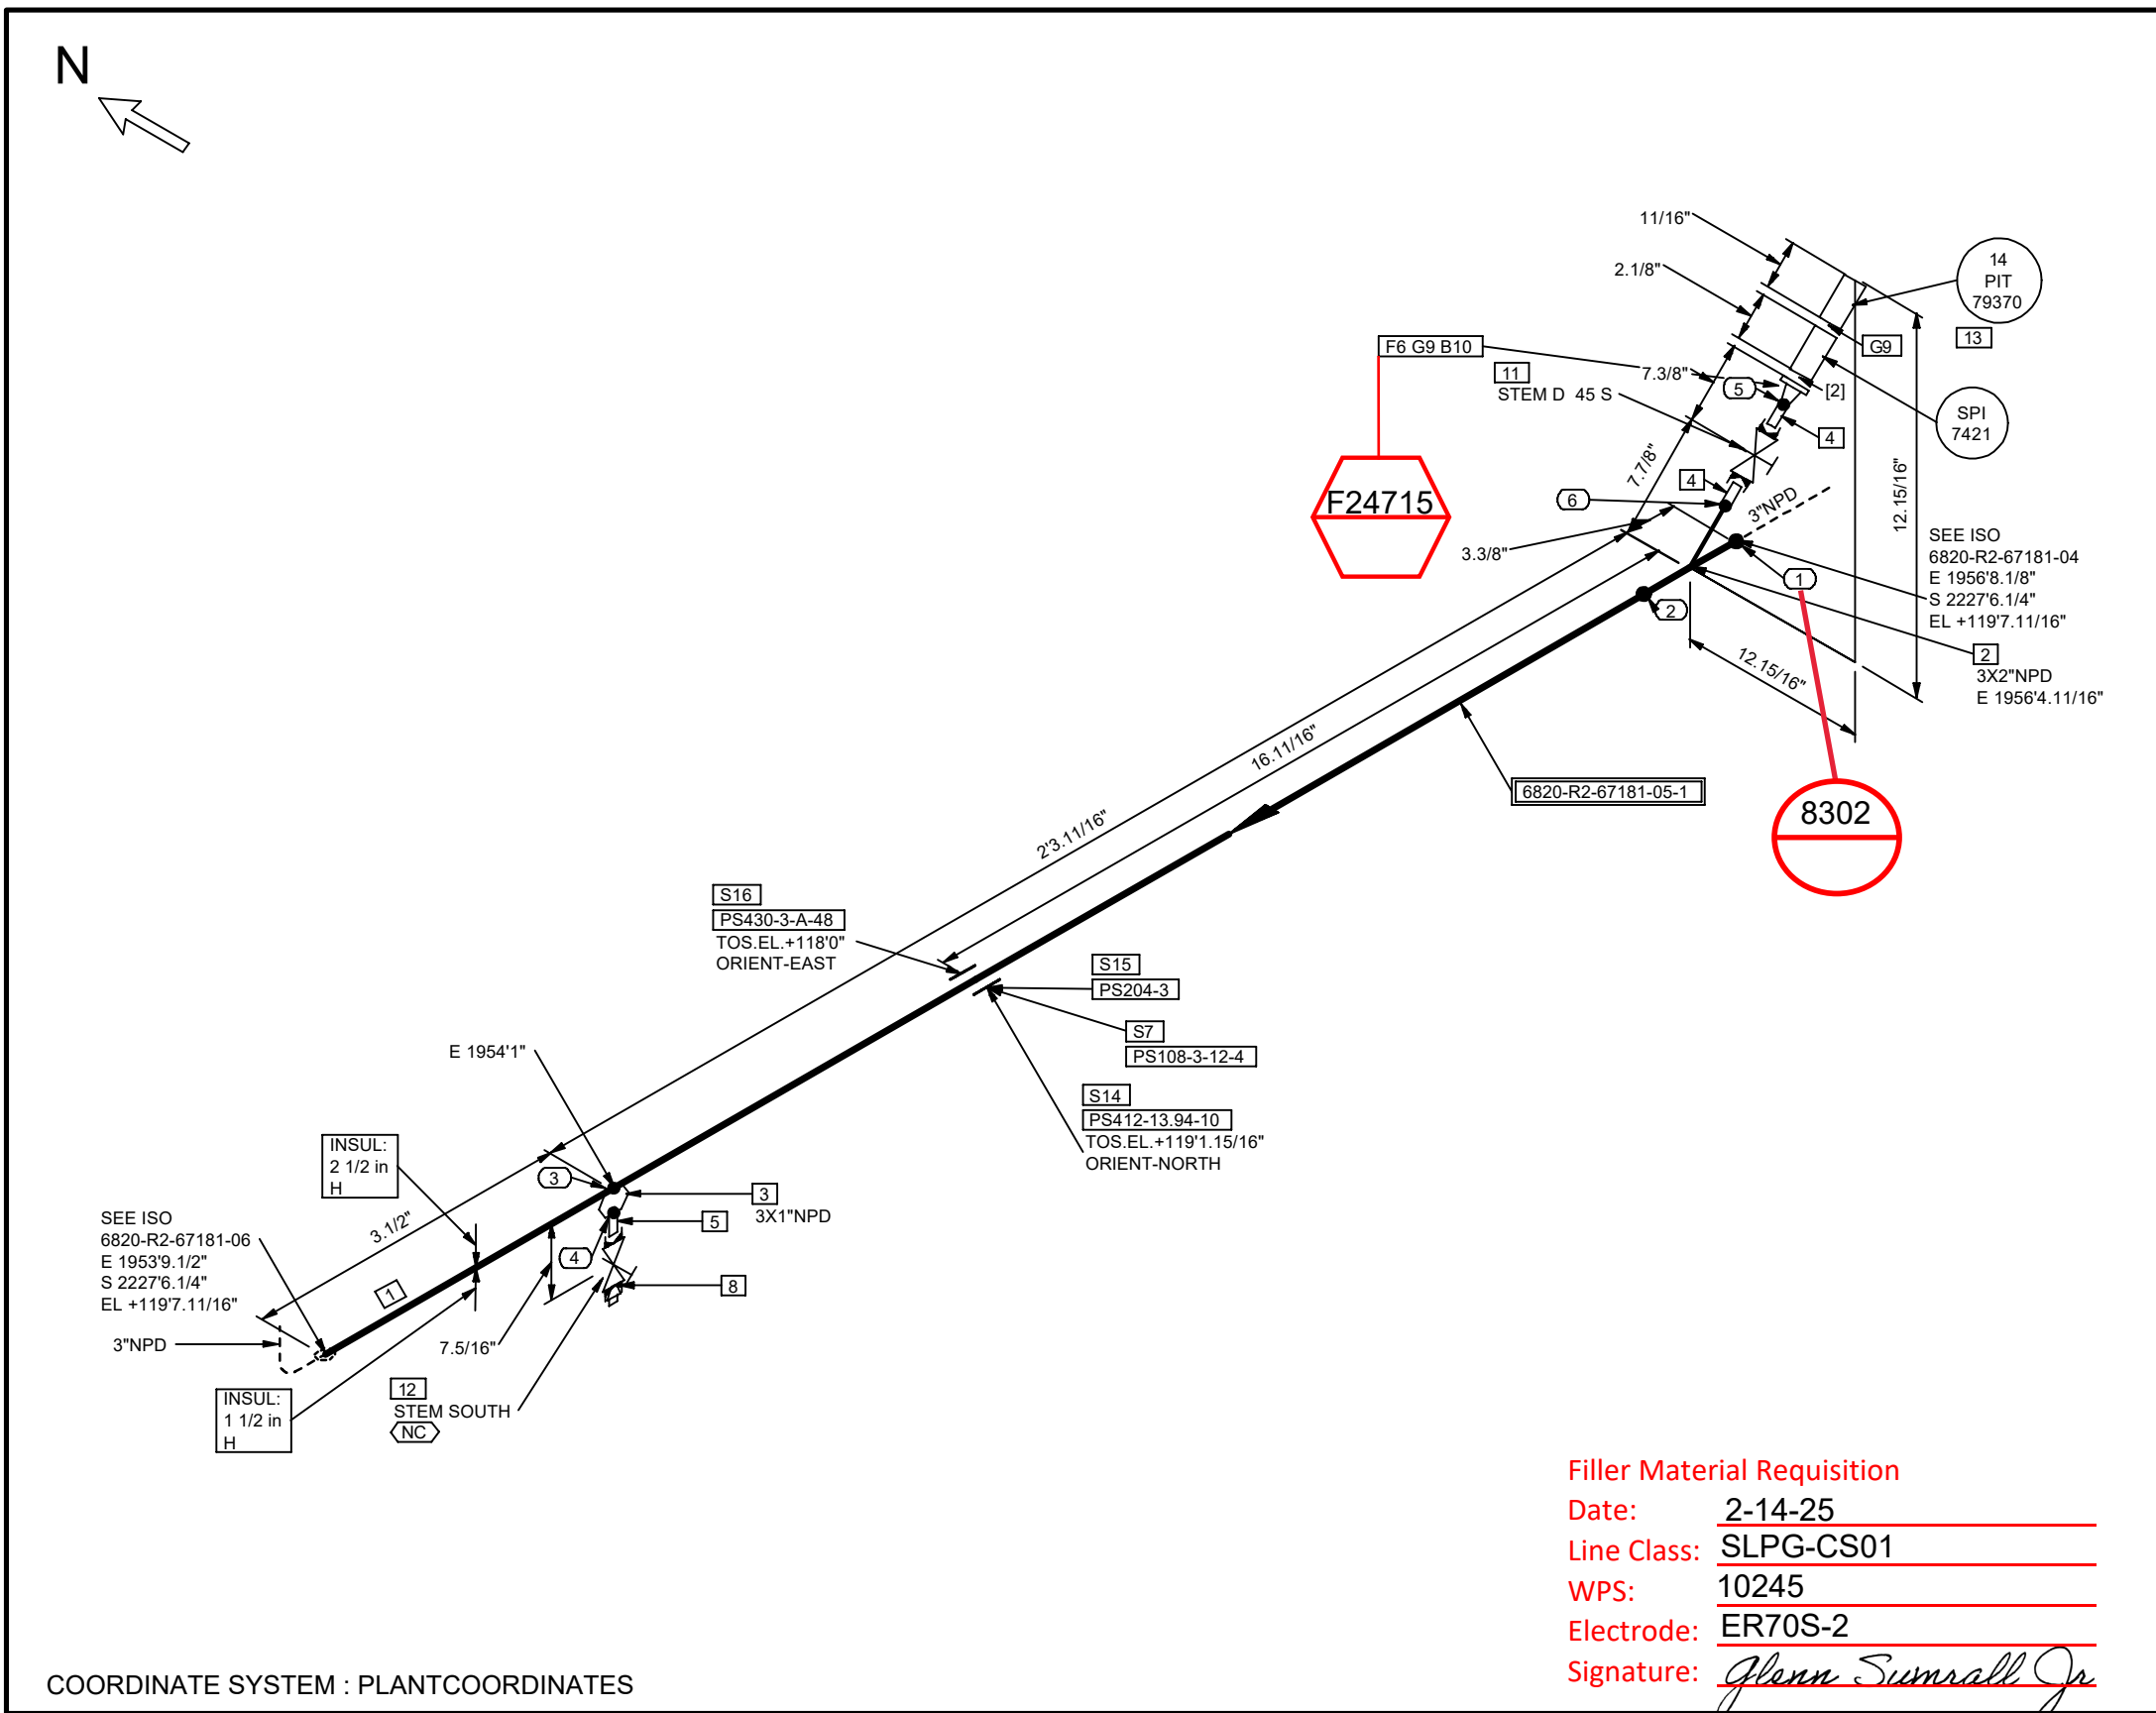

0	2025-02-07	RVA	ISSUED FOR CONSTRUCTION	SAD	KJK	SMR	GR
REV	DATE	BY	DESCRIPTION	CHKD	MTD	STRESS	APRVD

NO	NPD	DESCRIPTION	IDENT	QTY
1	3	Pipes, Seamless, ASME B36.10, ASTM A106 Gr.B, BE, -, -, S-STD	CPP002ZK	2.4 '
2	3X2	Red Te, Seamless, ASME B16.9, ASTM A234 Gr.WPB, BW Ends, -, -, S-STD x S-XS	CDB0D31S	1
3	3X1	Weldolet, MSS SP-97, ASTM A105N, BW Ends, -, S-STD x S-XS	CTE2DP5	1
4	2	Nipple, ASTM A106 Gr.B, BE/NPTM End, L = 3in, -, S-XS	C8GZKYUG	2
5	1	Nipple, ASTM A106 Gr.B, BE/NPTM End, L = 3in, -, S-XS	C80UCV6H	1
6	2	WN Flg, ASME B16.5, ASTM A105N, 150 Lbs, RF/BW End, -, S-XS	CFG6WJ8W	1

7	3	PS108-3-12-4	PS108	1
---	---	--------------	-------	---

NO	NPd	DESCRIPTION	IDENT	QTY
8	1	Plug, Solid Round Head Type, ASME B16.11, ASTM A105N, NPTM End, -,	CBBPLK4	1
9	2	NM Flat Gk, Aramid Fiber Reinforced SBR, 150 Lbs, RF as per ASME B16.5, -, Thk=1/8in, -,	C7SM1YGR	2
10	5/8	SBlT 2 HHx N, A193 Gr.B7/A194 Gr.2H, -, Xylan PTFE Coated, - 5.75 in. Length	C6S4K890	4
11	2	Gat Fem, API 602, ASTM A105N,800 Lbs, NPTF Ends, HO,-, Valve Tag: GA-0120	C8ADWXXKM	1
12	1	Gat Fem, API 602, ASTM A105N,800 Lbs, NPTF Ends, HO,-, Valve Tag: GA-0120	C76SPABV	1

13	2	14-PIT-79370	14-PIT-79370	1
----	---	--------------	--------------	---

14	3	PS412-13.94-10	PS412	1
15	3	PS204-3	PS204	1
16	3	PS430-3-A-48	PS430	1

6820-R2-67181-05-1

Date: 2-14-25
Line Class: SLPG-CS01
WPS: 10245
Electrode: ER70S-2
Signature: *Glenn Sumrall Jr*

