


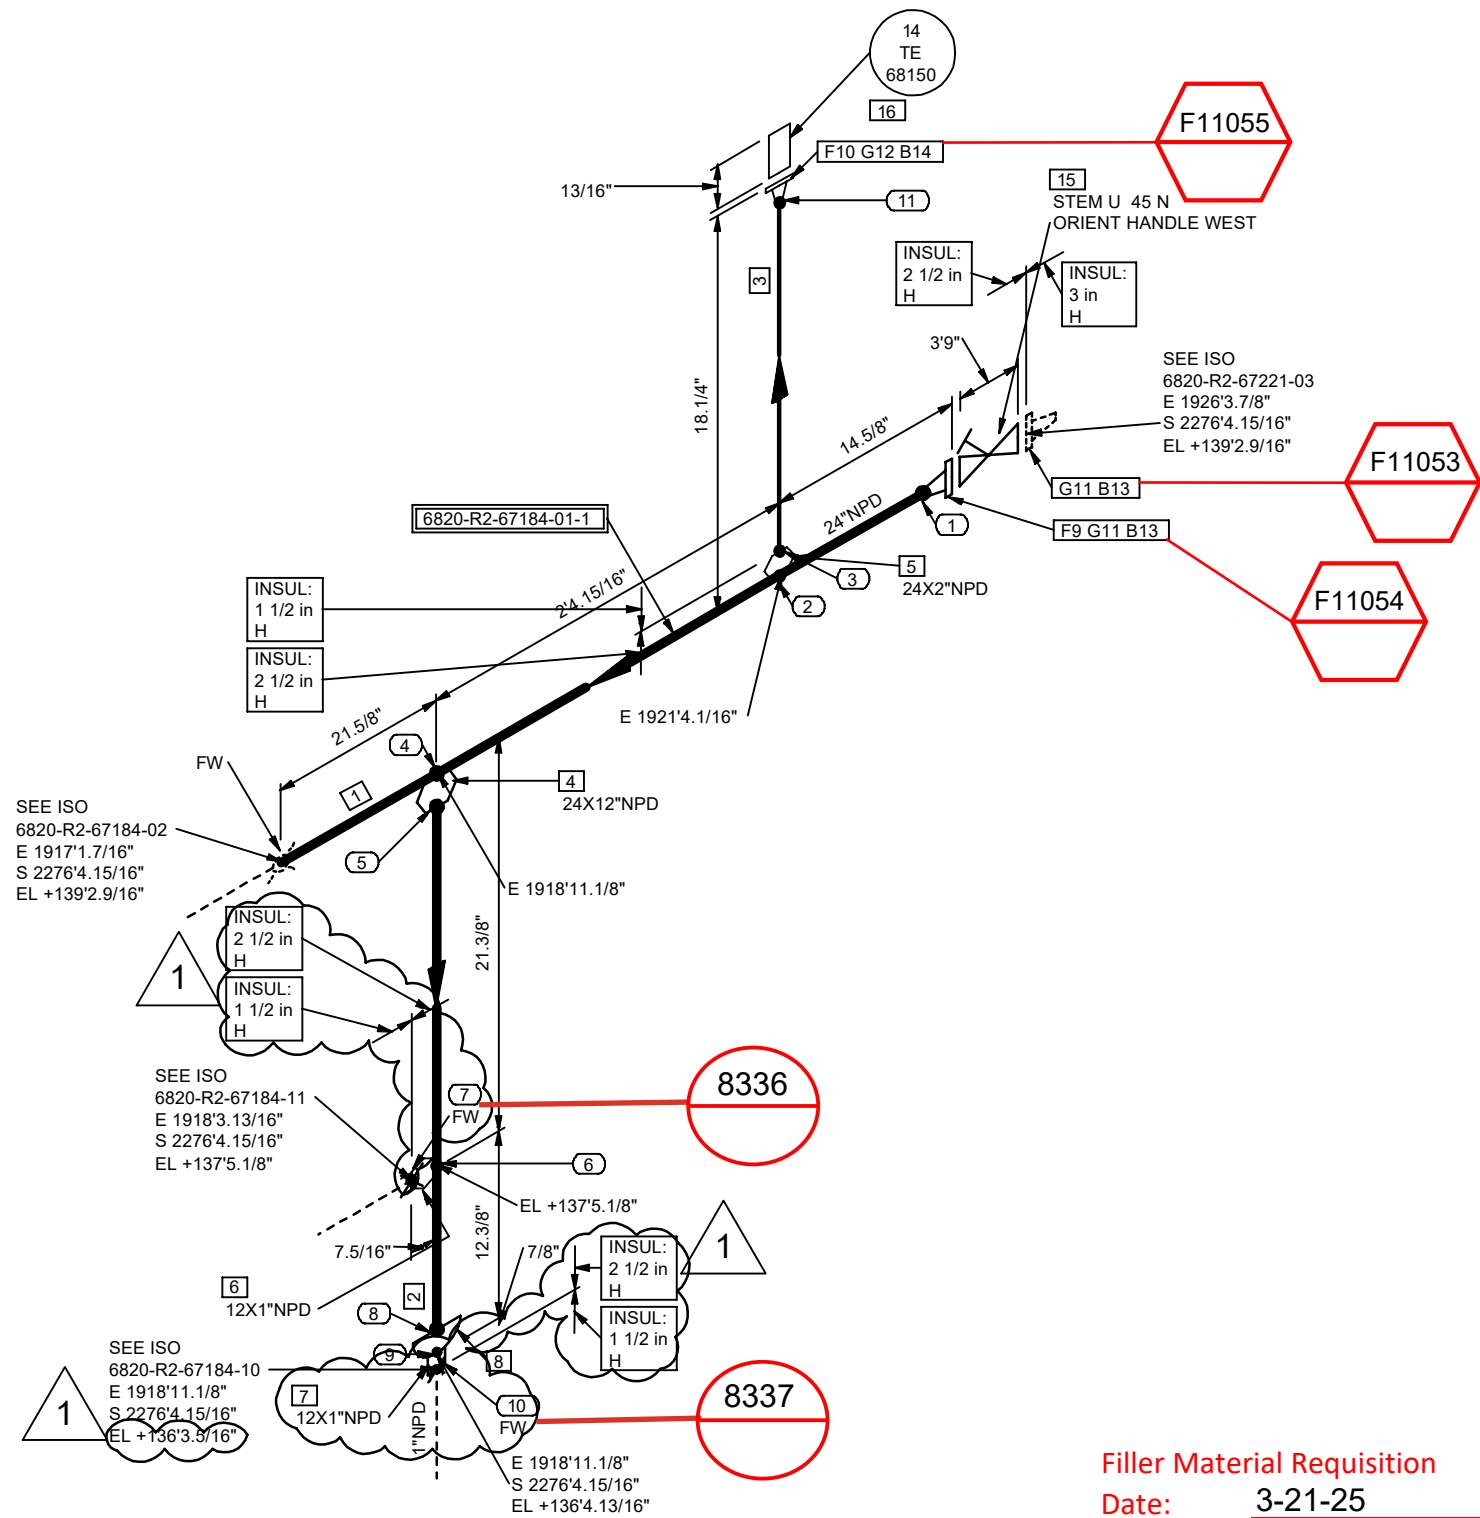

Filler Material Requisition

Date: 3-21-25
Line Class: SIPG-CS01
WPS: 10245
Electrode: ER70S-2
Signature: Pedro Morin

SHOP MATERIALS

NO	NPD	DESCRIPTION	IDENT	QTY
1	24	Pipes, Seamless, ASME B36.10, ASTM A106 Gr.B, BE, -, -, S-STD	CPP0AN0E	4.9 '
2	12	Pipes, Seamless, ASME B36.10, ASTM A106 Gr.B, BE, -, -, S-STD	CPP0AATK	1.0 '
3	2	Pipes, Seamless, ASME B36.10, ASTM A106 Gr.B, BE, -, -, S-XS	CPP0AAUB	0.2 '
4	24X12	Weldolet, MSS SP-97, ASTM A105N, BW Ends, -, S-STD	C10VUSYT	1
5	24X2	Weldolet, MSS SP-97, ASTM A105N, BW Ends, -, S-STD x S-XS	C133MPDV	1
6	12X1	Socketlet, ASTM A105N, 3000 Lbs, SW Ends, -, S-STD	CYU3CE	1
7	12X1	Endolet (Flat) Fem, ASTM A105N, 3000 Lbs, SW Ends, -, S-STD	C133MNE2	1
8	12	Cap, Seamless, ASME B16.9, ASTM A234 Gr.WPB, BW Ends, -, S-STD	CDB7423U	1
9	24	WN Flg, ASME B16.5, ASTM A105N, 300 Lbs, RF/BW End, -, S-STD	CFG6WKNU	1
10	2	WN Flg, ASME B16.5, ASTM A105N, 300 Lbs, RF/BW End, -, S-XS	CFG6WKK1	1

OTHER THAN SHOP MATERIALS

NO	NPD	DESCRIPTION	IDENT	QTY
11	24	SW Gk, AISI 304/Graphite, 300 Lbs, RF as per ASME B16.5, Thk=1/8in, -, -,	CGKFEG67	2
12	2	SW Gk, AISI 304/Graphite, 300 Lbs, RF as per ASME B16.5, Thk=1/8in, -, -,	CGKFEG63	1
13	1.1/2	SBlit 2 HHx N, A193 Gr.B7/A194 Gr.2H, -, Xylan PTFE Coated, - 9.25 in. Length	C6S4K8MD	48
14	5/8	SBlit 2 HHx N, A193 Gr.B7/A194 Gr.2H, -, Xylan PTFE Coated, - 3.5 in. Length	C6S4K88R	8
15	24	Gat Flg, -, API 600, ASTM A216 Gr.WCB, 300 Lbs, RF, Ends as per ASME B16.5, GO, -, Valve Tag: VG-4	C7J7XW33	1

INSTRUMENTS

16	2	14-TE-68150	14-TE-68150	1
----	---	-------------	-------------	---

PIECE MARKS

6820-R2-67184-01-1

COORDINATE SYSTEM : PLANTCOORDINATES

NOTES:

- FOR LINE PRESSURES, TEMPERATURES, INSULATION TYPE AND THICKNESS, ETC. REFER TO LATEST REVISION OF LDT.
- FOR STANDARD PIPE SUPPORT DETAILS SEE PROJECT STANDARD.
- FIELD SHIM TO SUIT UNLESS OTHERWISE NOTED.
- FOR PWHT REQUIREMENTS REFER TO LINE CLASS SPECIFICATION.
- ALL THREADED PIPE LINE SYSTEMS, FIELD SHALL VERIFY DIMENSION PRIOR TO ERECTION.
- FFW DESIGNATION AT WELDS INDICATES FIELD FIT WELD, WHERE PIPE FABRICATOR IS TO ADD 9 INCH OF PIPE TO THE ISOMETRIC DIMENSION TO ENABLE THE FIELD TO CUT TO FIT AT SITE.
- REFER TO 202998C-000-W1-1300-0001 FOR FRP AND DUAL-LAM FABRICATION.



Information contained in this document is the work product of one or more legal entities of Technip Energies N.V. and embodies confidential and proprietary information of the applicable entity and/or its client. Use of this information is restricted in accordance with conditions specified by the contract. Technip Energies N.V. and its affiliates disclaim any and all liabilities for any changes or modifications to this document which are made by any person other than the entity that issued the document under the applicable client contract.

THIS DOCUMENT IS UNCONTROLLED WHEN REPRODUCED

REV	DATE	BY	DESCRIPTION	CHKD	MTD	STRESS	APRVD
1	2025-03-14	RVA	ISSUED FOR CONSTRUCTION	SAD	KJK	SMR	GR
0	2024-11-22	RVA	ISSUED FOR CONSTRUCTION	SAD	KJK	SMR	GR

SERVICE: R2	VAPOR/LIQUID: V	INSUL TYPE: Per LDT	INSUL THK: Per LDT	SHOP: Y	FIELD: Y	PAINT CODE: Per LDT	MODULE: -	
 OxyChem Redstone Battleground PROJECT				P&ID: 202998C-001-PID-0021-0320				
				UNIT#: 6800	EWP AREA: 6820	SPEC: SIPG-CS01	STRESS CALC #: CN-0023	
				LINE No. 24"-R2-67184-SIPG-CS01-H				
				DRAWING NUMBER 6820-R2-67184-01				
				REV. 1				

OxyChem Redstone Battleground PROJECT

