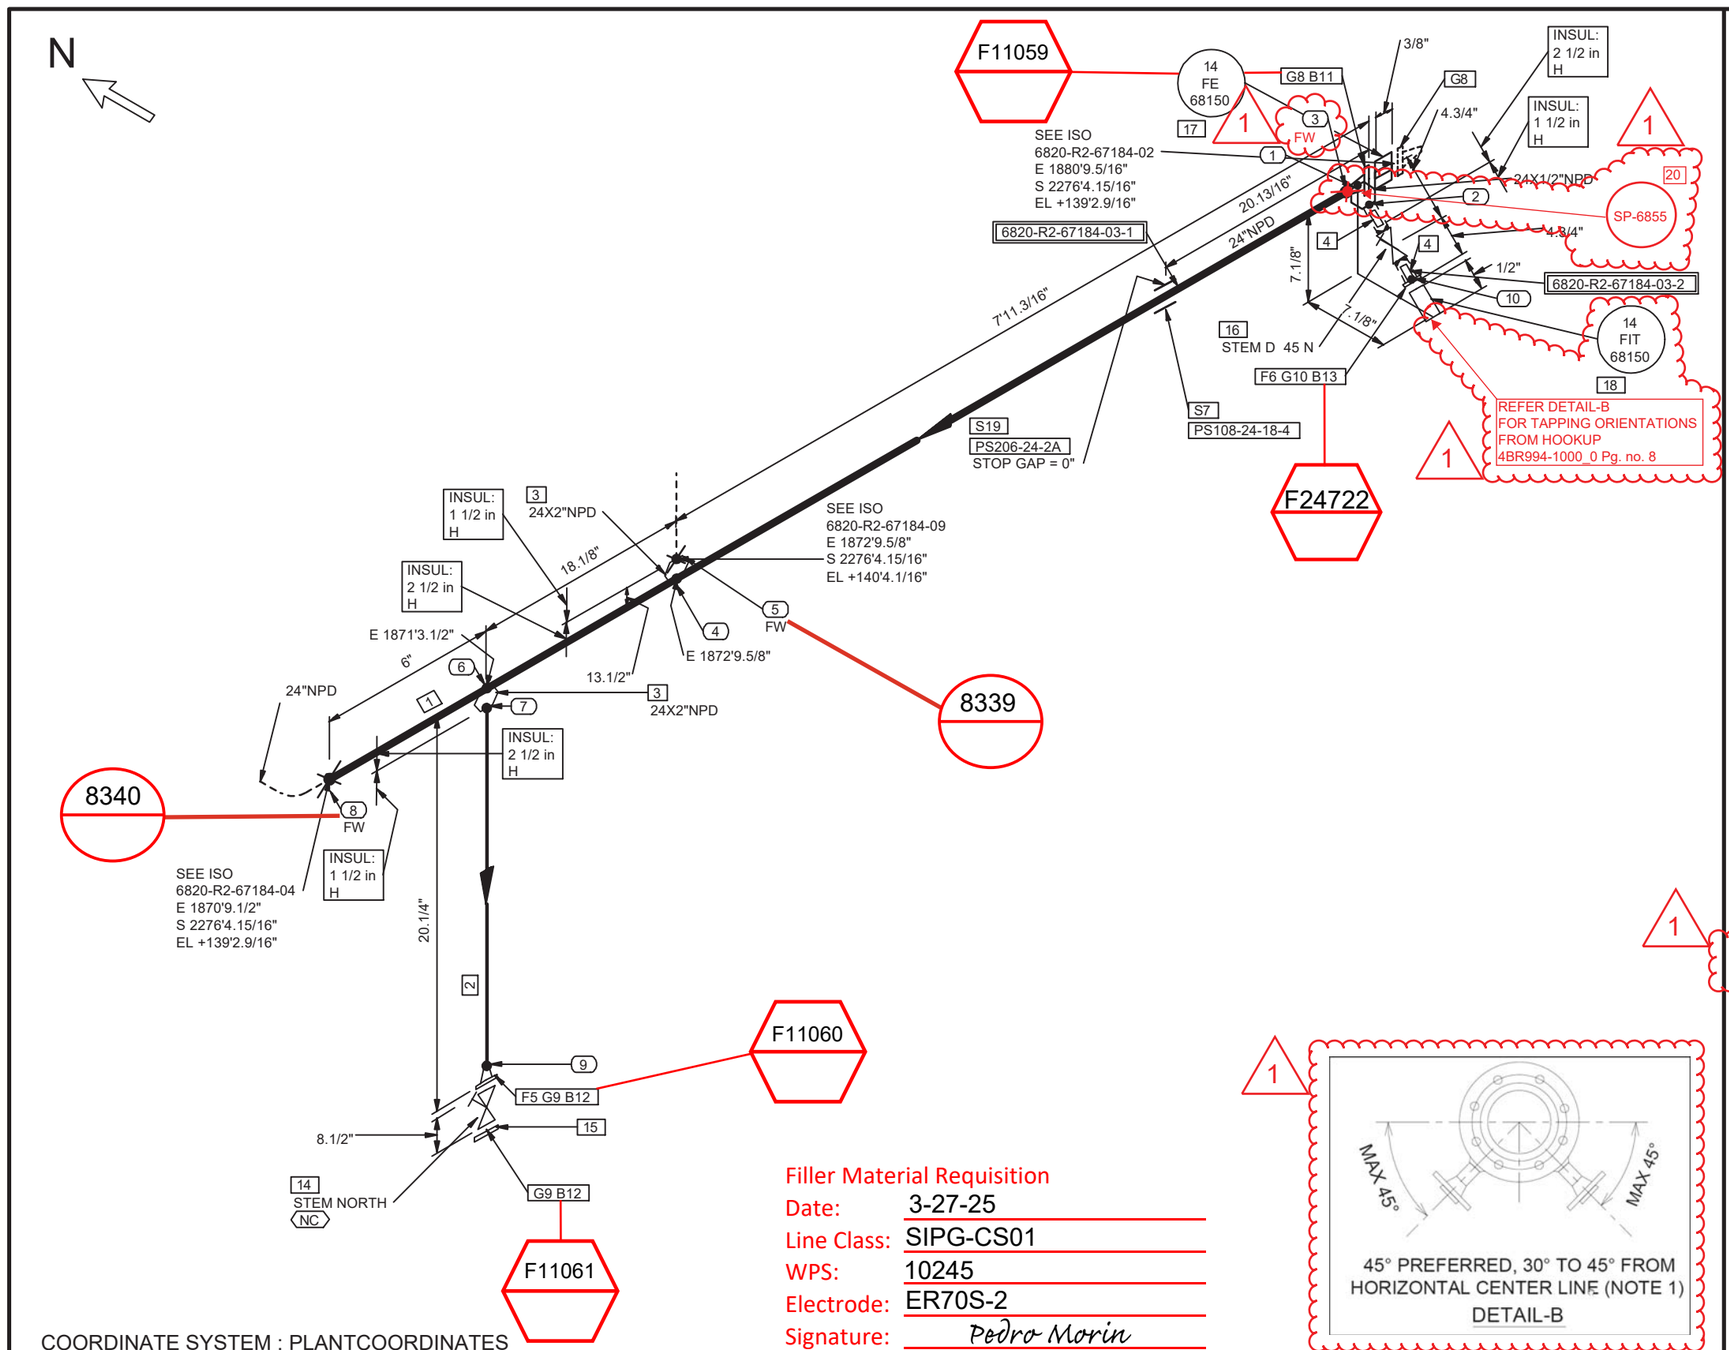

Filler Material Requisition

Date: 3-27-25

Line Class: SIPG-CS01

WPS: 10245

Electrode: ER70S-2

Signature: Pedro Morin

SHOP MATERIALS

NO	NPD	DESCRIPTION	IDENT	QTY
1	24	Pipes, Seamless, ASME B36.10, ASTM A106 Gr.B, BE, -, -, S-STD	CPP0AN0E	9.4 '
2	2	Pipes, Seamless, ASME B36.10, ASTM A106 Gr.B, BE, -, -, S-XS	CPP0AAUB	0.4 '
3	24X2	Weldolet, MSS SP-97, ASTM A105N, BW Ends, -, S-STD x S-XS	C133MPDV	2
4	1/2	Nipple, ASTM A106 Gr.B, PE/NPTM End, L = 3in, -, S-XS	C12GGPS4	2
5	2	WN Flg, ASME B16.5, ASTM A105N, 300 Lbs, RF/BW End, -, S-XS	CFG6WKK1	1
6	1/2	SW Flg, ASME B16.5, ASTM A105N, 300 Lbs, RF/SW End, -, x S-XS	CFG70GL4	1

PIPE SUPPORTS

7	24	PS108-24-18-4	PS108	1

OTHER THAN SHOP MATERIALS

NO	NPD	DESCRIPTION	IDENT	QTY
8	24	SW Gk, AISI 304/Graphite, 300 Lbs, RF as per ASME B16.5, Thk=1/8in, -, -,	CGKFEG67	2
9	2	SW Gk, AISI 304/Graphite, 300 Lbs, RF as per ASME B16.5, Thk=1/8in, -, -,	CGKFEG63	2
10	1/2	SW Gk, AISI 304/Graphite, 300 Lbs, RF as per ASME B16.5, Thk=1/8in, -, -,	CGKFEG5T	1
11	1.1/2	SBlt 2 HHx N, A193 Gr.B7/A194 Gr.2H, -, Xylan PTFE Coated, -9.75 in. Length	C6S4K8MF	24
12	5/8	SBlt 2 HHx N, A193 Gr.B7/A194 Gr.2H, -, Xylan PTFE Coated, -3.5 in. Length	C6S4K88R	16
13	1/2	SBlt 2 HHx N, A193 Gr.B7/A194 Gr.2H, -, Xylan PTFE Coated, -2.75 in. Length	C6S4K87U	4
14	2	Gat Flg, -, API 600, ASTM A216 Gr.WCB,300 Lbs, RF, Ends as per ASME B16.5, HO,-, Valve Tag: VG-4	C7J7XW2J	1
15	2	Bld Flg, ASME B16.5, ASTM A105N, 300 Lbs, RF, -,	CFG6WM77	1
16	1/2	Gat Fem, API 602, ASTM A105N,800 Lbs, NPTF Ends, HO,-, Valve Tag: VG-7	C80U8UAY	1
20	24x1/2	SP-6855		1

INSTRUMENTS

17	24	14-FE-68150	14-FE-68150	1
18	1/2	14-FIT-68150	14-FIT-68150	1

PIPE SUPPORTS

19	24	PS206-24-2A	PS206	1

PIECE MARKS

6820-R2-67184-03-1 6820-R2-67184-03-2

Turner Industries Group, LLC
Received
MARCH 27, 2025
DOCUMENT CONTROL

NOTES:

1. FOR LINE PRESSURES, TEMPERATURES, INSULATION TYPE AND THICKNESS, ETC. REFER TO LATEST REVISION OF LDT.
2. FOR STANDARD PIPE SUPPORT DETAILS SEE PROJECT STANDARD.
3. FIELD SHIM TO SUIT UNLESS OTHERWISE NOTED.
4. FOR PWHT REQUIREMENTS REFER TO LINE CLASS SPECIFICATION.
5. ALL THREADED PIPE LINE SYSTEMS, FIELD SHALL VERIFY DIMENSION PRIOR TO ERECTION.
6. FFW DESIGNATION AT WELDS INDICATES FIELD FIT WELD, WHERE PIPE FABRICATOR IS TO ADD 9 INCH OF PIPE TO THE ISOMETRIC DIMENSION TO ENABLE THE FIELD TO CUT TO FIT AT SITE.
7. REFER TO 202998C-000-W1-1300-0001 FOR FRP AND DUAL-LAM FABRICATION.

T.EN TECHNIP ENERGIES

Information contained in this document is the work product of one or more legal entities of Technip Energies N.V. and embodies confidential and proprietary information of the applicable entity and/or its client.use of this information is restricted in accordance with conditions specified by the contract.Technip Energies N.V. and its affiliates disclaim any and all liabilities for any changes or modifications to this document which are made by any person other than the entity that issued the document under the applicable client contract.

THIS DOCUMENT IS UNCONTROLLED WHEN REPRODUCED

REV	DATE	BY	DESCRIPTION	CHKD	MTO	STRESS	APRVD
1	2025-03-21	RVA	ISSUED FOR CONSTRUCTION	SAD	KJK	SMR	GR
0	2024-11-22	RVA	ISSUED FOR CONSTRUCTION	SAD	KJK	SMR	GR

SERVICE:	VAPOR/LIQUID:	INSUL TYPE:	INSUL THK:	SHOP:	FIELD:	PAINT CODE:	MODULE:
R2	V	Per LDT	Per LDT	Y	Y	Per LDT	-

OXY

OxyChem Redstone Battleground
PROJECT

P&ID: 202998C-001-PID-0021-0320

UNIT#:	EWP AREA:	SPEC:	STRESS CALC #:
6800	6820	SIPG-CS01	CN-0023

LINE No.: 24"-R2-67184-SIPG-CS01-H

DRAWING NUMBER: 6820-R2-67184-03

REV.: 1

23 NOV 2024 07:12