


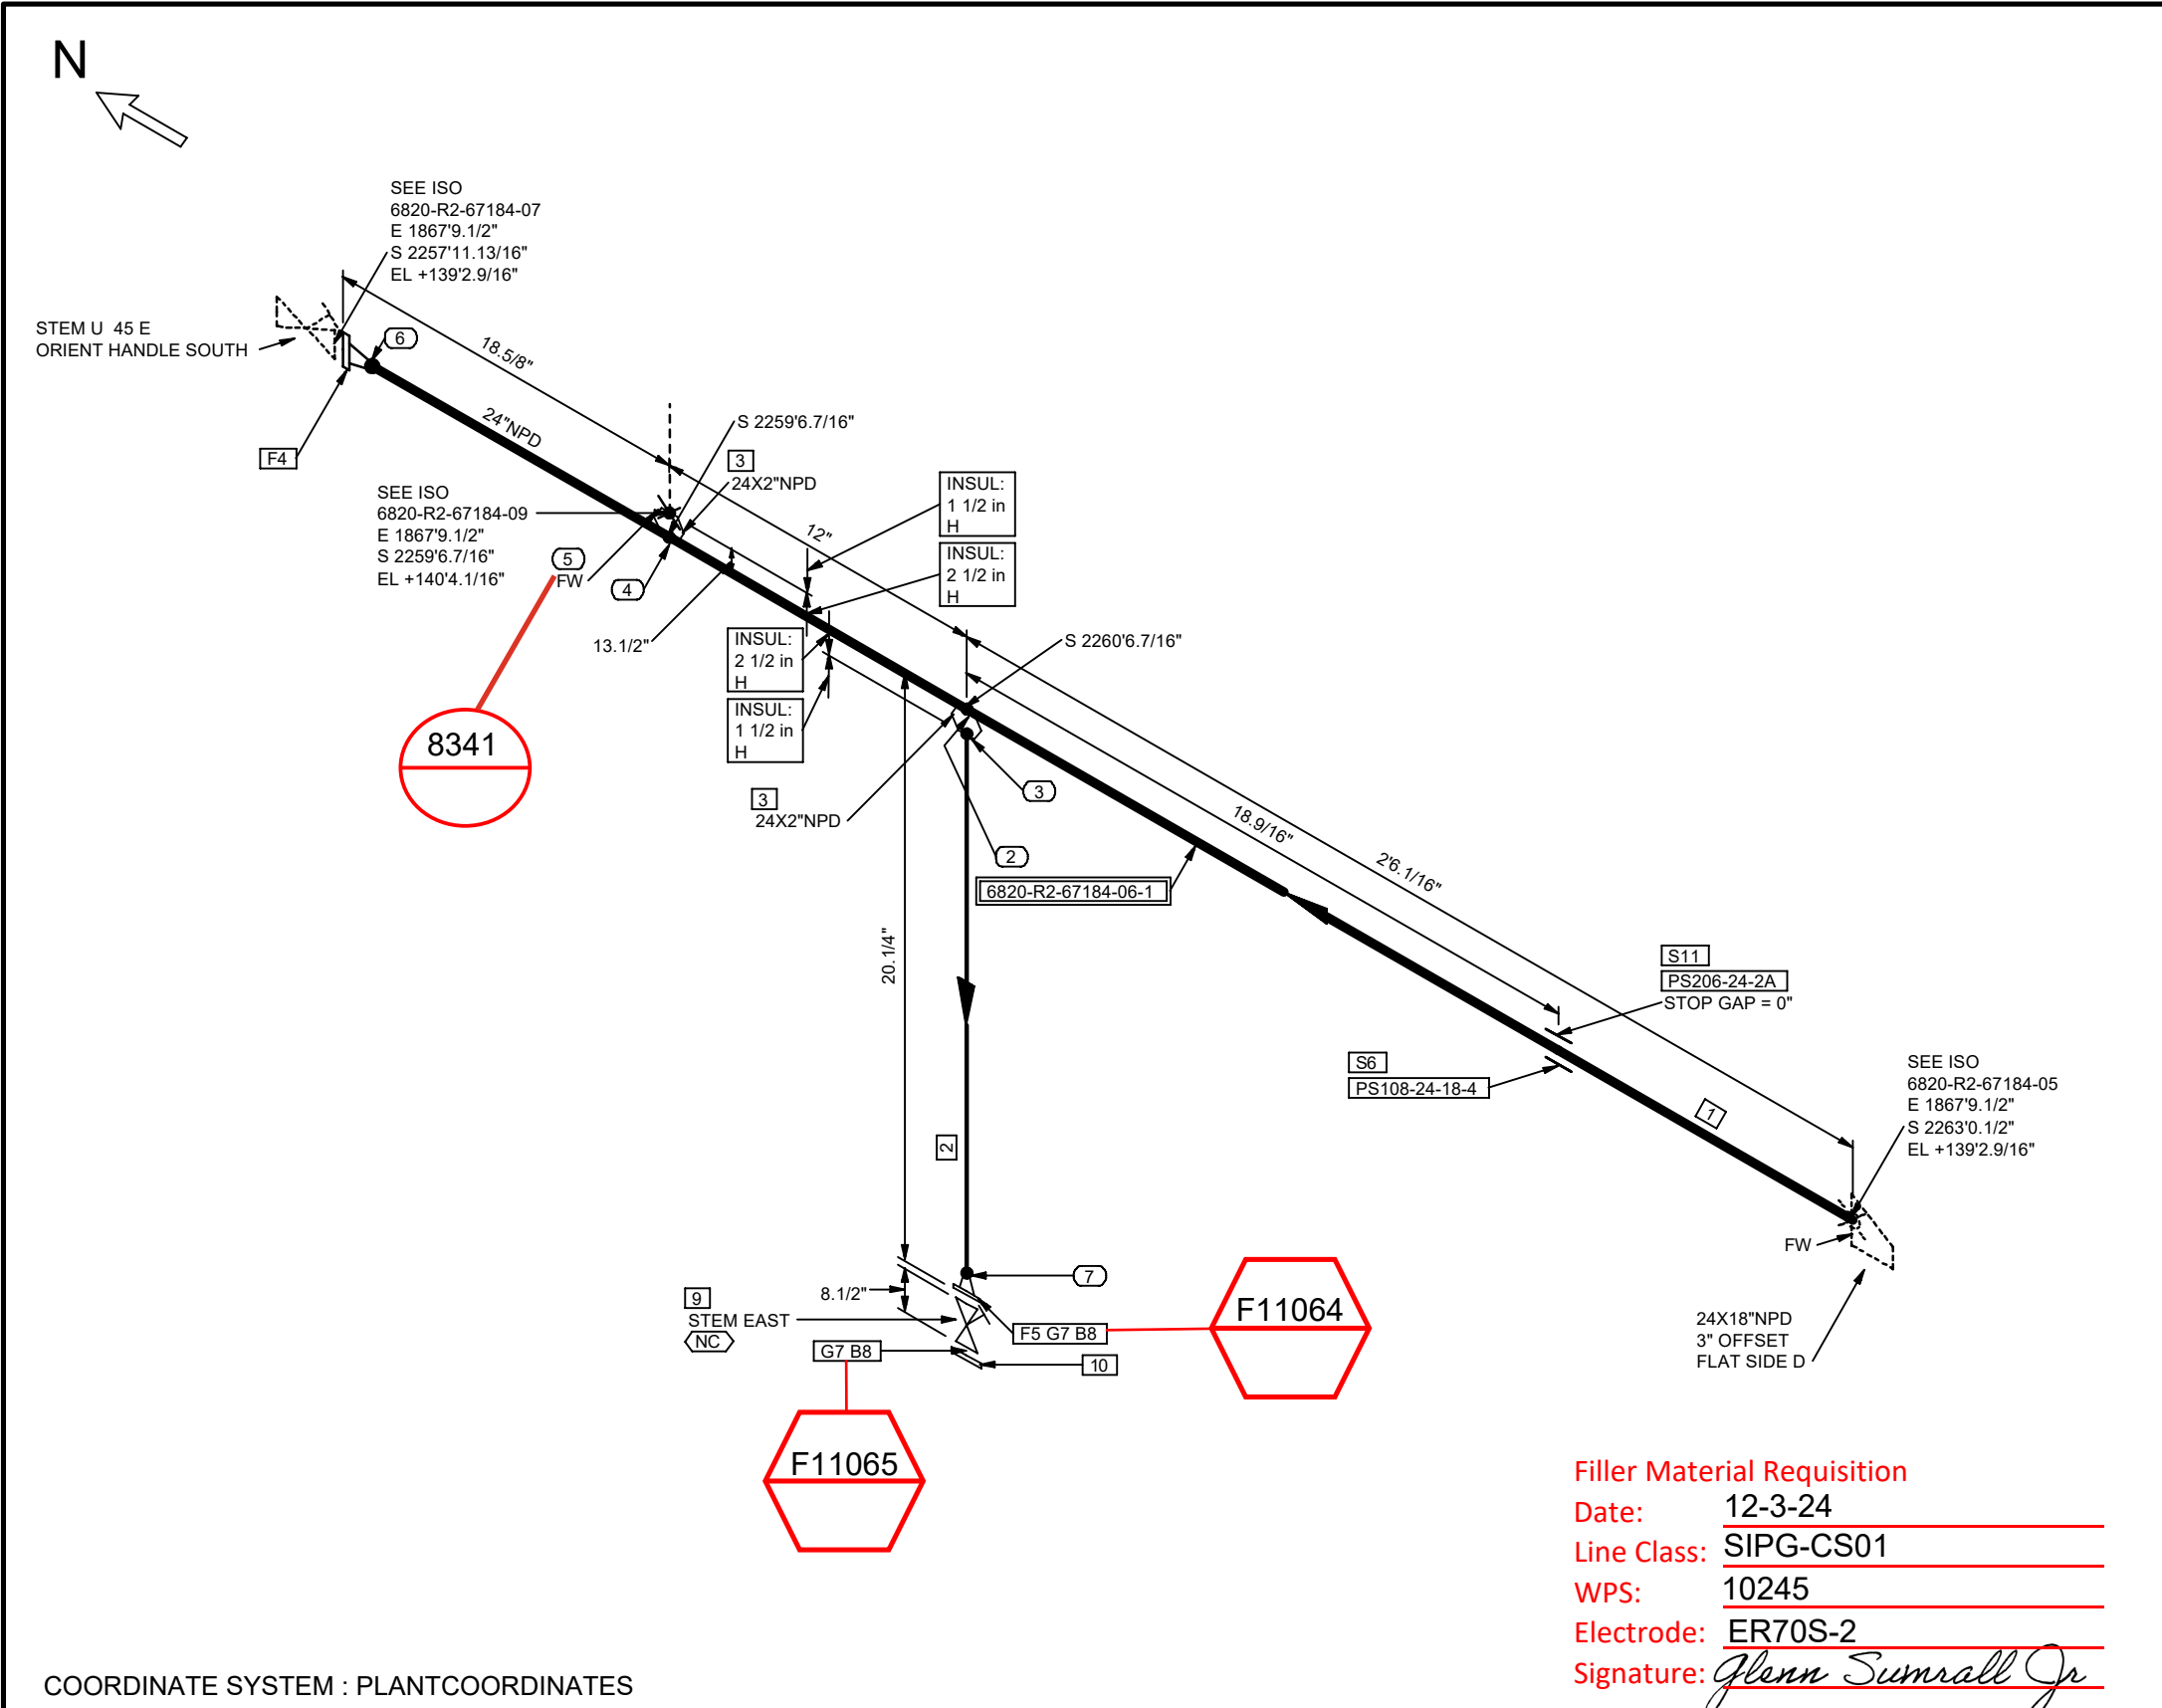

COORDINATE SYSTEM : PLANTCOORDINATES

Filler Material Requisition

Date: 12-3-24
Line Class: SIPG-CS01
WPS: 10245
Electrode: ER70S-2
Signature: *Glenn Sumrall Jr*

SHOP MATERIALS							
NO	NPD	DESCRIPTION	IDENT	QTY			
1	24	Pipes, Seamless, ASME B36.10, ASTM A106 Gr.B, BE, -, -, S-STD	CPP0AN0E	4.6 '			
2	2	Pipes, Seamless, ASME B36.10, ASTM A106 Gr.B, BE, -, -, S-XS	CPP0AAUB	0.4 '			
3	24X2	Weldolet, MSS SP-97, ASTM A105N, BW Ends, -, S-STD x S-XS	C133MPDV	2			
4	24	WN Flg, ASME B16.5, ASTM A105N, 300 Lbs, RF/BW End, -, S-STD	CFG6WKNU	1			
5	2	WN Flg, ASME B16.5, ASTM A105N, 300 Lbs, RF/BW End, -, S-XS	CFG6WKK1	1			
PIPE SUPPORTS							
6	24	PS108-24-18-4	PS108	1			
OTHER THAN SHOP MATERIALS							
NO	NPD	DESCRIPTION	IDENT	QTY			
7	2	SW Gk, AISI 304/Graphite, 300 Lbs, RF as per ASME B16.5, Thk=1/8in, -, -,	CGKFEG63	2			
8	5/8	SBlt 2 HHx N, A193 Gr.B7/A194 Gr.2H, -, Xylan PTFE Coated, - 3.5 in. Length	C6S4K88R	16			
9	2	Gat Flg, -, API 600, ASTM A216 Gr.WCB,300 Lbs, RF, Ends as per ASME B16.5, HO,-, Valve Tag: VG-4	C7J7XW2J	1			
10	2	Bld Flg, ASME B16.5, ASTM A105N, 300 Lbs, RF, -,	CFG6WM77	1			
PIPE SUPPORTS							
11	24	PS206-24-2A	PS206	1			
PIECE MARKS							
6820-R2-67184-06-1							
Turner Industries Group, LLC Received DECEMBER 03, 2024 DOCUMENT CONTROL							
SERVICE: R2	VAPOR/LIQUID: V	INSUL TYPE: Per LDT	INSUL THK: Per LDT	SHOP: Y	FIELD: Y	PAINT CODE: Per LDT	MODULE: -
		P&ID: 202998C-001-PID-0021-0320					
		UNIT#: 6800	EW P AREA: 6820	SPEC: SIPG-CS01	STRESS CALC #: CN-0023		
		LINE No. 24"-R2-67184-SIPG-CS01-H					
		DRAWING NUMBER 6820-R2-67184-06					
OxyChem Redstone Battleground PROJECT		REV. 0					

- NOTES:
- FOR LINE PRESSURES, TEMPERATURES, INSULATION TYPE AND THICKNESS, ETC. REFER TO LATEST REVISION OF LDT.
 - FOR STANDARD PIPE SUPPORT DETAILS SEE PROJECT STANDARD.
 - FIELD SHIM TO SUIT UNLESS OTHERWISE NOTED.
 - FOR PWHT REQUIREMENTS REFER TO LINE CLASS SPECIFICATION.
 - ALL THREADED PIPE LINE SYSTEMS, FIELD SHALL VERIFY DIMENSION PRIOR TO ERECTION.
 - FFW DESIGNATION AT WELDS INDICATES FIELD FIT WELD, WHERE PIPE FABRICATOR IS TO ADD 9 INCH OF PIPE TO THE ISOMETRIC DIMENSION TO ENABLE THE FIELD TO CUT TO FIT AT SITE.
 - REFER TO 202998C-000-W1-1300-0001 FOR FRP AND DUAL-LAM FABRICATION.



TECHNIP ENERGIES

Information contained in this document is the work product of one or more legal entities of Technip Energies N.V. and embodies confidential and proprietary information of the applicable entity and/or its client. Use of this information is restricted in accordance with conditions specified by the contract. Technip Energies N.V. and its affiliates disclaim any and all liabilities for any changes or modifications to this document which are made by any person other than the entity that issued the document under the applicable client contract.

THIS DOCUMENT IS UNCONTROLLED WHEN REPRODUCED

0	2024-11-22	RVA	ISSUED FOR CONSTRUCTION	SAD	KJK	SMR	GR
REV	DATE	BY	DESCRIPTION	CHKD	MTD	STRESS	APRVD



OxyChem Redstone Battleground PROJECT

6800

6820

6820-R2-67184-SIPG-CS01-H

